


RE: Galion City
Report
Drinking Water Program
Crawford County
PWS ID: OH1700211

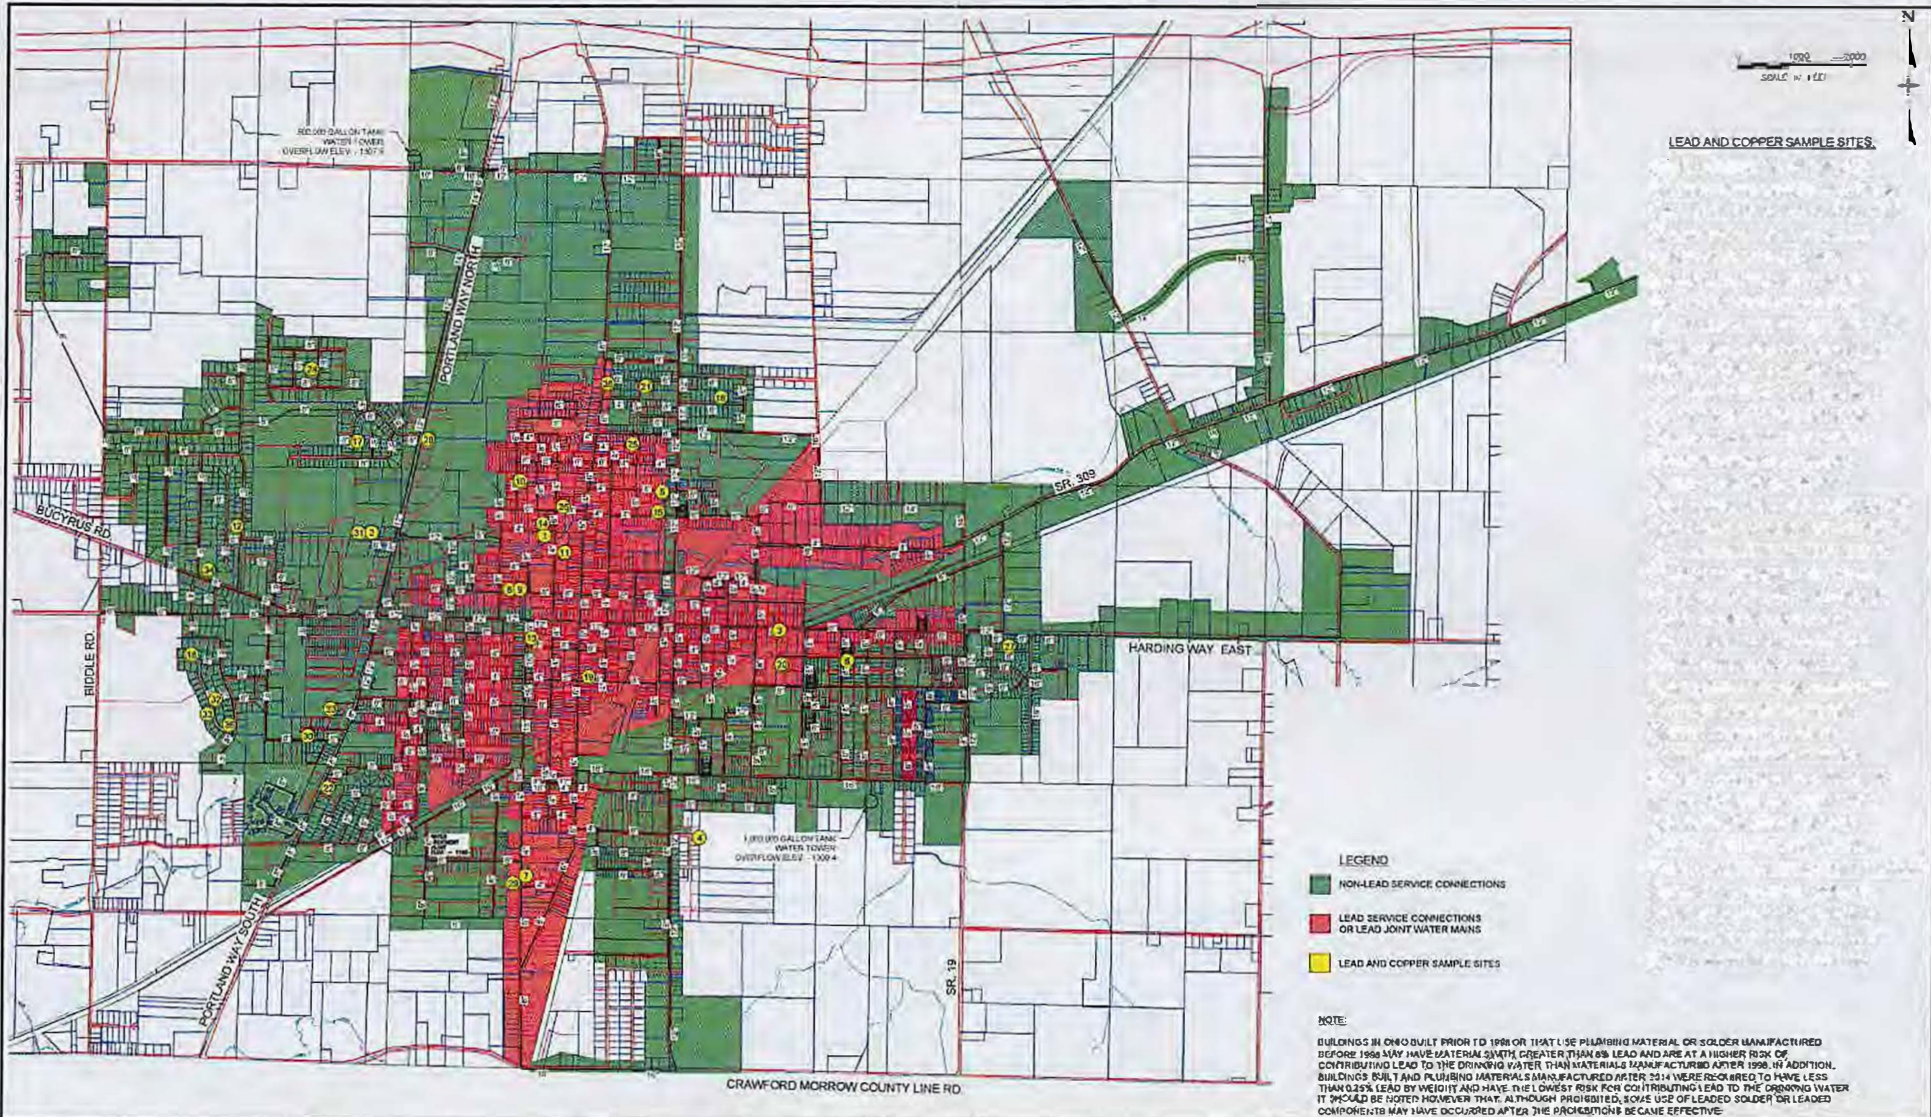

LEGEND

- NON-LEAD SERVICE CONNECTIONS
- LEAD SERVICE CONNECTIONS OR LEAD JOINT WATER MAINS
- LEAD AND COPPER SAMPLE SITES

NOTE:
 BUILDINGS IN OHIO BUILT PRIOR TO 1986 OR THAT USE PLUMBING MATERIAL OR SOLDER MANUFACTURED BEFORE 1986 MAY HAVE MATERIAL WITH GREATER THAN 8% LEAD AND ARE AT A HIGHER RISK OF CONTRIBUTING LEAD TO THE DRINKING WATER THAN MATERIALS MANUFACTURED AFTER 1986. IN ADDITION, BUILDINGS BUILT AND PLUMBING MATERIALS MANUFACTURED AFTER 1986 ARE REQUIRED TO HAVE LESS THAN 0.25% LEAD BY WEIGHT AND HAVE THE LOWEST RISK FOR CONTRIBUTING LEAD TO THE DRINKING WATER. IT SHOULD BE NOTED HOWEVER THAT, ALTHOUGH PROHIBITED, SOME USE OF LEADED SOLDER OR LEADED COMPONENTS MAY HAVE OCCURRED AFTER THE PROHIBITION BECAME EFFECTIVE.

LATEST REFERENCE		REVISIONS	
DATE	DESCRIPTION	NO.	DESCRIPTION

Prepared by
akeever & Associates, Inc.
 10000 W. 11th St., Suite 100
 Overland Park, KS 66211
 Phone: 913.241.1111

OVERALL LAYOUT
LEAD MAPPING IN DISTRIBUTION SYSTEM
 PWS ID: OH 1700211

DATE: _____
 SHEET NO.: _____
 CONTRACT NO.: _____
 COMPLETION DATE: _____
 CONTRACTOR: _____

CITY OF GALION, OHIO

State - 100% = 10' HORIZ
 Vert = 1" = 10' VERT
 Design Sheet Size = 24"x36"
 Date: _____

Sheet No. 1 of 1
 53307000101
 Date: 11/23/11 11:24:27

RECEIVED

MAR 01 2017

DDAGW - NWDO

Revised