

RE: Franklin Elem Sch / Mercer Co Head Start
Report
Drinking Water Program
Mercer County
PWS ID: OH5432412

FRANKLIN ELEMENTARY / MERCER COUNTY HEAD START

PWS ID# OH 5432412



Well and Service Line into Building

Original Building Constructed – 1941

Expansion/Remodeling – 1998

All Copper Lines – Lead Solder in Older
Construction


RECEIVED

MAR 02 2017

DDAGW - NWDO

Legend

- Sink
- ▲ Restroom
- ★ Drinking Fountain
- Well

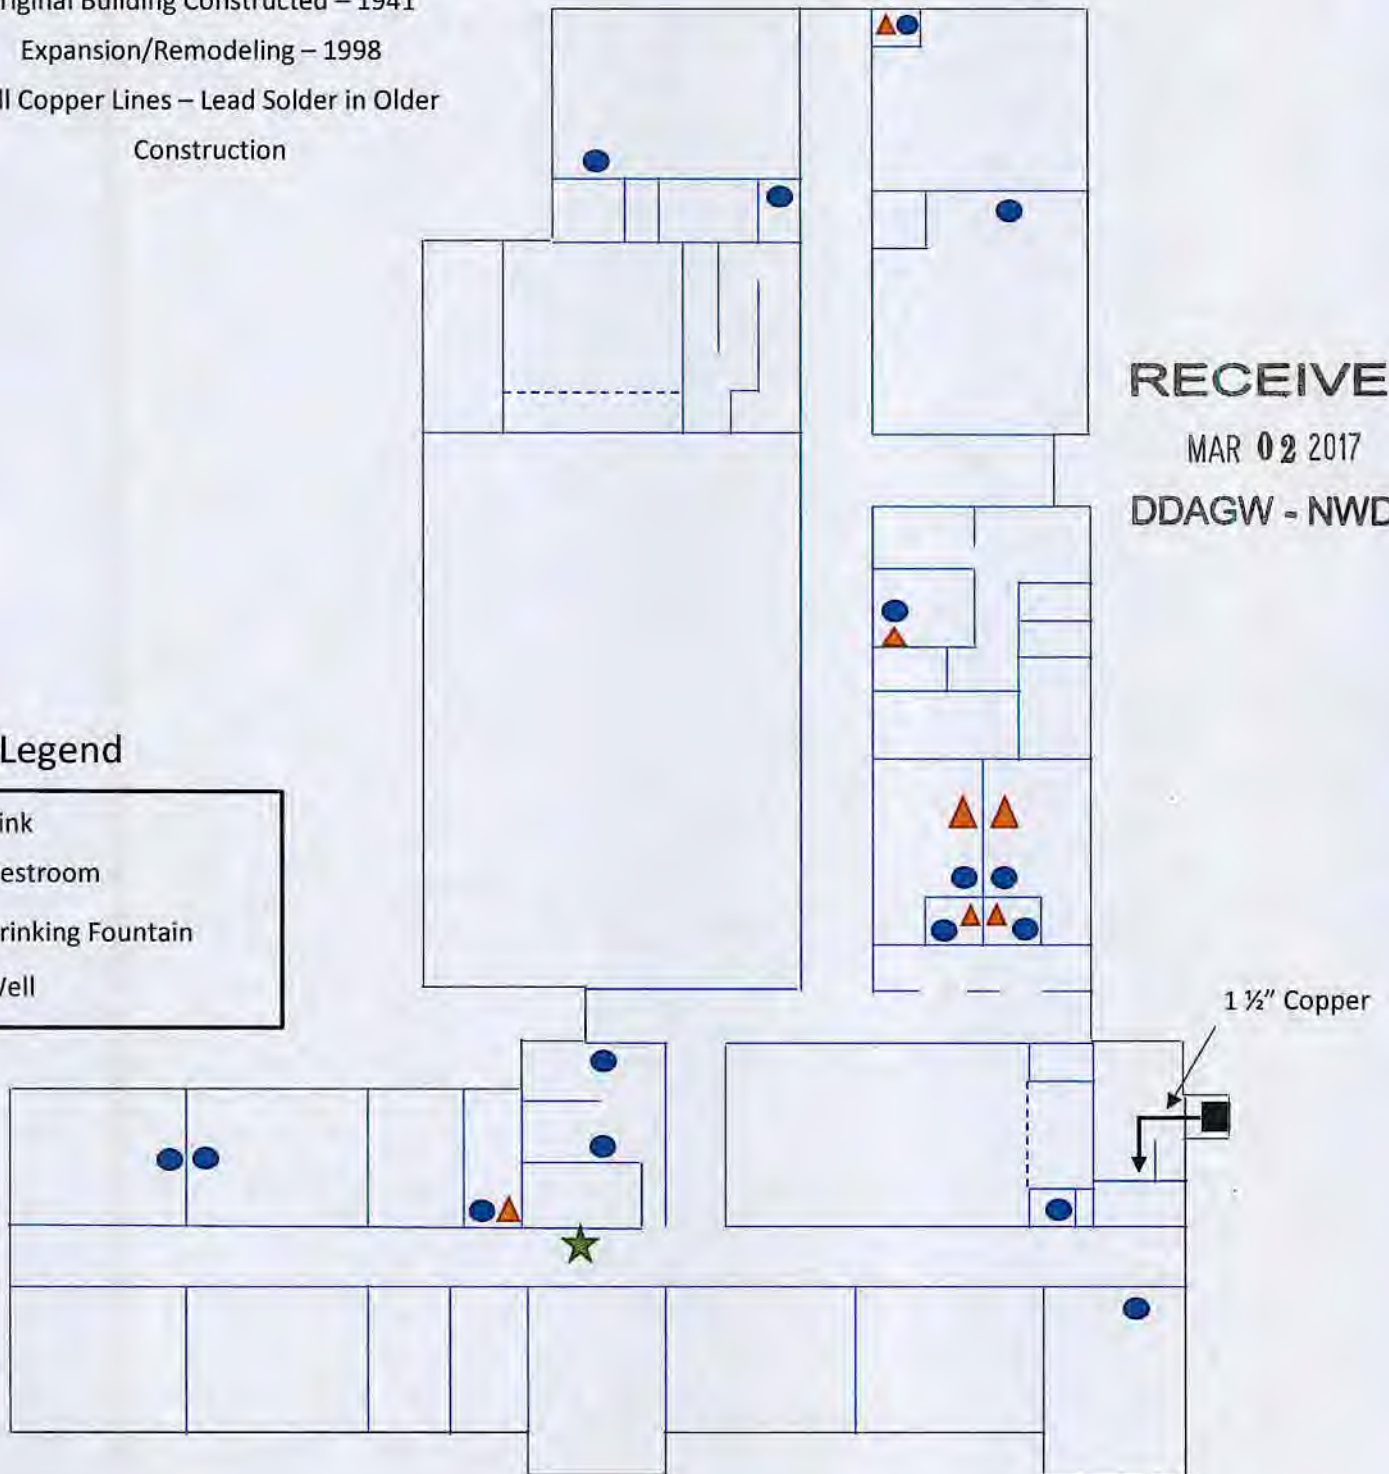

FRANKLIN ELEMENTARY / MERCER COUNTY HEAD START

PWS ID# OH 5432412



Hot Water Service Lines


Original Building Constructed – 1941

Expansion/Remodeling – 1998

All Copper Lines – Lead Solder in Older
Construction

Legend

- Sink
- ▲ Restroom
- ★ Drinking Fountain
- Well

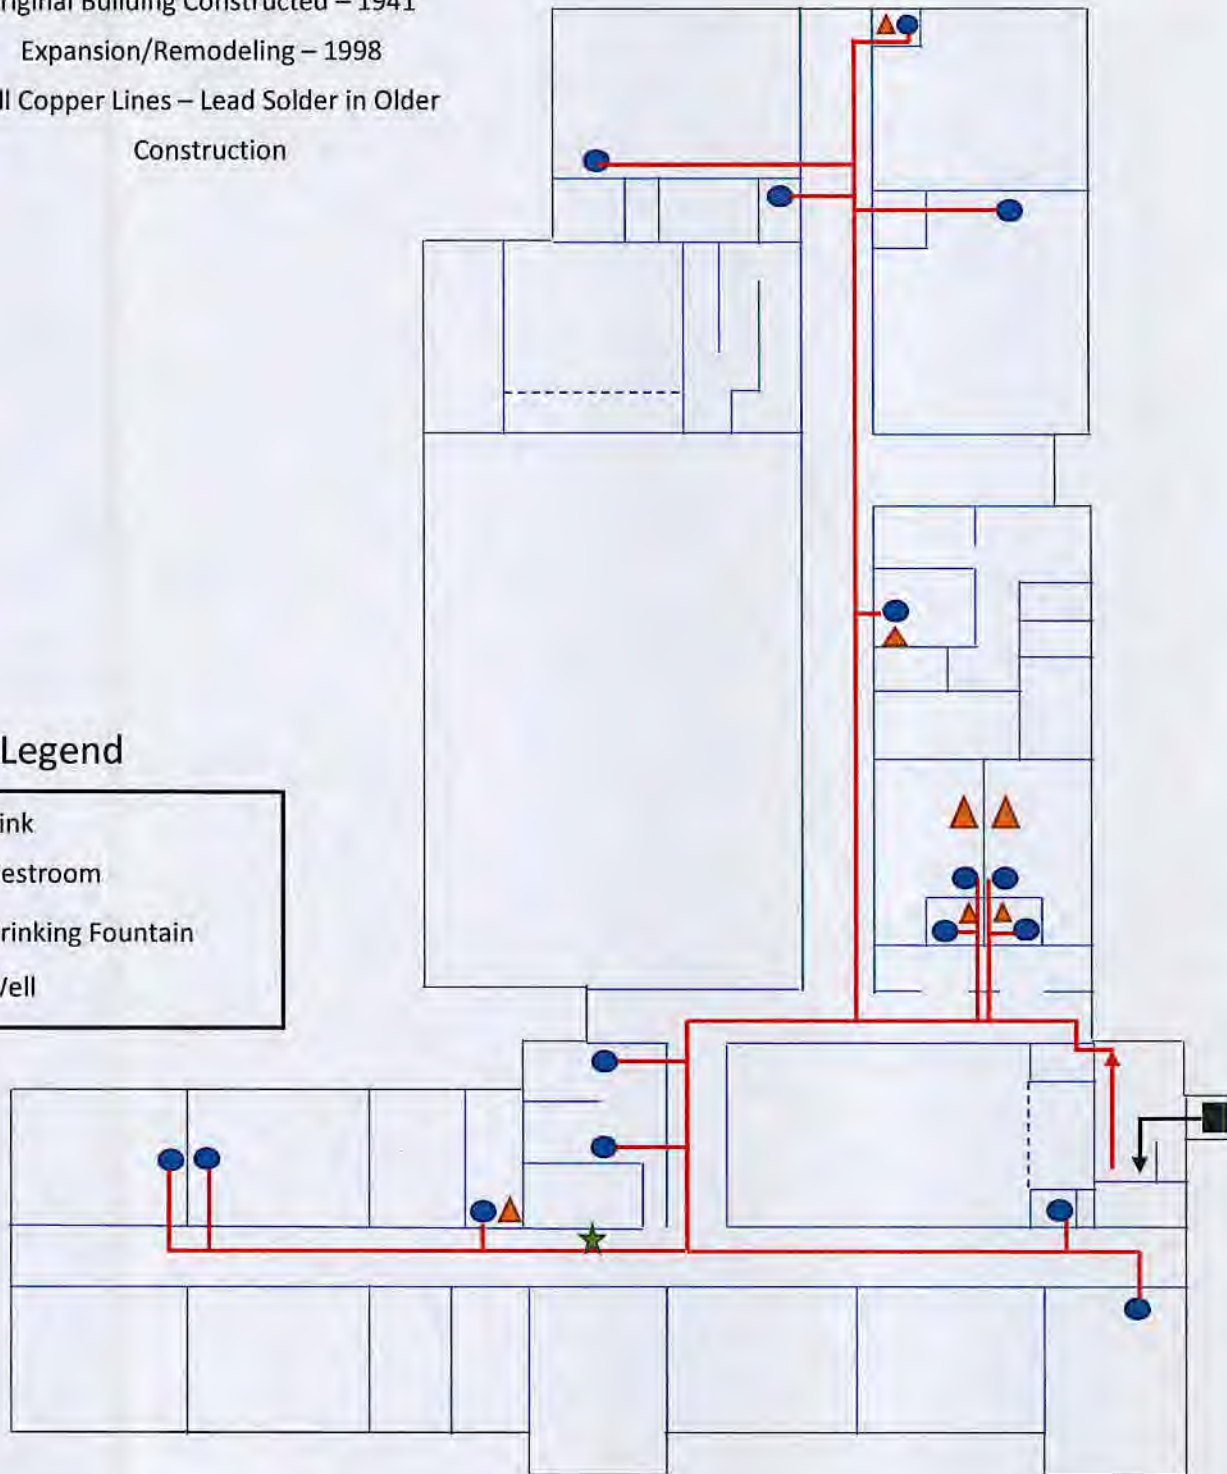

FRANKLIN ELEMENTARY / MERCER COUNTY HEAD START

PWS ID# OH 5432412




Cold Water Service Lines

Original Building Constructed – 1941
Expansion/Remodeling – 1998
All Copper Lines – Lead Solder in Older
Construction

Legend

- Sink
- ▲ Restroom
- ★ Drinking Fountain
- Well

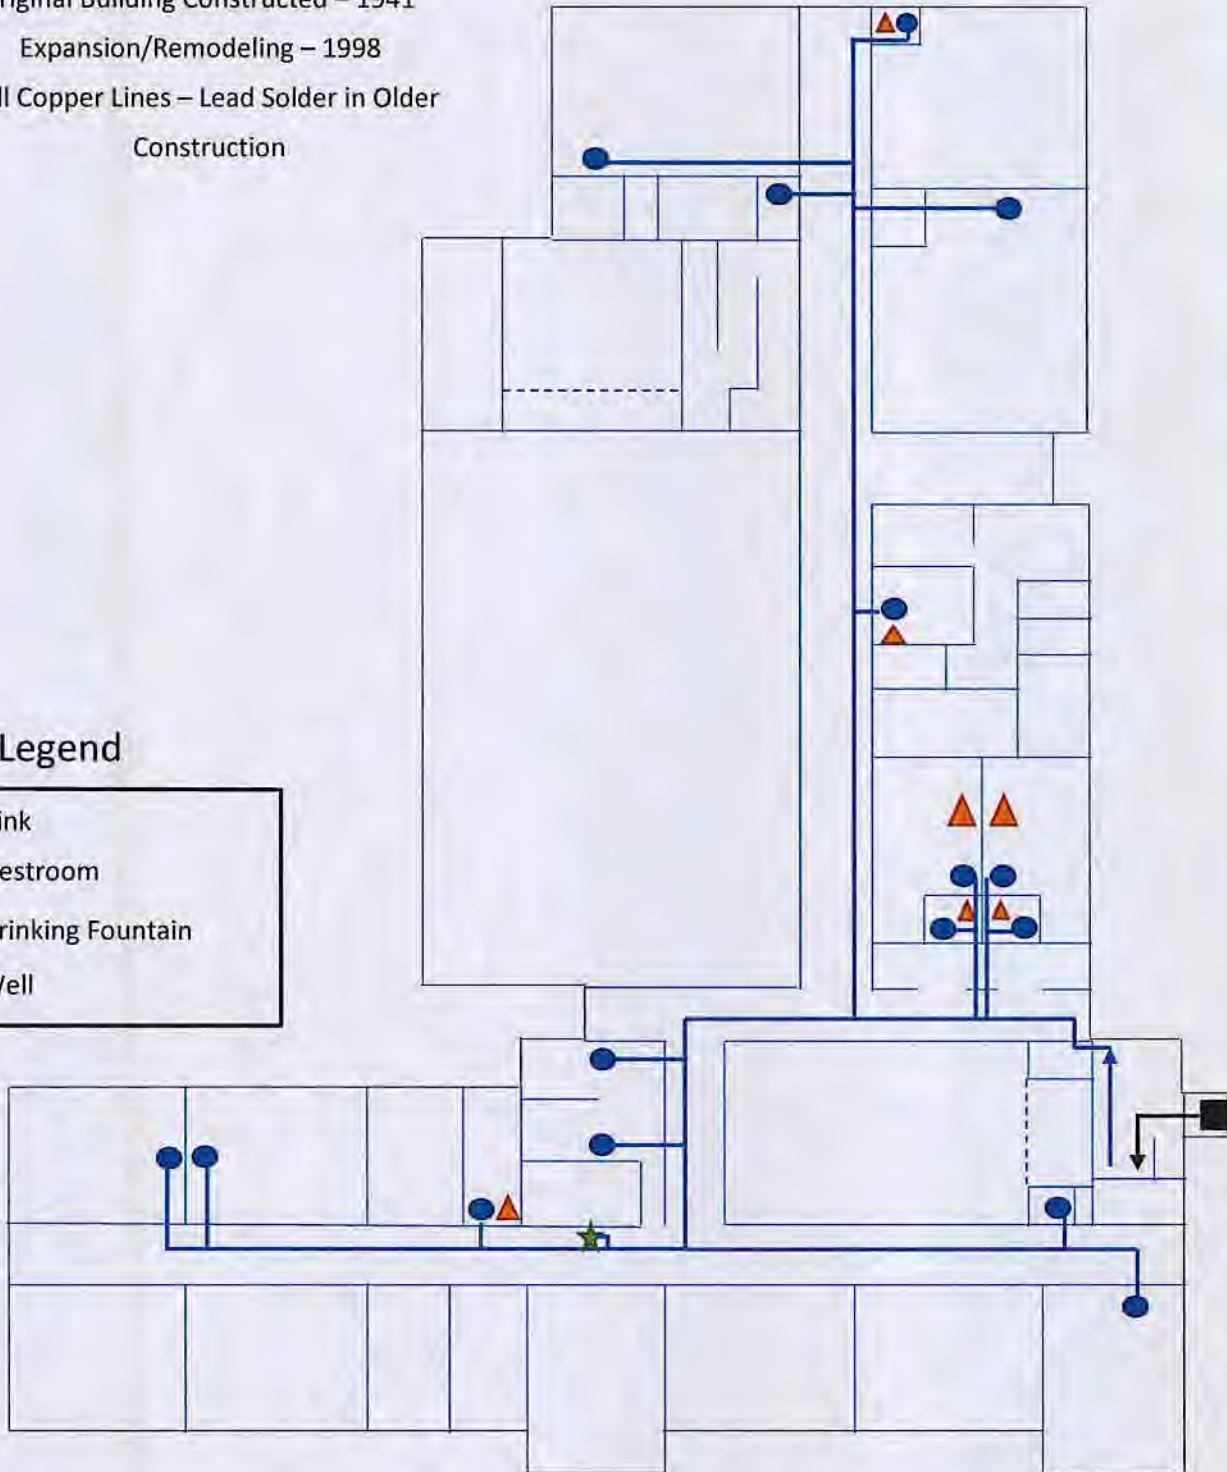


FRANKLIN ELEMENTARY / MERCER COUNTY HEAD START


PWS ID# OH 5432412







Lines/Fixtures with Potential Lead Solder


Original Building Constructed – 1941
Expansion/Remodeling – 1998
All Copper Lines – Lead Solder in Older
Construction

 Original Construction (1941)
Potential Lead Solder

 1998 Expansion
(No Lead Solder)

Legend

-  Sink
-  Restroom
-  Drinking Fountain
-  Well

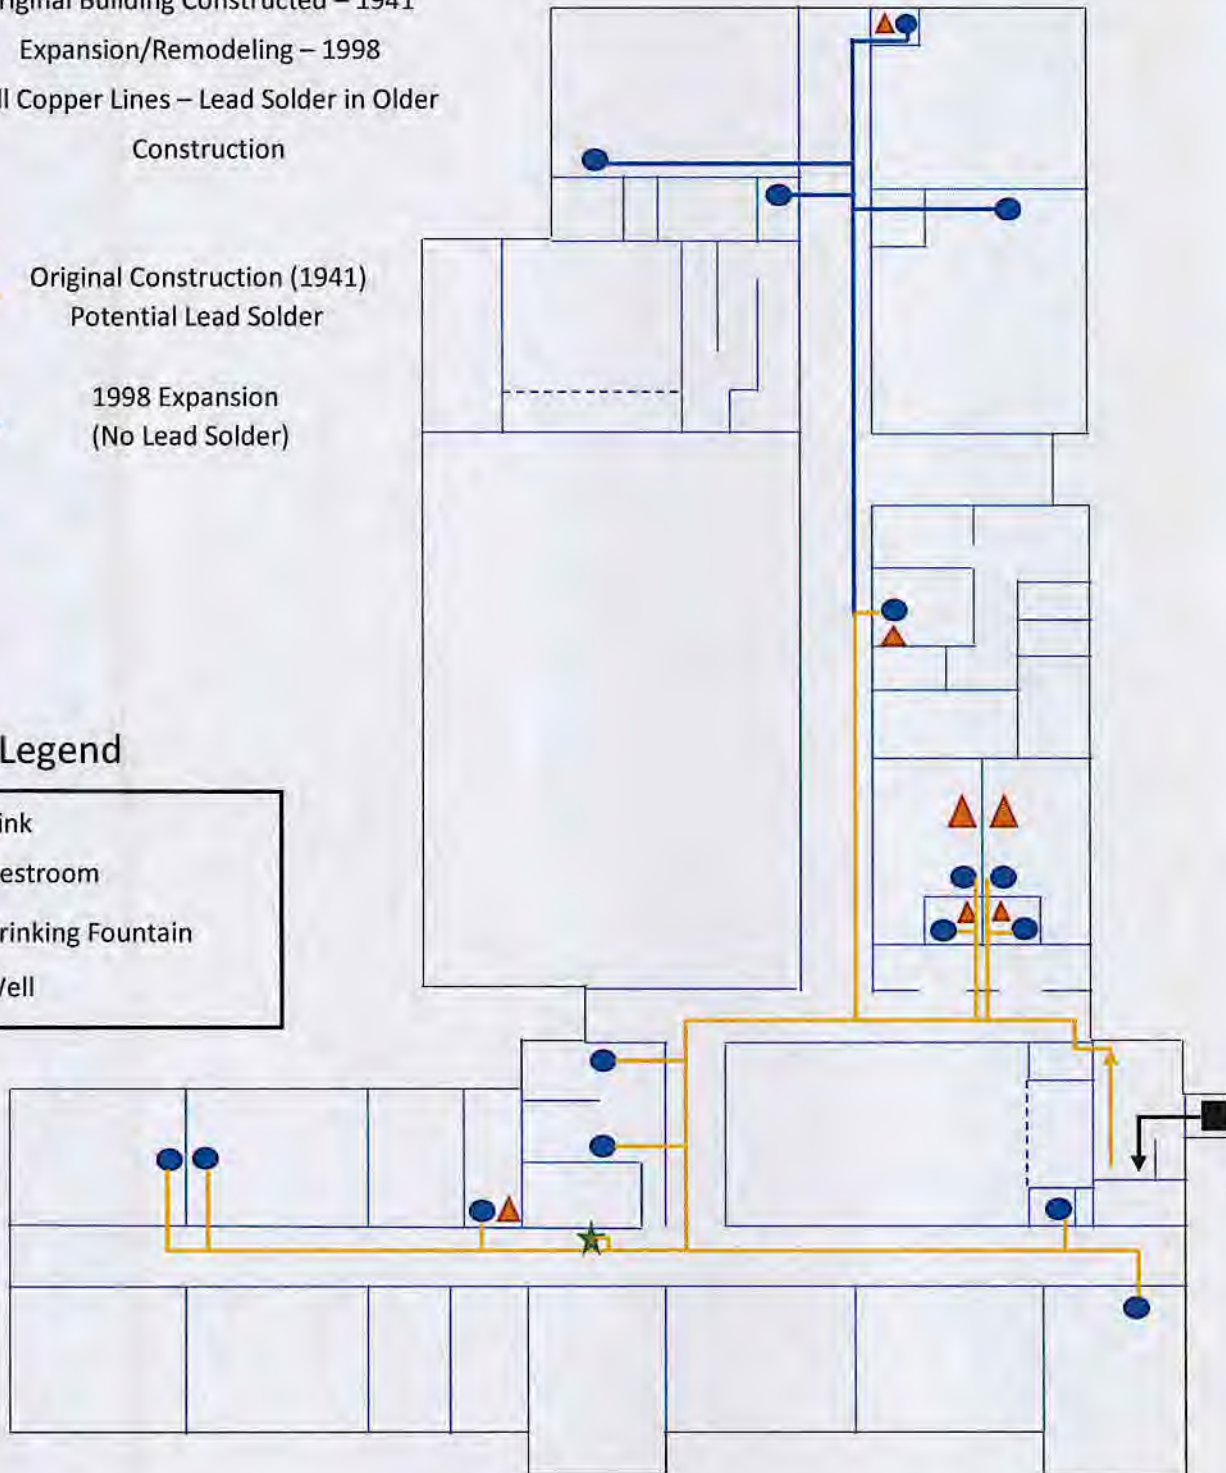

FRANKLIN ELEMENTARY / MERCER COUNTY HEAD START

PWS ID# OH 5432412



Lead/Copper Sampling Locations

Original Building Constructed – 1941
Expansion/Remodeling – 1998
All Copper Lines – Lead Solder in Older Construction

- LC201 – Main Kitchen Sink
- LC202 – Drinking Fountain (South Hall)
- LC203 – Teacher's Breakroom - Restroom
- LC204 – Men's Restroom – Center Hall
- LC205 – (Former) Nurse's Office

Legend

- Sink
- Restroom
- Drinking Fountain
- Well

