



City of Chardon

Chardon Municipal Center - 111 Water Street • Chardon, Ohio 44024-1201

10/25/2016

www.chardon.cc

To whom it may concern,

I have worked for the City of Chardon for thirty plus years. My men and I have repaired many water leaks, both water mains and service lines. We have yet to come across any lead service lines from the water main to the resident's home. We have also been in a large majority of the homes in Chardon to change out water meters. My men and I do not recall coming across any lead service lines in the home at the meter. This is the reason for **NO HIGH RISK AREAS** being identified on the map of the City of Chardon water system.

Jim Berkey

Superintendent, City of Chardon Water and Wastewater

CITY COUNCIL

CITY MANAGER

440-286-2600

Fax: 440-286-2658

FINANCE

440-286-2470

Fax: 440-286-2658

Water & Sewer Billing

440-286-2949

Fax: 440-286-2658

PARK & RECREATION

440-286-2630

Fax: 440-286-2658

POLICE

440-286-6123

Fax: 440-286-2680

PLANNING & ZONING

440-286-2654

Fax: 440-286-5541

PUBLIC SERVICE

440-286-2655

Fax: 440-286-5541

Division of Streets,
Cemeteries & Parks

440-286-2656


Fax: 440-286-2681

Division of Water
& Wastewater

440-286-2657

Fax: 440-286-7538

City of Chardon
Lead Vulnerability Map
10/25/2016

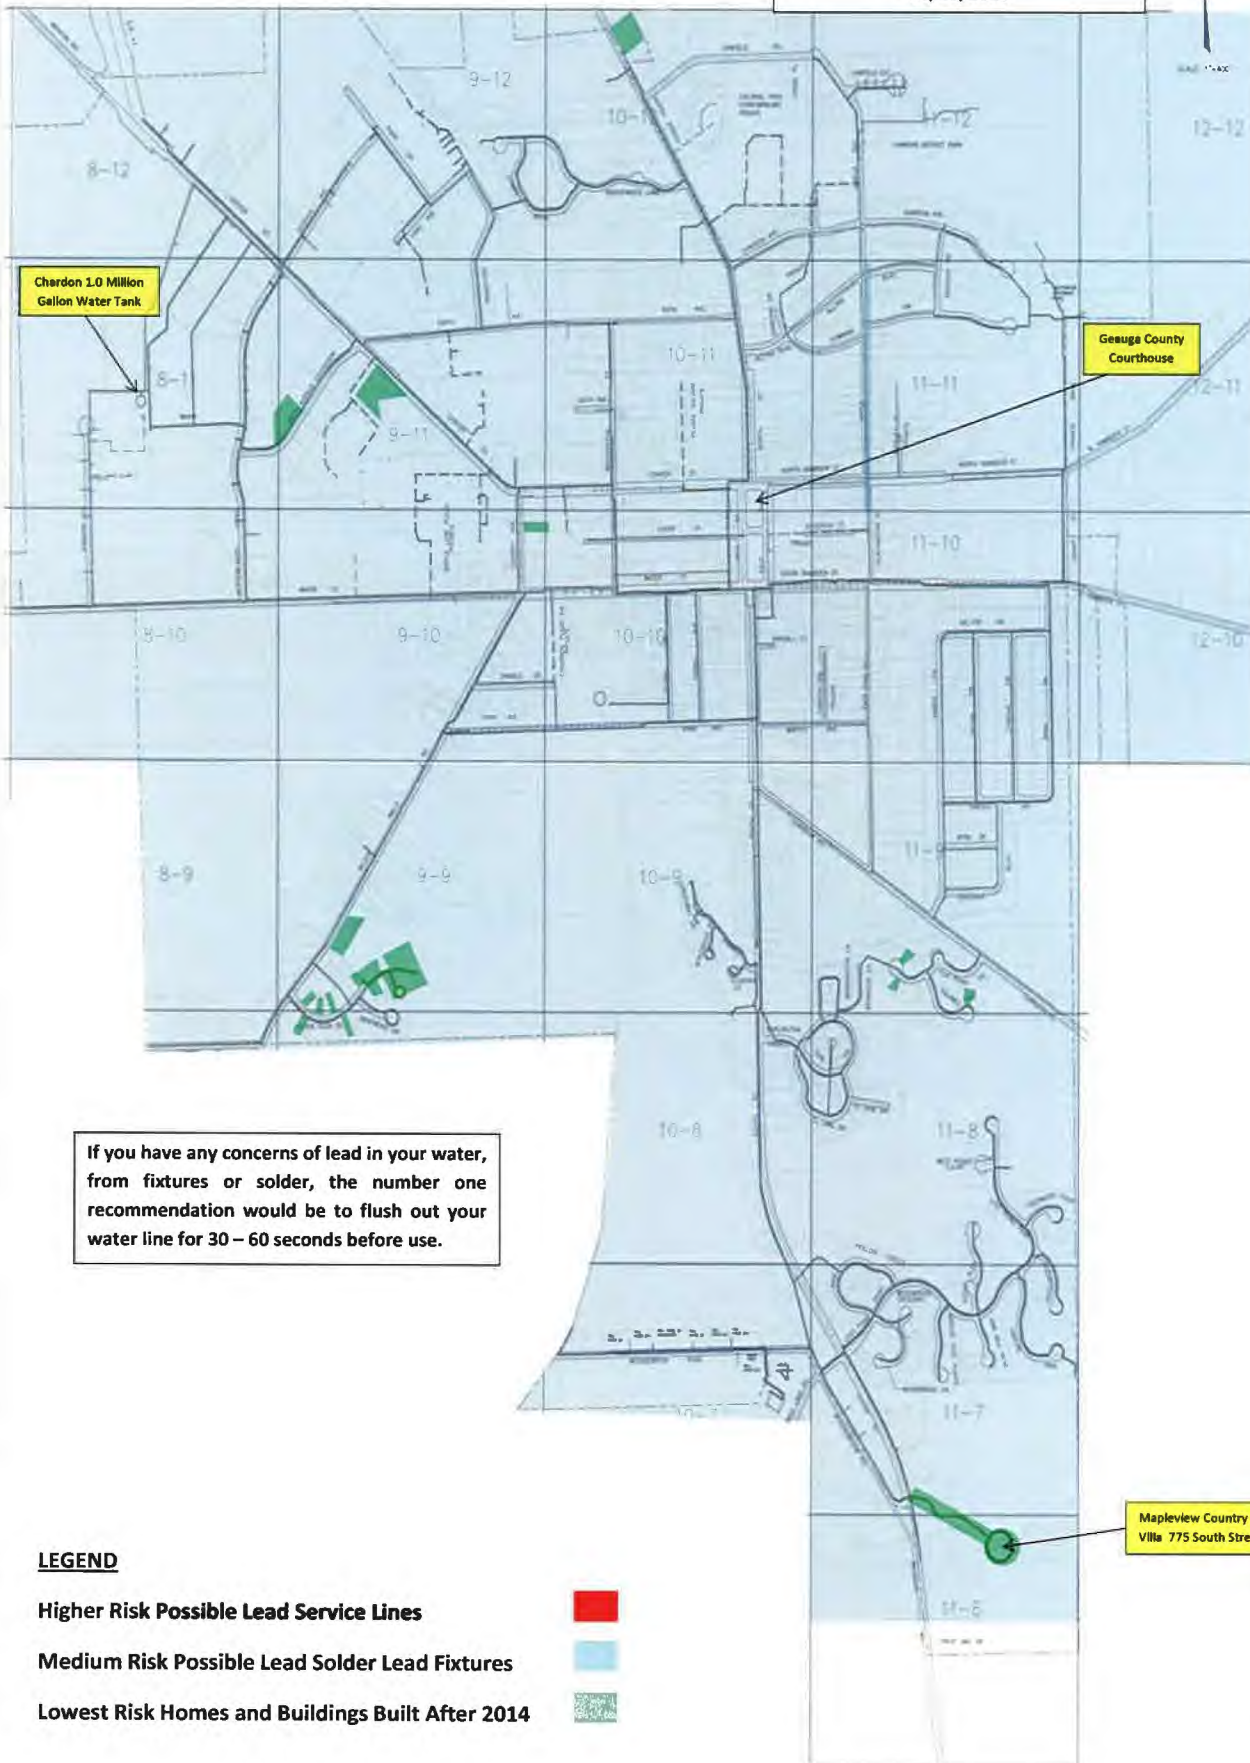

Chardon 1.0 Million Gallon Water Tank

Gauga County Courthouse

Mapleview Country Villa 775 South Street

If you have any concerns of lead in your water, from fixtures or solder, the number one recommendation would be to flush out your water line for 30 – 60 seconds before use.

- LEGEND**
- Higher Risk Possible Lead Service Lines ■
 - Medium Risk Possible Lead Solder Lead Fixtures ■
 - Lowest Risk Homes and Buildings Built After 2014 ■


VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS CLAIMING NO LEAD SERVICE LINES

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
<p>This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):</p> <ul style="list-style-type: none"> <input type="checkbox"/> Historical permit records and/or local ordinances <input checked="" type="checkbox"/> Distribution maintenance records (i.e. meter replacement, waterline break repairs) <input type="checkbox"/> Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned) <input type="checkbox"/> Service line material of all service lines is known (i.e. all service lines are known to be PVC)

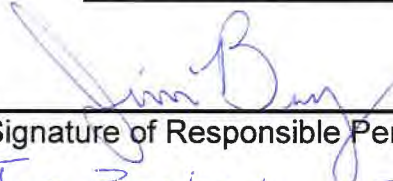	2-28-2017
Signature of Responsible Person	Date
Jim Berkey Superintendent	
Printed Name and Title of Responsible Person	

PWS NAME: Chardon City
PWS ID: OH 2800412
COUNTY: Geauga

<p><u>For Ohio EPA use only:</u></p> <p>Date Verification Rec'd: _____</p>
