

**Southern Perry County
Water District**

P.O. Box 335 - 115 School Avenue
Corning, Ohio 43730-0335

Phone (740) 347-9030 - Fax (740) 347-9031
e-mail: spc wd43730@att.net

**LEAD MAPPING &
SAMPLE POINTS
PROJECT**

**SOUTHERN PERRY
COUNTY WATER DISTRICT-
MILLERTOWN
PWS#6401903
PERRY COUNTY**

RECEIVED

MAR 6 2017
Ohio Environmental
Protection Agency
Southeast District

Southern Perry County Water District

P.O. Box 335 - 115 School Avenue
Corning, Ohio 43730-0335

Phone (740) 347-9030 - Fax (740) 347-9031
e-mail: spc wd43730@att.net

February 8, 2017

To Whom It May Concern;

Southern Perry County Water District has posted a survey of service line materials for our customers on our websites homepage which is www.spcwd43730.com and have notified each customer on the bottom of their February and March water bills. A copy of our website post and a copy of a February water bill are included with the distribution map and cover letter, as well as a list of the lead and copper sample sites.

By use of our as-built maps and operator knowledge of more than 20 years with the Company, Southern Perry County Water District has determined to the best of their ability that all our service lines are plastic material.

Southern Perry County Water District serves water to mainly single family homes that were constructed over a vast number of years. There are also a number of small businesses that are served our water.

Thank you.

Sincerely,

Southern Perry County Water District

RECEIVED

MAR 6 2017

Ohio Environmental
Protection Agency
Southeast District

**VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS
CLAIMING NO LEAD SERVICE LINES**

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following): ☐ Historical permit records and/or local ordinances ☒ Distribution maintenance records (i.e. meter replacement, waterline break repairs) ☐ Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned) ☒ Service line material of all service lines is known (i.e. all service lines are known to be PVC)

Richard West 3-6-2017
Signature of Responsible Person Date

Richard West Tech operator
Printed Name and Title of Responsible Person

PWS NAME: Southern Perry County Water District Millertown
PWS ID: OH6401903
COUNTY: Perry

For Ohio EPA use only:

Date Verification Rec'd: _____

**PLEASE PARTICIPATE BY CALLING THE OFFICE AND GIVE THE
FOLLOWING INFORMATION:**

TO ALL SOUTHERN PERRY COUNTY WATER DISTRICT CUSTOMERS

The US EPA and Ohio EPA are making significant regulatory changes to lead/copper monitoring and public notification requirements in 2017. Many of the changes in monitoring and reporting are due to high lead levels in other water systems throughout the country.

Following EPA guidelines, Southern Perry Water currently monitors each system to ensure our lead and copper levels do not pose a health risk to our customers.

In an effort to identify additional lead/copper sampling locations, Southern Perry is requesting your participation in identifying the type of material of your water service line (the line from your meter to your home) along with the type of plumbing inside your residence, if known. Commonly used materials are plastic, copper, lead, and galvanized piping. In addition, it is helpful to report the year that the home construction or your plumbing was completed.

If you would like to participate in the lead/copper sampling program, please call the office at 740-347-9030 Monday through Friday 9:00 am to 2:00 pm and give the clerk the information for your residence. You may also write the info down and return it with your water payment. After reviewing the information you return to the office, the data will be analyzed to see if your residence qualifies for the sampling program. We appreciate your time and efforts in completing the necessary information.

Following is the information needed:

Residence: Service Line Material	☐ Plastic	Household Plumbing Material	☐ Plastic
	☐ Copper		☐ Copper
	☐ Galvanized		☐ Galvanized
	☐ Lead		☐ Lead

Residence Construction Date _____

Residence Plumbing Completion Date _____

Contact information:

Name: _____

Address _____

Phone: _____

Perry County Monroe Township

T-12, R-14

Revised: 2017


Kenton Cannon P.E., P.S.
Perry County Engineer

COMMISSIONERS
Ben Carpenter
Dave Freriks
Jim O'Brien

PROPERTY LINES SHOWN ARE APPROXIMATE



○ STATE HIGHWAY ○ COUNTY ROAD △ TOWNSHIP ROAD

0 1000 2000 3000 4000 5000

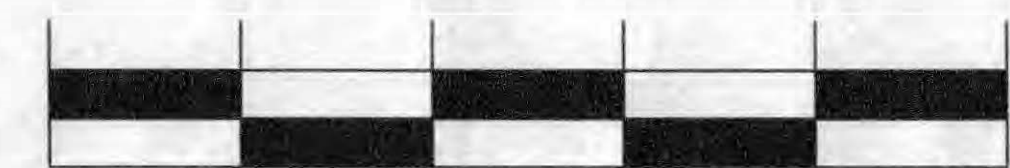

Scale In Feet

millertown Legend
Water mains
Sample Sites

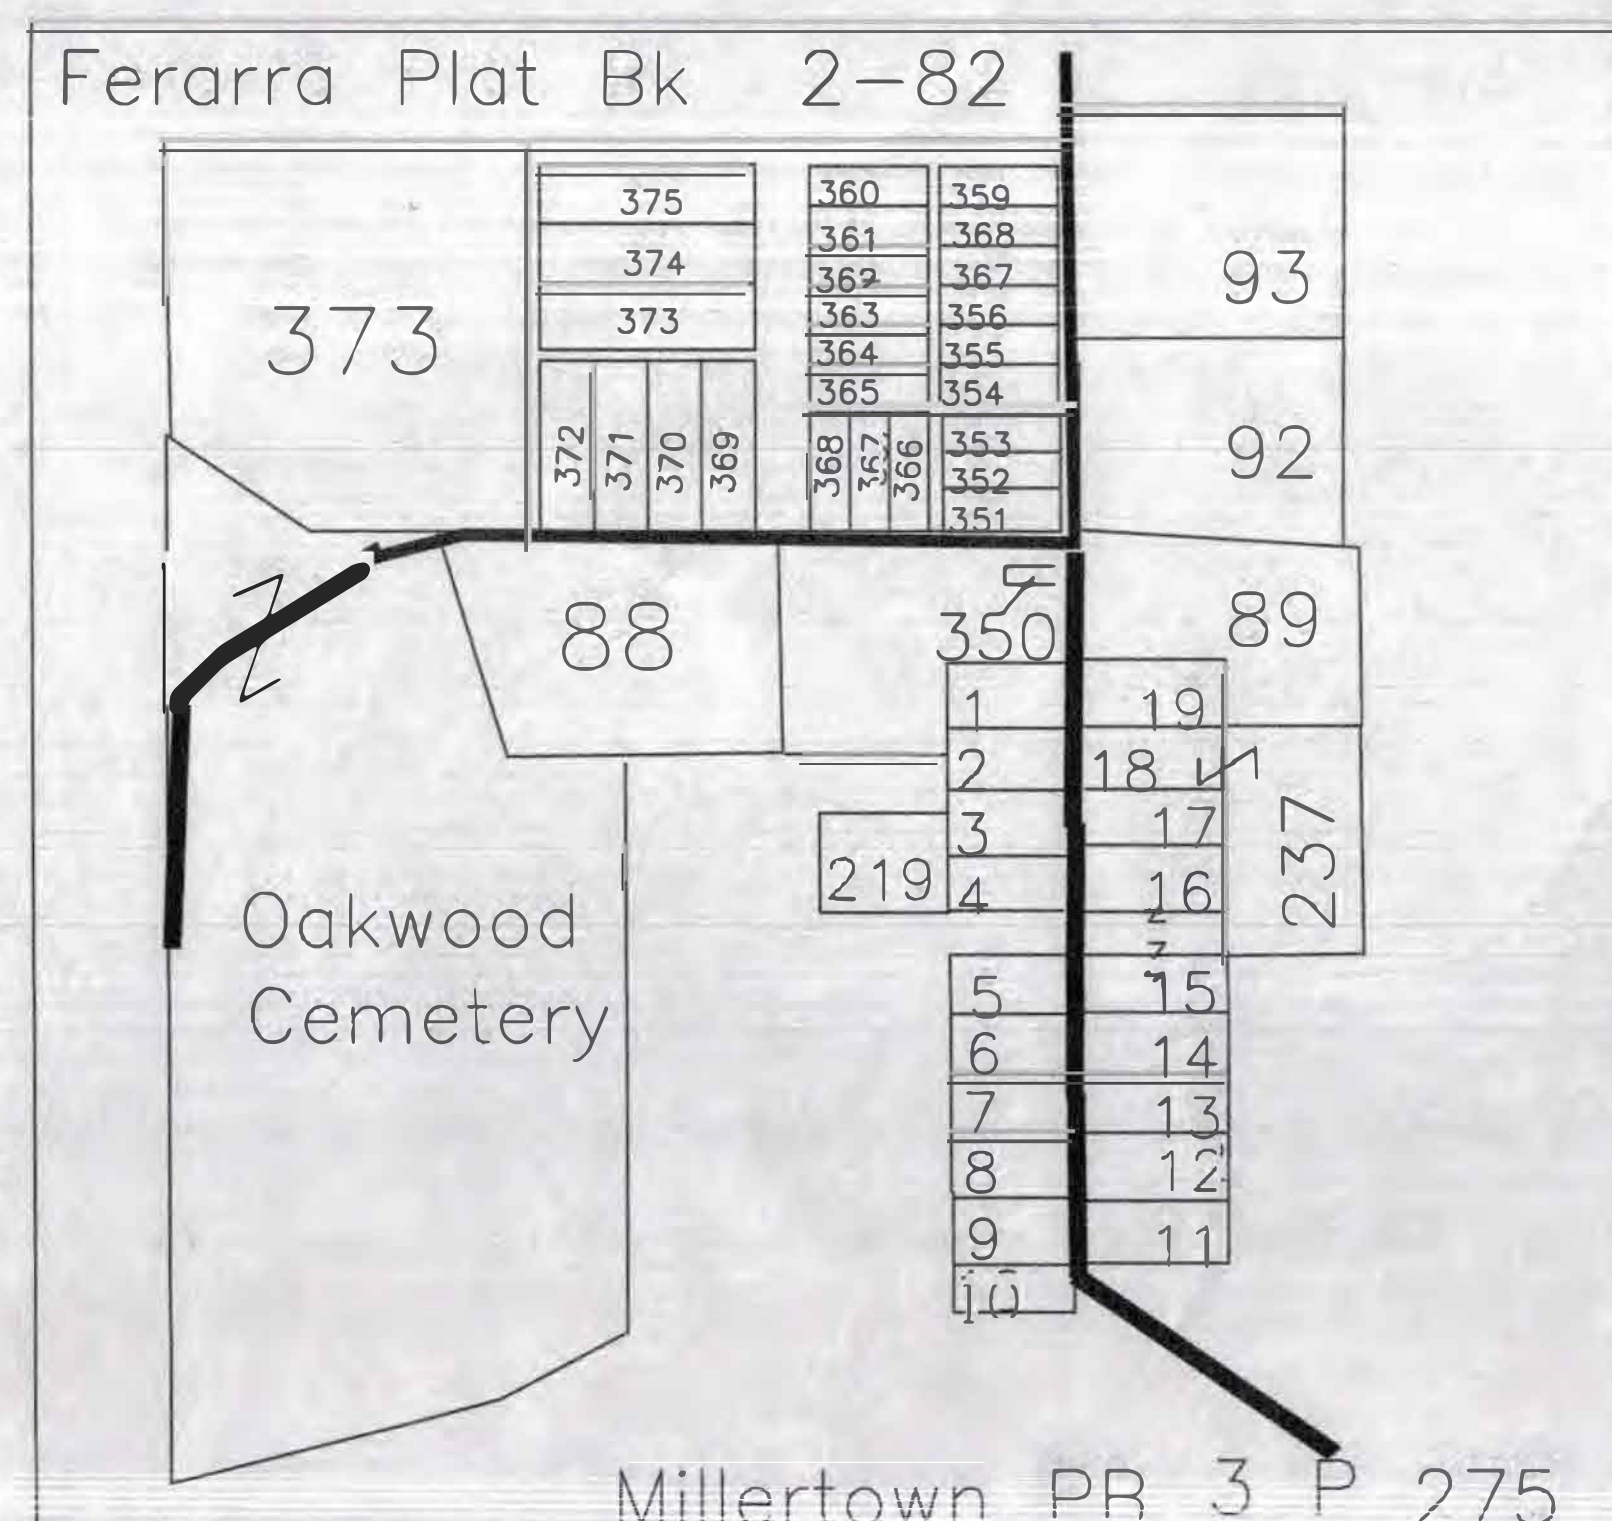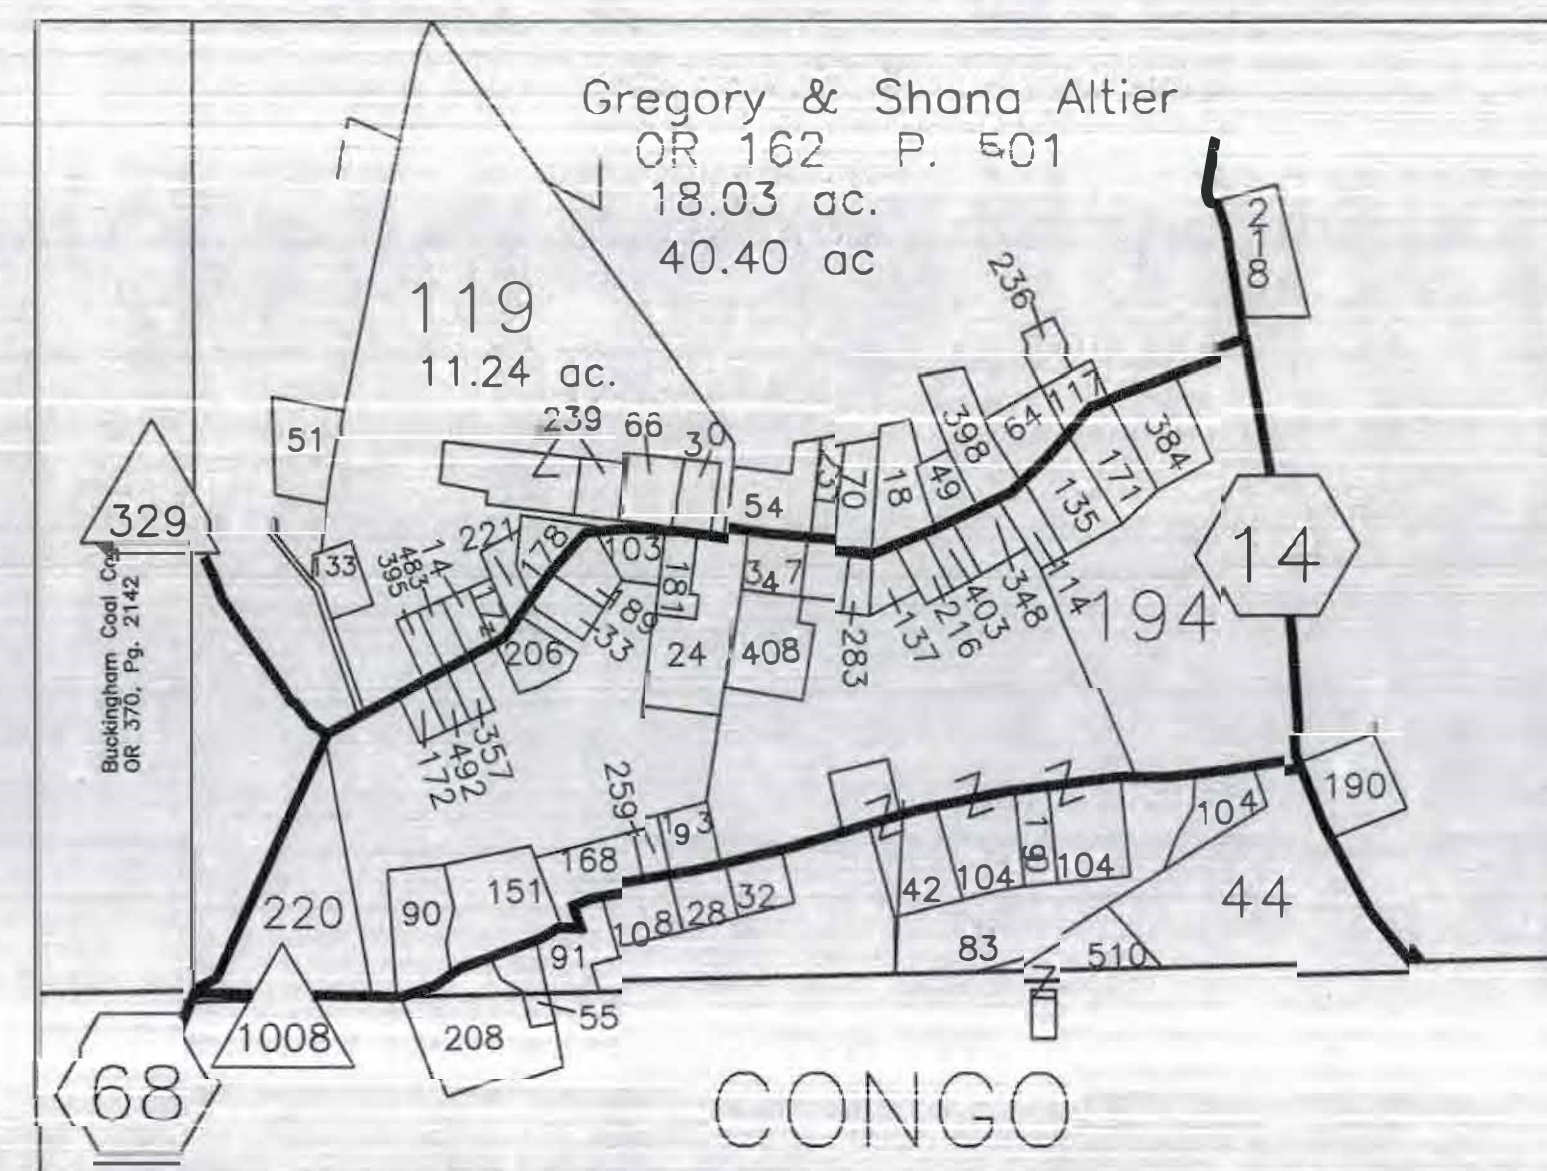


MILLERTOWN

scale 1" = 400'

Salt Lick Twp.

Coal Twp.

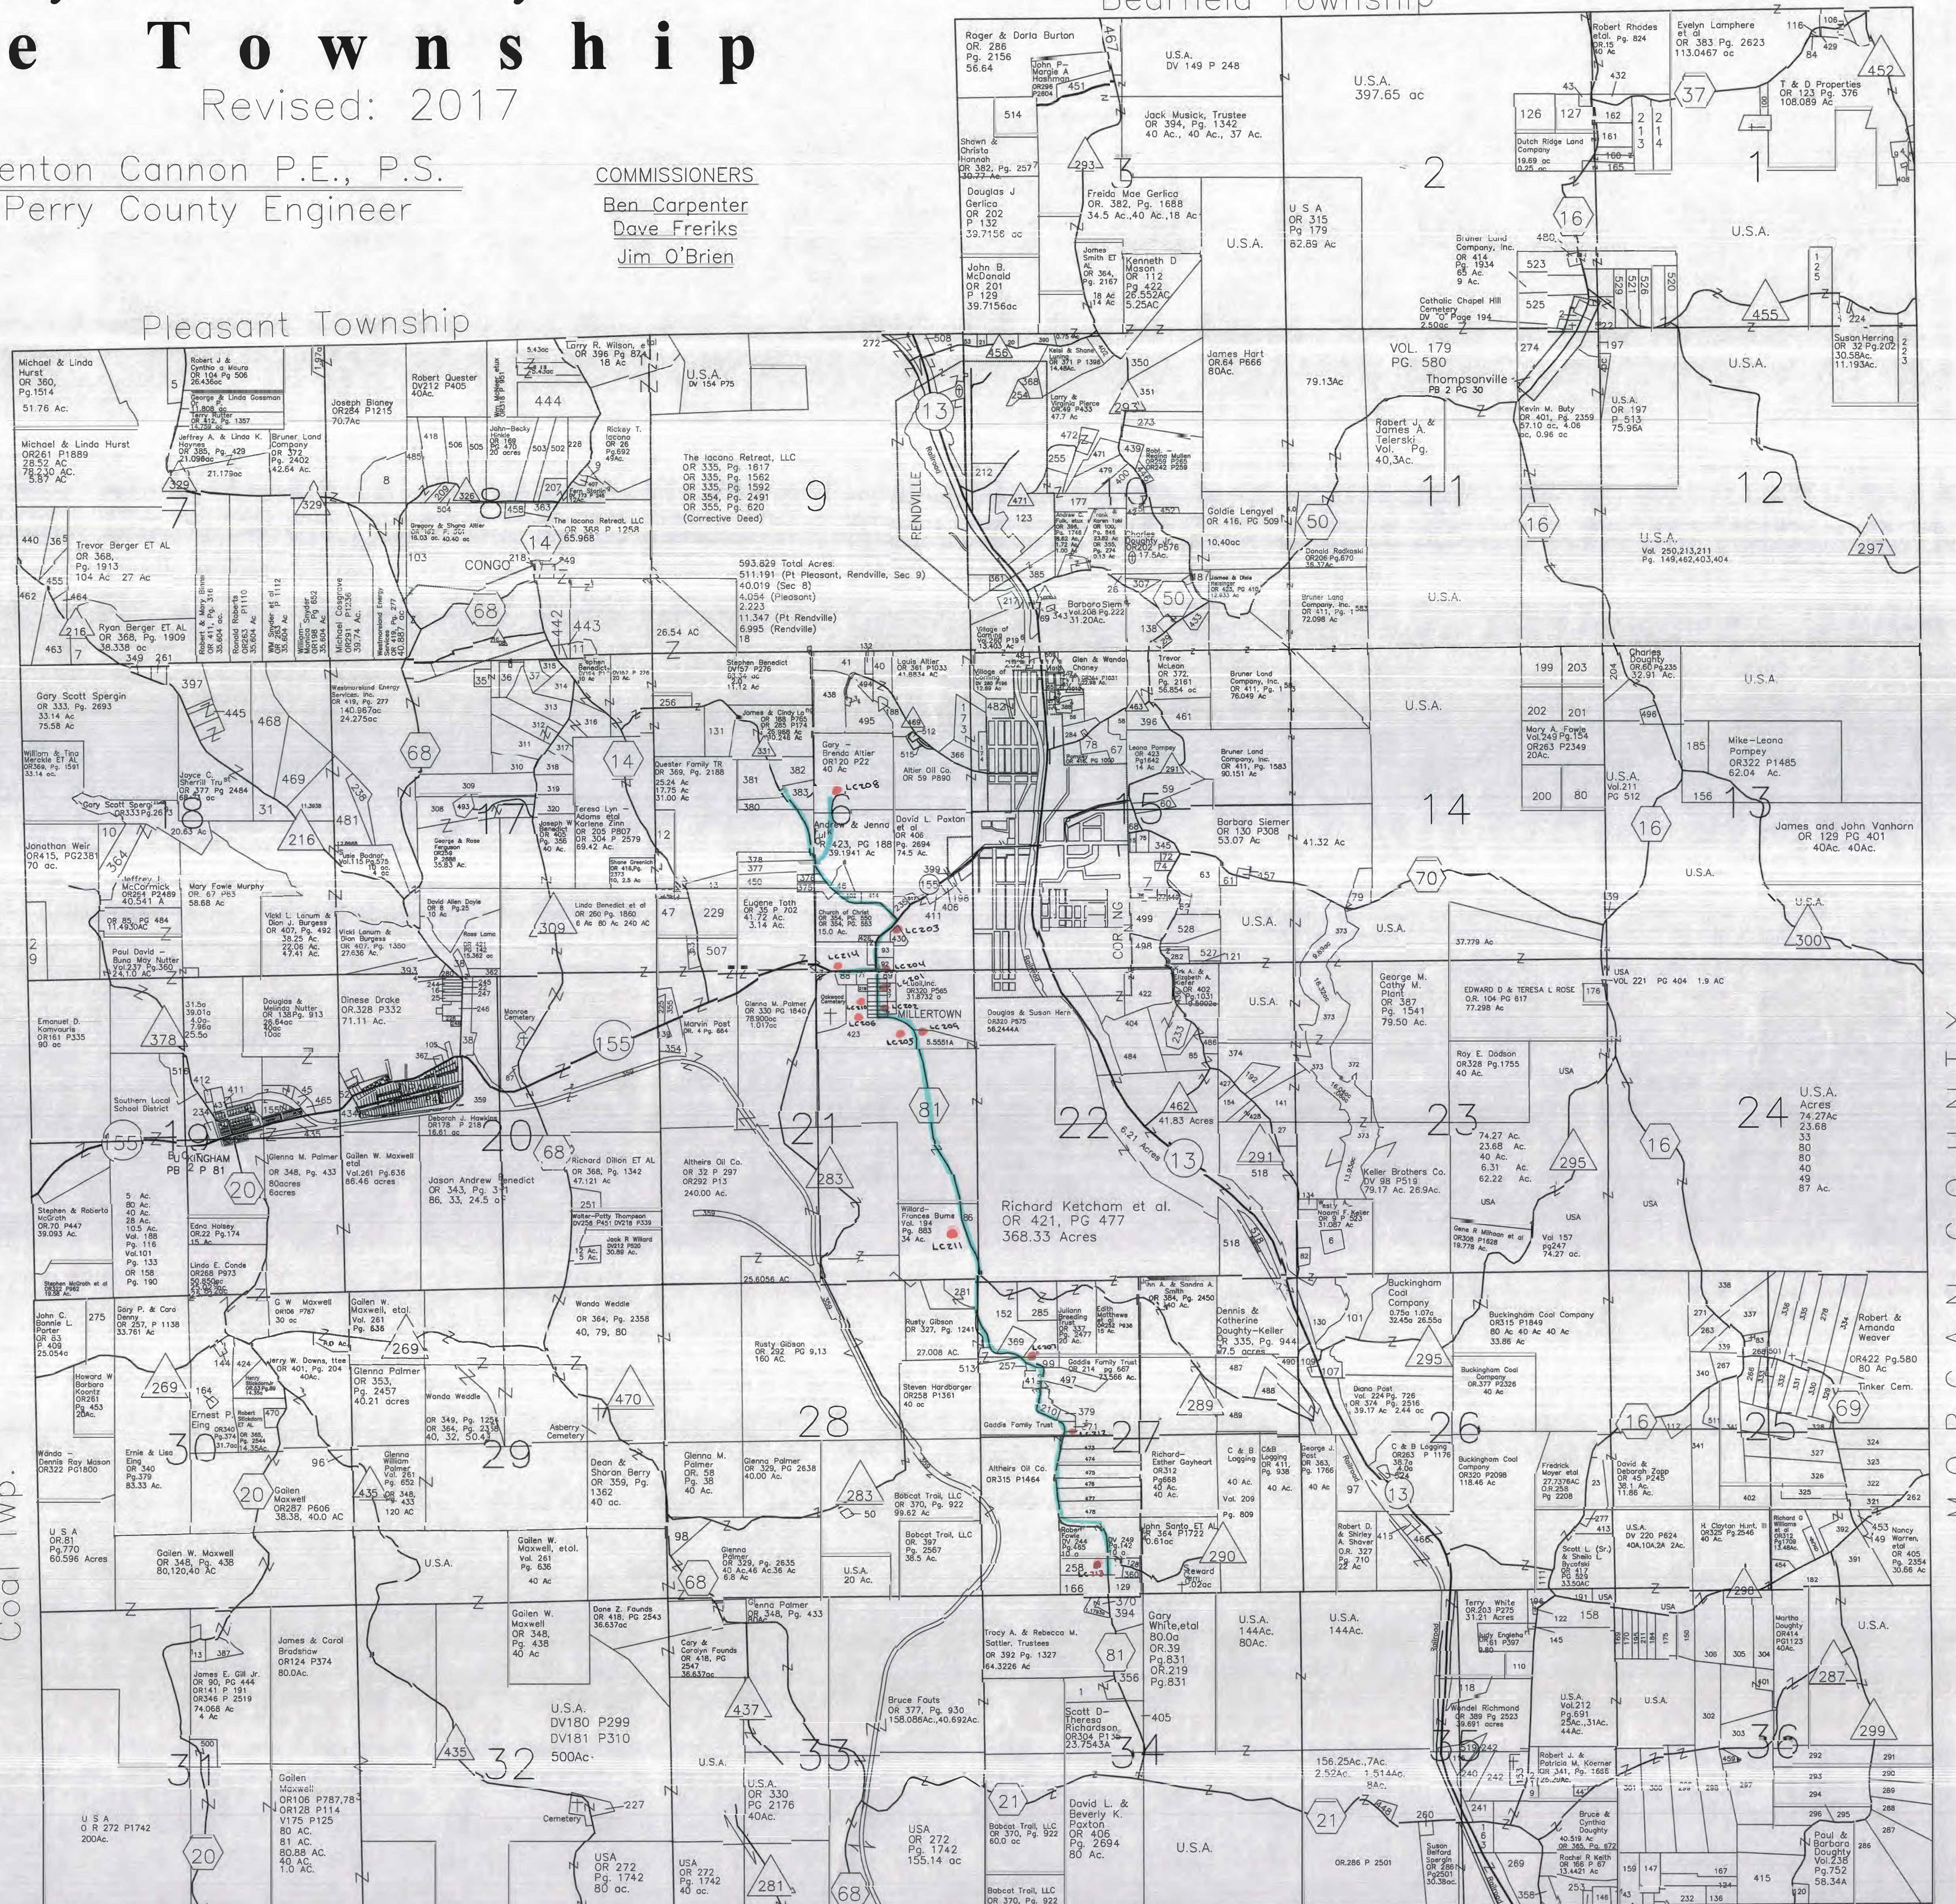

ATHENS COUNTY

RECEIVED

MAR 6 2017
Ohio Environmental
Protection Agency
Southeast District