

RE: Lima City
Report
Drinking Water Program
Allen County
PWS ID: OH0200811



CITY OF LIMA, OHIO

David J. Berger, Mayor

50 Town Square Lima, Ohio 45801-4900 419/228-5462 Fax 419/221-5214

March 2, 2017

Justin Bowerman, Lead and Copper Representative
Ohio EPA Northwest District

Re: Lead and Copper Mapping
City of Lima Water Treatment Plant
PWS ID # 0200811

Dear Justin,

Please see attached map of our water distribution system that illustrates the points in Lima's service area that contain lead service lines, copper and a number of points where we have no information. Also note that Lima's Tier 1 sampling sites, as previously reported to EPA via the "Monitoring Point ID" sheet, are included on the attached map. This map allows Lima to meet the requirements of HB 512 (ORC 6109.121), which was passed last June to establish requirements governing lead and copper testing for public water systems.

This map will be available for viewing on the City's webpage. Although the map was created using GIS software, it is not yet available on the web as an interactive file where users can pan and zoom to achieve greater detail on specific properties. However the City is currently engaged as a member of a 'Smart City Initiative' project that includes all city departments and various county offices. The goal of the initiative is to enable efficient sharing of data between various agencies and the public via web access. It is expected that Lima's ability to provide timely and specific user information via this type of interaction will substantially improve in the next few years as this project progresses.

RECEIVED

MAR 02 2017

DDAGW - NWDO




Lima will also be initiating a meter change-out program later this year and into 2018. This program will allow work crews to gather accurate data concerning lead lines on the approximately 6,300 services that are currently categorized in our GIS system as having "No information."

Sincerely Yours,

A handwritten signature in cursive script that reads "Terry Huber". The signature is written in black ink and is positioned above a horizontal line.

Terry Huber, Supervisor
Water Supply and Treatment Plant

City of Lima, Ohio
Lead Service Line Identification Map
PWS ID #0200811

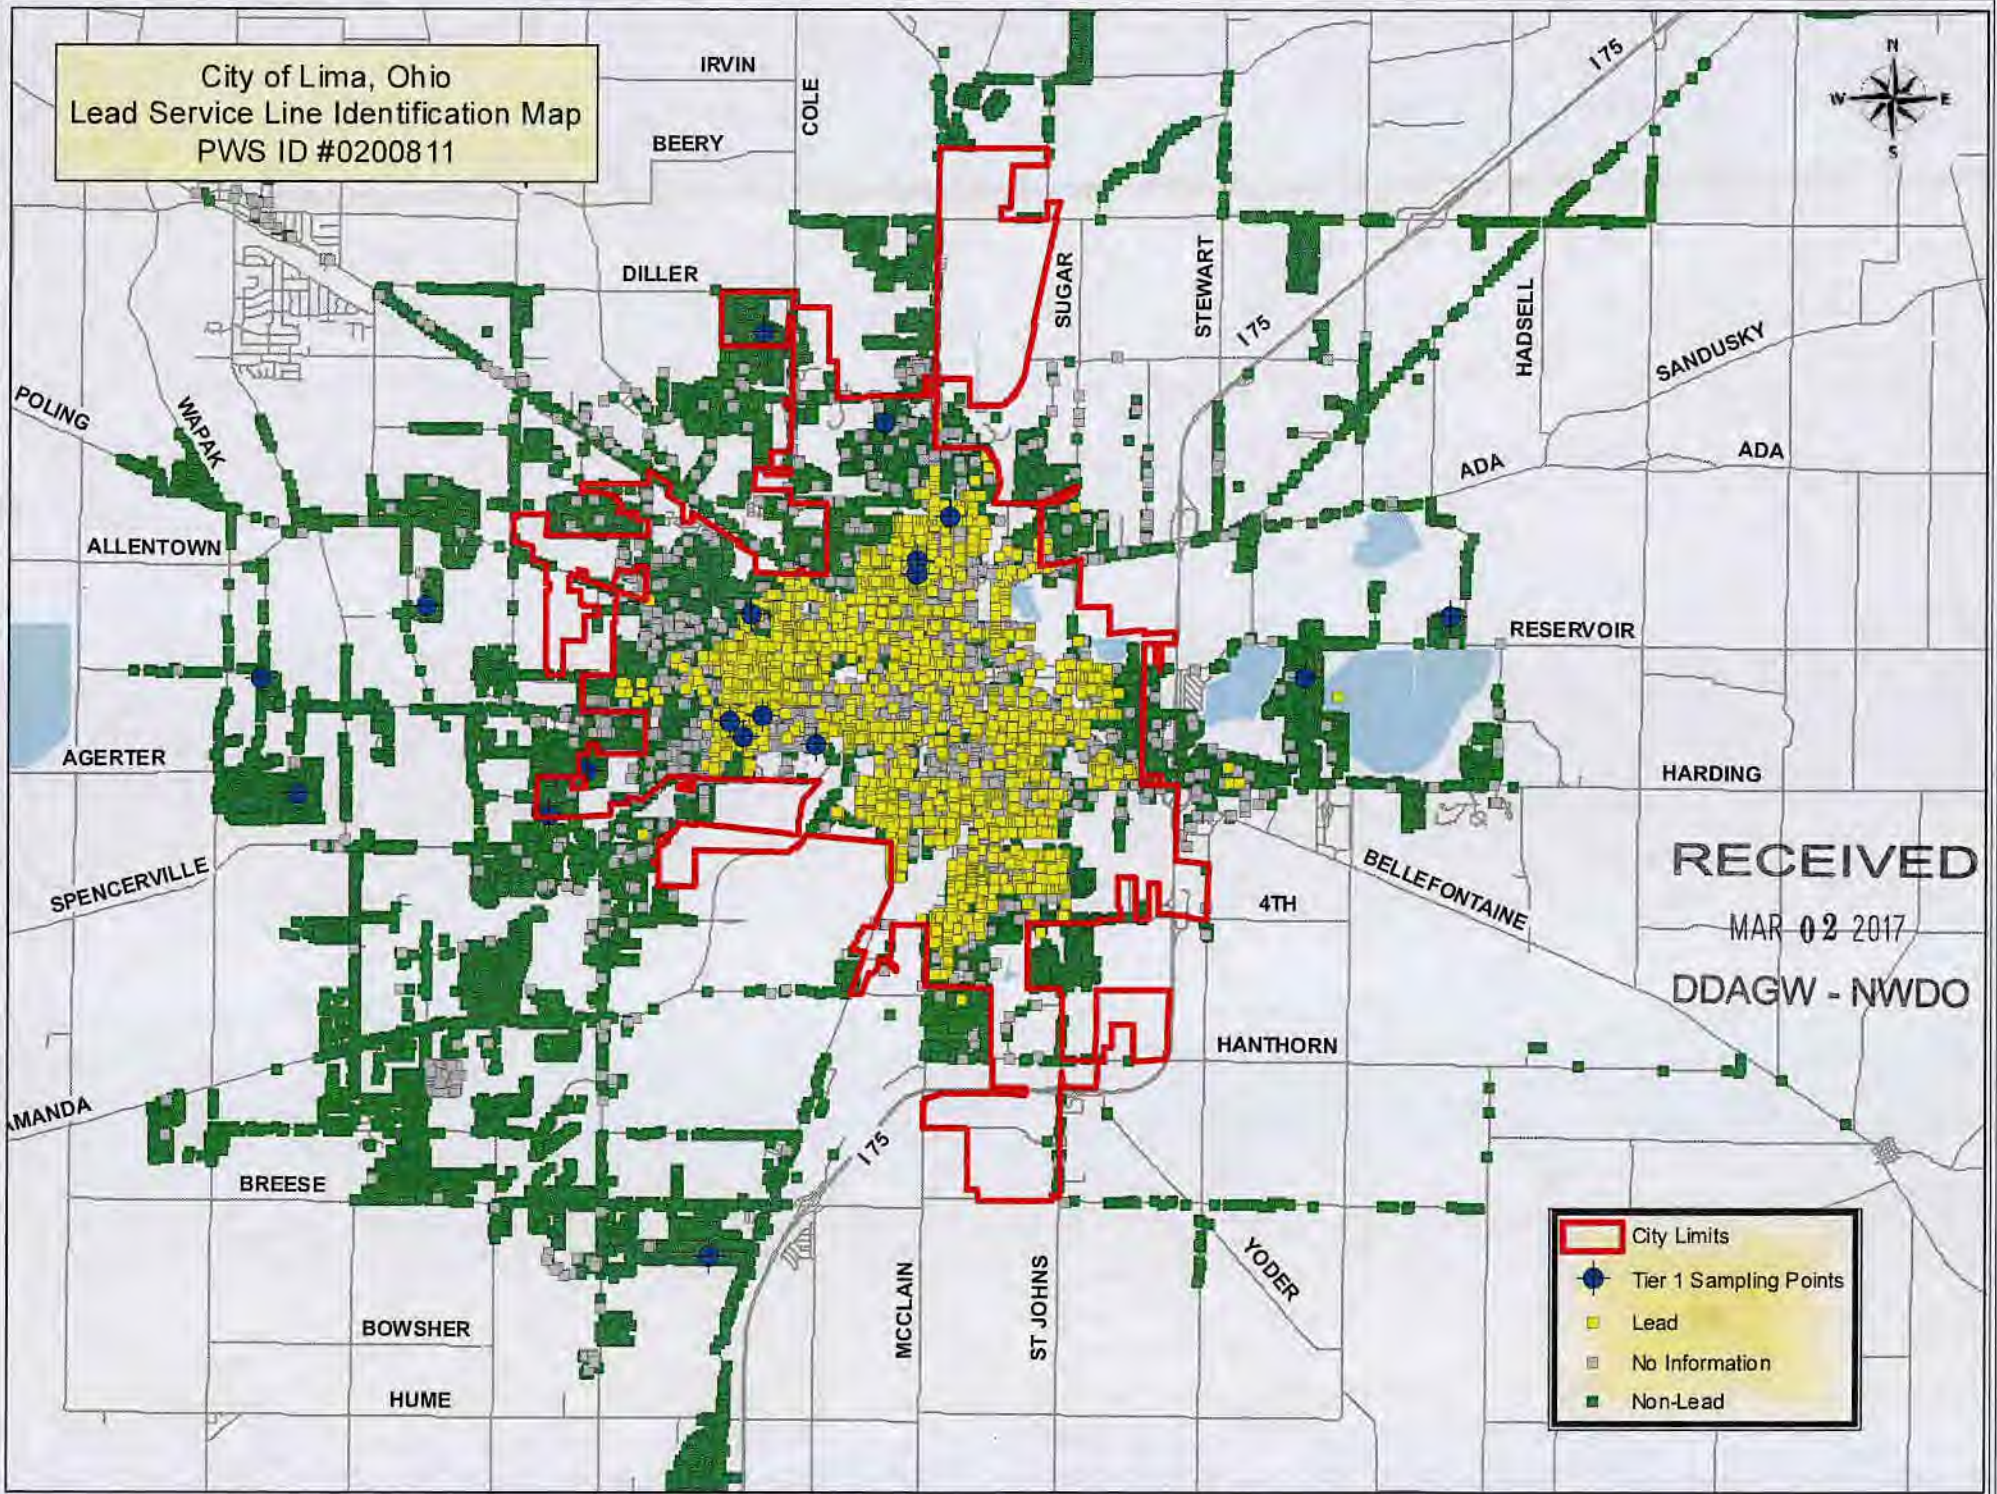

RECEIVED
MAR 02 2017
DDAGW - NWDO

	City Limits
	Tier 1 Sampling Points
	Lead
	No Information
	Non-Lead