

RE: Village of Republic
Report
Drinking Water Program
Seneca County
PWS ID: OH7400812

RECEIVED

MAR 03 2017

DDAGW - NWDO

LEAD AND COPPER SAMPLE SITES:

- ① LC201 - 206 JEFFERSON ST
- ② LC202 - 112 VAN BUREN ST
- ③ LC203 - 202 N MADISON ST
- ④ LC204 - 203 CENTER ST
- ⑤ LC205 - 416 KILBOURNE ST
- ⑥ LC206 - 219 WASHINGTON ST
- ⑦ LC207 - 303 S MADISON ST
- ⑧ LC208 - 216 WASHINGTON ST
- ⑨ LC209 - 211 N MADISON ST
- ⑩ LC210 - 105 BROADWAY ST

LEGEND


- NON-LEAD SERVICE CONNECTIONS
- LEAD AND COPPER SAMPLE SITES

NOTE:

ALL WATER DISTRIBUTION MAINS ARE AC PIPE, PVC PIPE, OR CI PIPE
ALL WATER SERVICES ARE COPPER OR HOPE TUBING.

NOTE:

BUILDINGS IN OHIO BUILT PRIOR TO 1998 OR THAT USE PLUMBING MATERIAL OR SOLDER MANUFACTURED BEFORE 1998 MAY HAVE MATERIALS WITH GREATER THAN 8% LEAD AND ARE AT A HIGHER RISK OF CONTRIBUTING LEAD TO THE DRINKING WATER THAN MATERIALS MANUFACTURED AFTER 1998. IN ADDITION, BUILDINGS BUILT AND PLUMBING MATERIALS MANUFACTURED AFTER 2014 WERE REQUIRED TO HAVE LESS THAN 0.25% LEAD BY WEIGHT AND HAVE THE LOWEST RISK FOR CONTRIBUTING LEAD TO THE DRINKING WATER. IT SHOULD BE NOTED HOWEVER THAT, ALTHOUGH PROHIBITED, SOME USE OF LEADED SOLDER OR LEADED COMPONENTS MAY HAVE OCCURRED AFTER THE PROHIBITIONS BECAME EFFECTIVE.

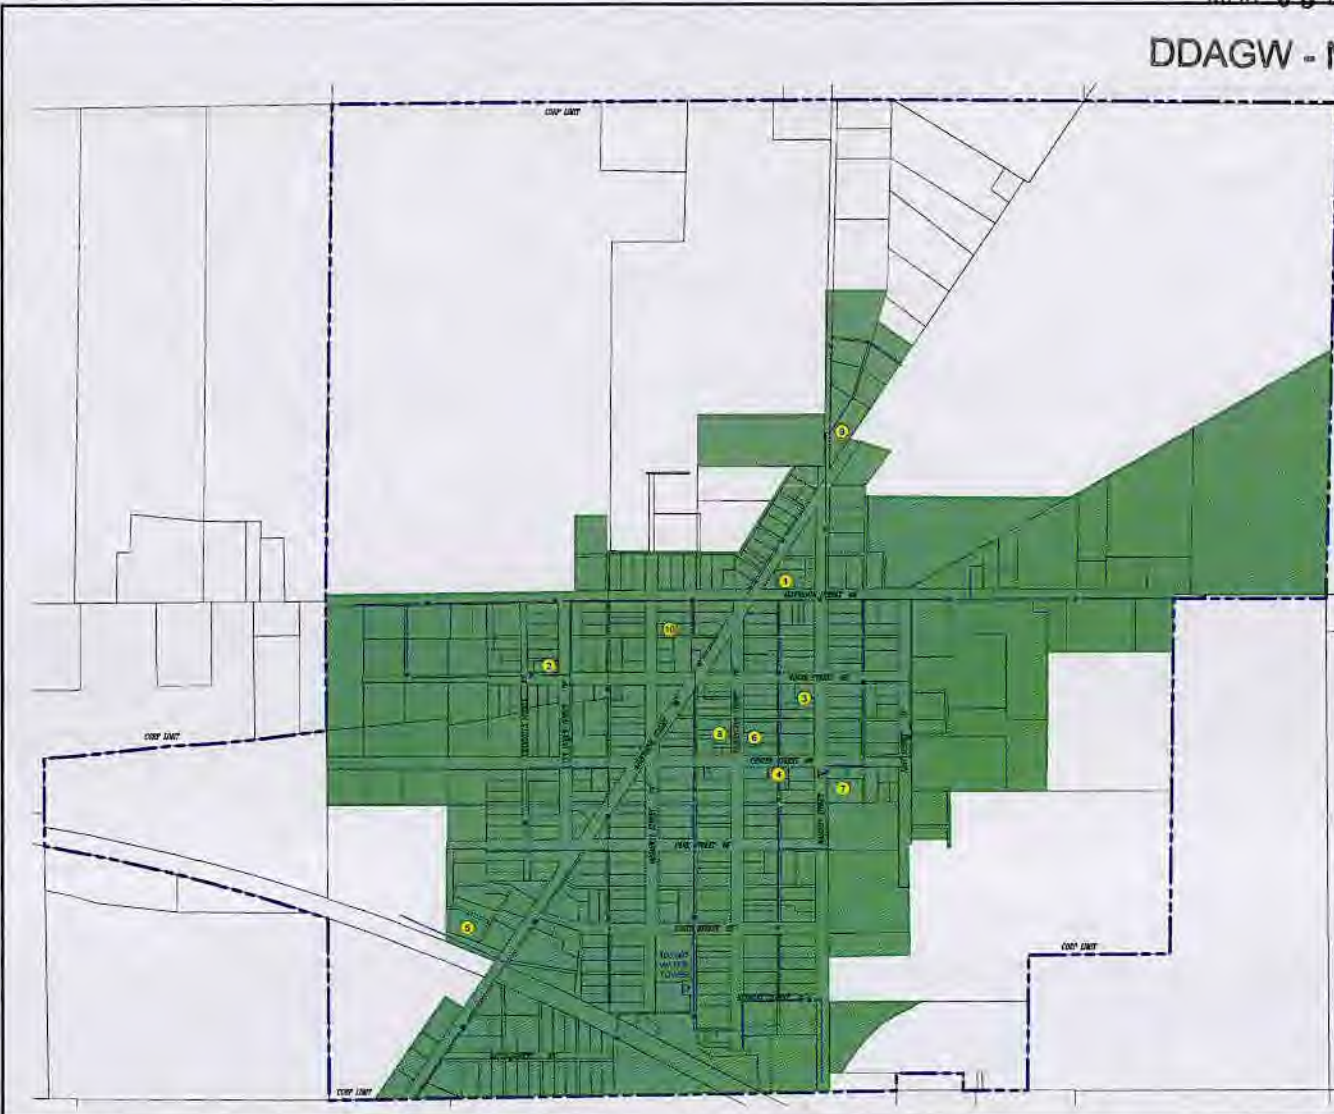

EASEMENT REFERENCE		
Dwg. No.	County Parcel No. Volume Page	Gen No.

REVISIONS			
No.	Description	Approval	Date
	AS BUILT		

Drawn by
Makeever & Associates, Inc.
 100 W. 10th St., Suite 100
 Republic, OH 44875
 Phone: 419-499-1111 Fax: 419-499-1112

LEAD MAPPING IN DISTRIBUTION SYSTEM
 PWS ID: OH7400812

DWG. FILE NO. _____
 IMP. ACCT. NO. _____
 CONTRACT NO. _____
 COMPLETION DATE _____
 CONTRACTOR _____

VILLAGE OF REPUBLIC
 OHIO

Scale: Horiz. = AS NOTED
 Vert. = AS NOTED
 Original Sheet Size = 14"x36"
 Date = 03/02/2017

Sheet No. 1 OF 1
 SHEET NUMBER
 Dwg. No.: 17-009-001