

Pure Water Co., Inc.


PWS # OH6100403

Lead and Copper 2017

Pure Water has been active since 1967 with all mains being PVC.SDR21.

In 2005, there was an upgrade to Parrish Ridge Rd, Paul Wells Rd and Archibald Rd. All mains were PVC C900.

According to blueprints, no lead lines were installed, and in 30+ years doing maintenance I have found no lead main lines. We only take care of lines to the meter pit; therefore, lines running to the houses and inside is unknown. Most homes/buildings are over 30 years old, so there is a possibility of lead lines/fixtures inside.

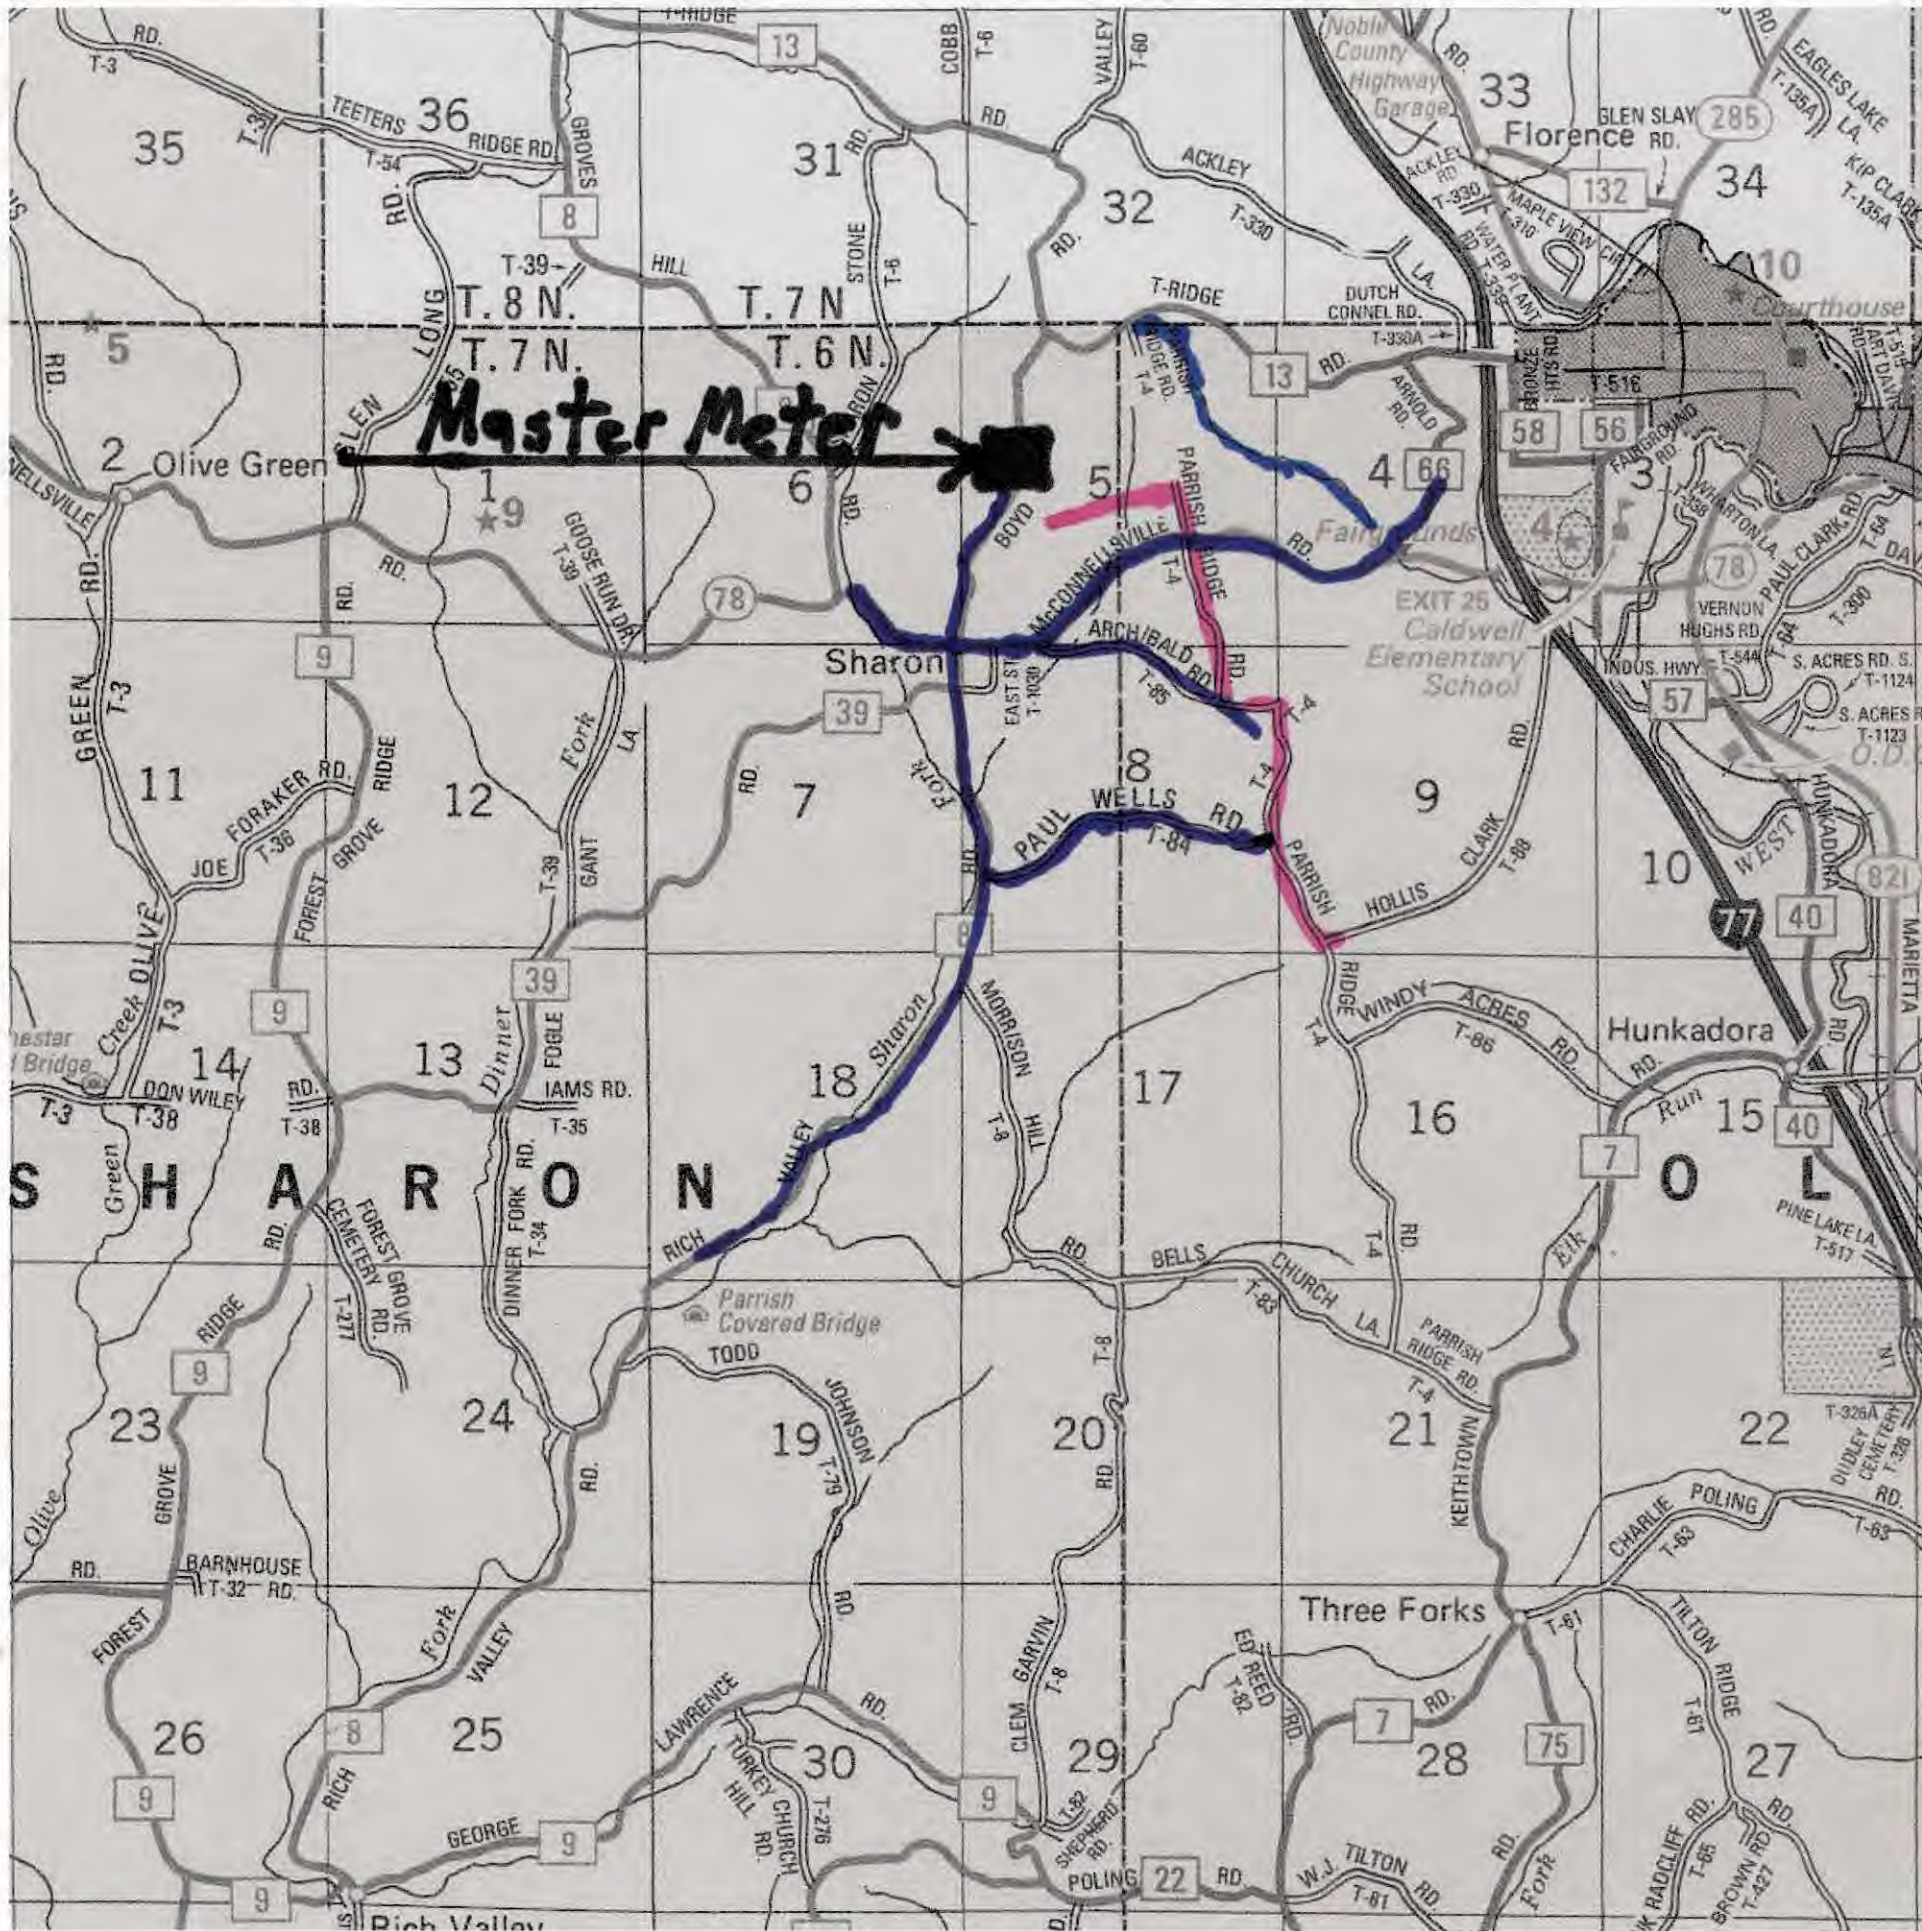

4" C900 Plastic
 2" SDR21 Plastic

Pure Water Co., Inc. - PWS # OH6100403 –
 Lead and Copper 2017

Because it is practically impossible to determine the lead content of an installed fixture, fitting or pipe, it should be assumed that the manufacture or installation date is the primary indicator of the lead content. Therefore, the characteristics of buildings and piping solder or fixtures would be buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.