

RE: Lafarge North America - Paulding
Report
Drinking Water Program
Paulding County
PWS ID: OH6332212

Lead Map

RECEIVED
MAR 06 2017
DDAGW - NWDO




- LC204 - MR001 - PH2 Restroom
- LC205 - MR002 - PH1 Restroom
- FOMR - Front Office Men's Restroom
- FOWR - Front Office Women's Restroom
- FOS - Front Office Sink
- LC201 - BRWR - Breakroom Women's Restroom
- BRLR# - Breakroom Locker Room Sinks (1-5)
- LC203 - MOWR - Main Office Women's Restroom
- MOMR - Main Office Men's Restroom
- CFR - Conference Room Sink
- MEG - Mobile Equipment Garage Sink
- LC202 - ANLY - Analytical Lab Sink
- PHYS - Physical Lab Sink
- MIXL - Mix Lab Sink
- FRMO - Foreman's Office Sink
- TANK - Well Tank Lid
- EYE# - Eye Wash Stations (1-3)
- SYST# - Systech Restroom (1-3)
- CRM - Controlroom Men's Restroom
- FAR - First Aid Room

Green - Post 1998

Yellow = Pre 1998

Note: All distribution lines were installed before 1998.

Map is not to scale.

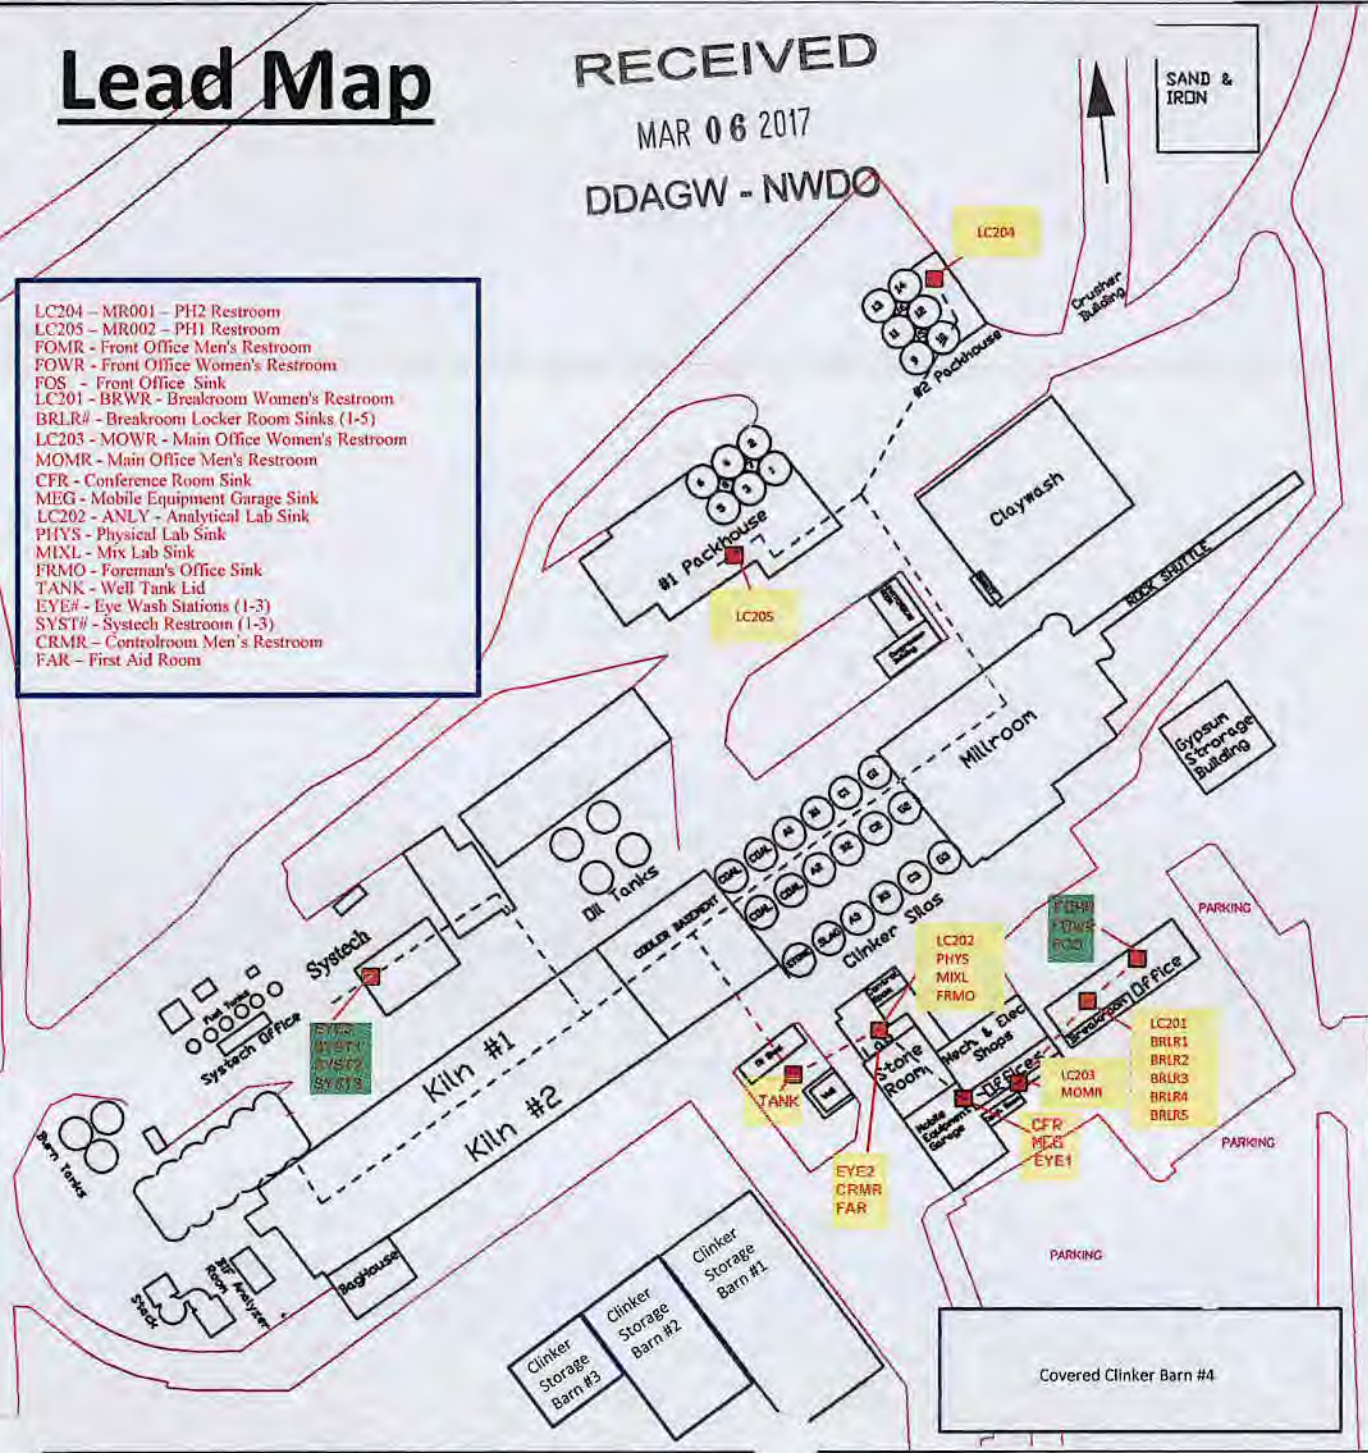

**LAFARGE
NORTH AMERICA
PAULDING PLANT**

11435 Road 176
Paulding, OH 45879
419-399-4861

PWS ID: OH6332212
Non-Transient/Non-Community
Public Water System

DW Distribution and Fixtures 2017.ppt