

RE: Sylvania City
Report
Drinking Water Program
Lucas County
PWS ID: OH4801303

Sylvania Ordinance 921.09(a) was updated in 1964. It requires water services to be type K copper. We have been for the last 15+ years systematically replacing our older water mains and/or city owned water services. We have not found any city owned lead services but we have found one homeowner's service line that is lead. That homeowner is aware of the lead service and has stated he will replace his line. Our meter department has begun a program of checking each service at the meter setting to note whether the service line is copper, galvanized or lead.

Our map represents the possibility that lead services could exist in our older areas. It also highlights the different lead rules and which buildings were constructed during each of these lead rules.


Ben Black

RECEIVED
MAR 06 2017
DDAGW - NWDO

RECEIVED

MAR 06 2017

DDAGW - NWDO

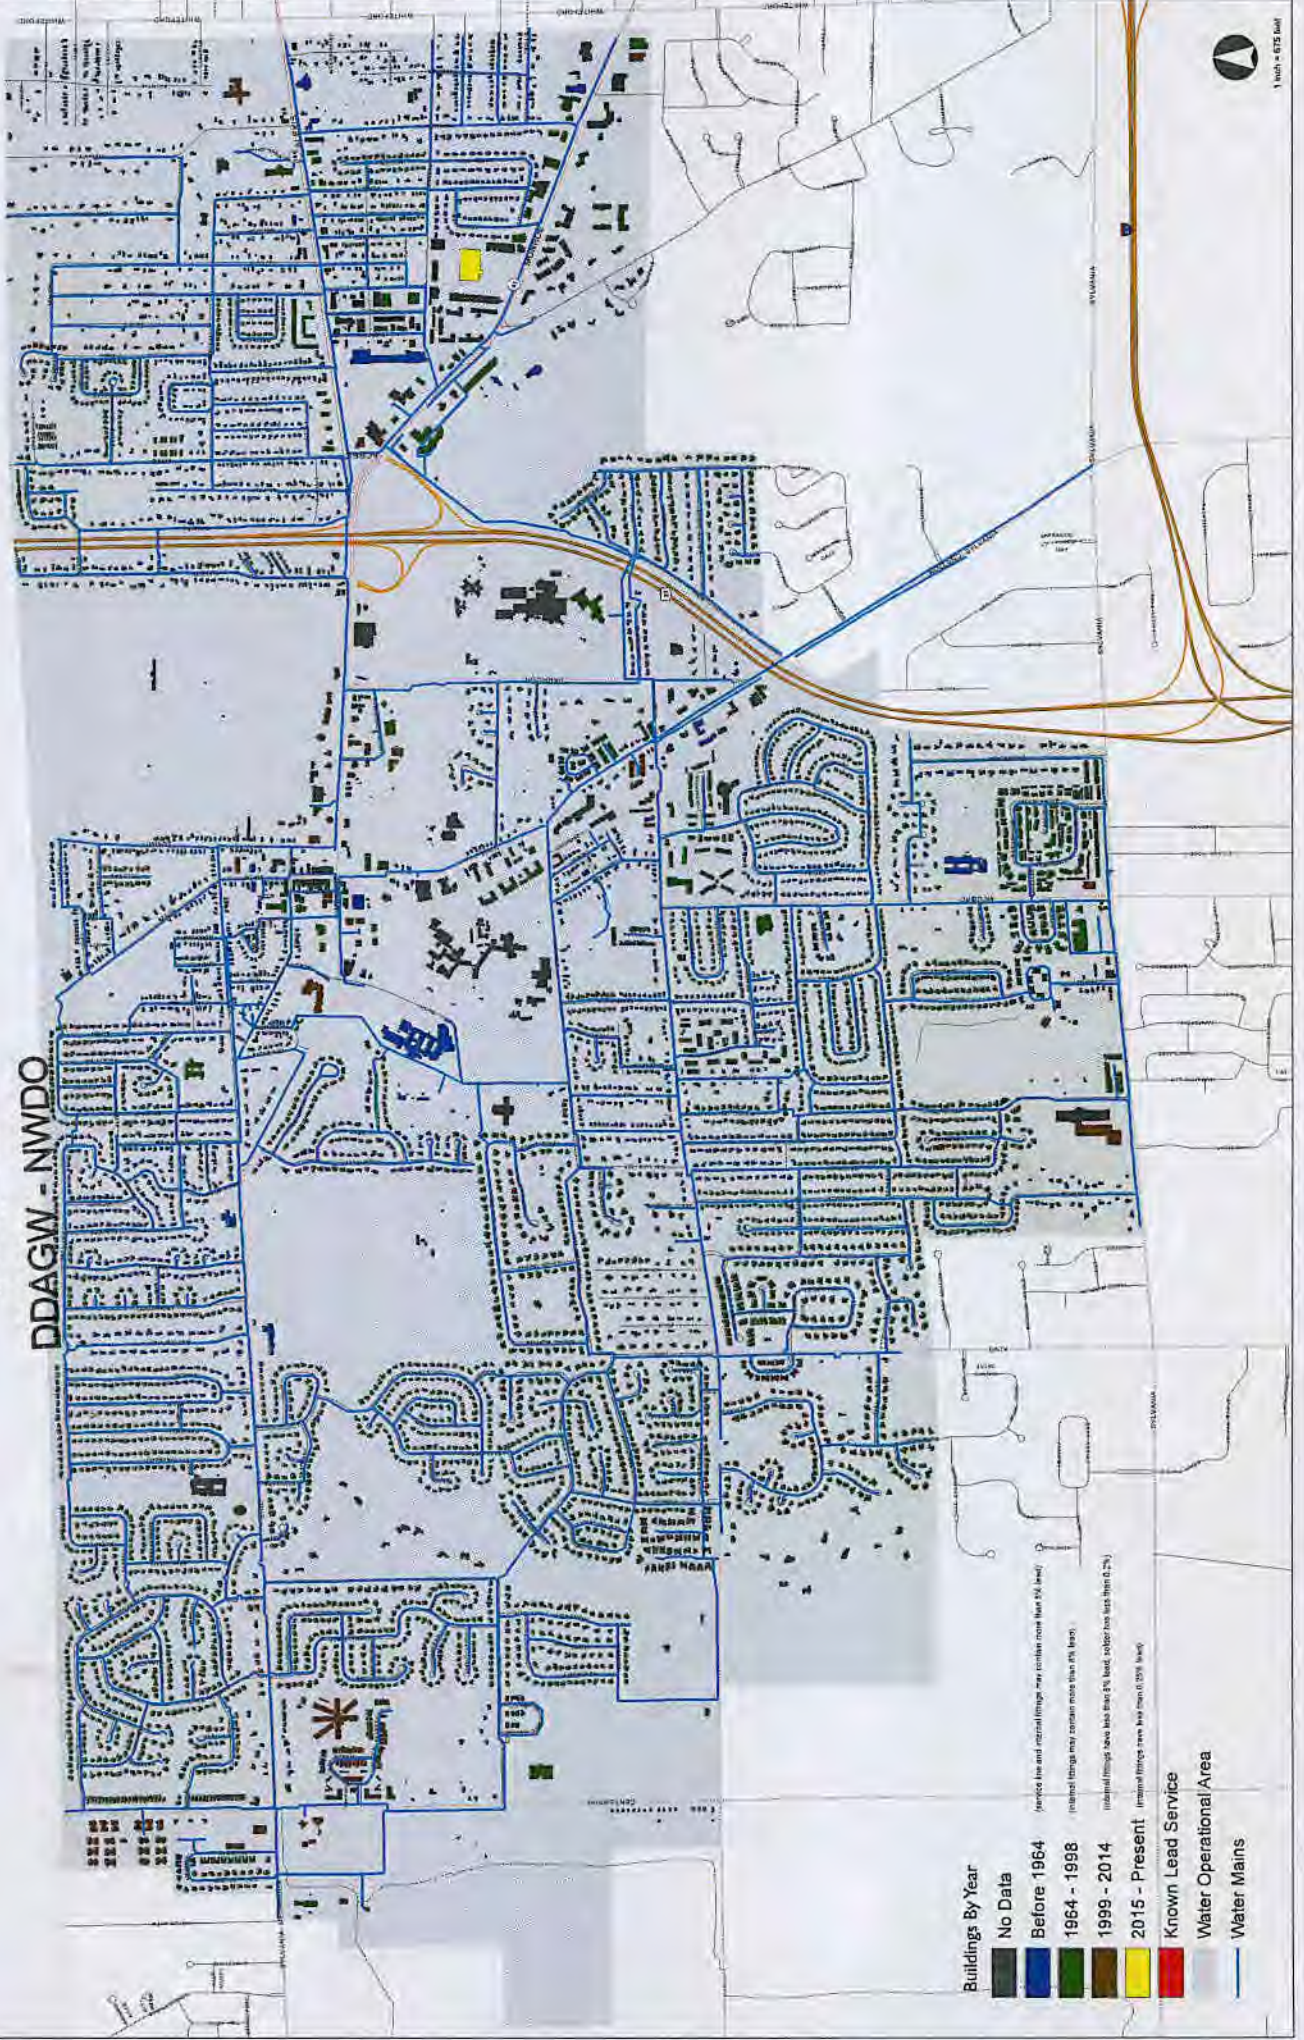

- Buildings By Year**
- No Data
 - Before 1964
 - 1964 - 1998
 - 1999 - 2014
 - 2015 - Present
- Known Lead Service**
- Water Operational Area
 - Water Mains
- (service line and central fringe may contain more than 1% lead)
(partial fringe may contain more than 0% lead)
(partial fringe may contain 0% lead, subject line may have 0.2%)
(partial fringe may have lead from 0.25% lead)



1 inch = 675 feet