

RE: Waynesfield Village
Report
Drinking Water Program
Auglaize County
PWS ID: OH0600912

March 2, 2017

Ohio EPA- Northwest District

Lead Program

347 N. Dunbridge Rd.

Bowling Green, OH 43402

RECEIVED

MAR 06 2017

OHIO E.P.A.
N.W.D.O.

This is the mapping and Sampling Siting Plan for are Lead program, The Village of Waynesfield, Ohio 45896. Our PWS # is OH0600912. If there are any Questions or Concerns please feel free to Contact the Operator of Record for the Village, Kyle Wildermuth at 937-638-7875 or e-mail kawild@live.com.

Thank You,

Kyle Wildermuth

Village of Waynesfield, Ohio


Auglaize County

WATER SYSTEM POSSIBLE LEAD MAP

VILLAGE OF WAYNESFIELD
 AUGLAIZE COUNTY, OHIO

UPDATED FEBRUARY, 2017

RECEIVED
 MAR 06 2017
 OHIO E.P.A.
 N.W.D.O.

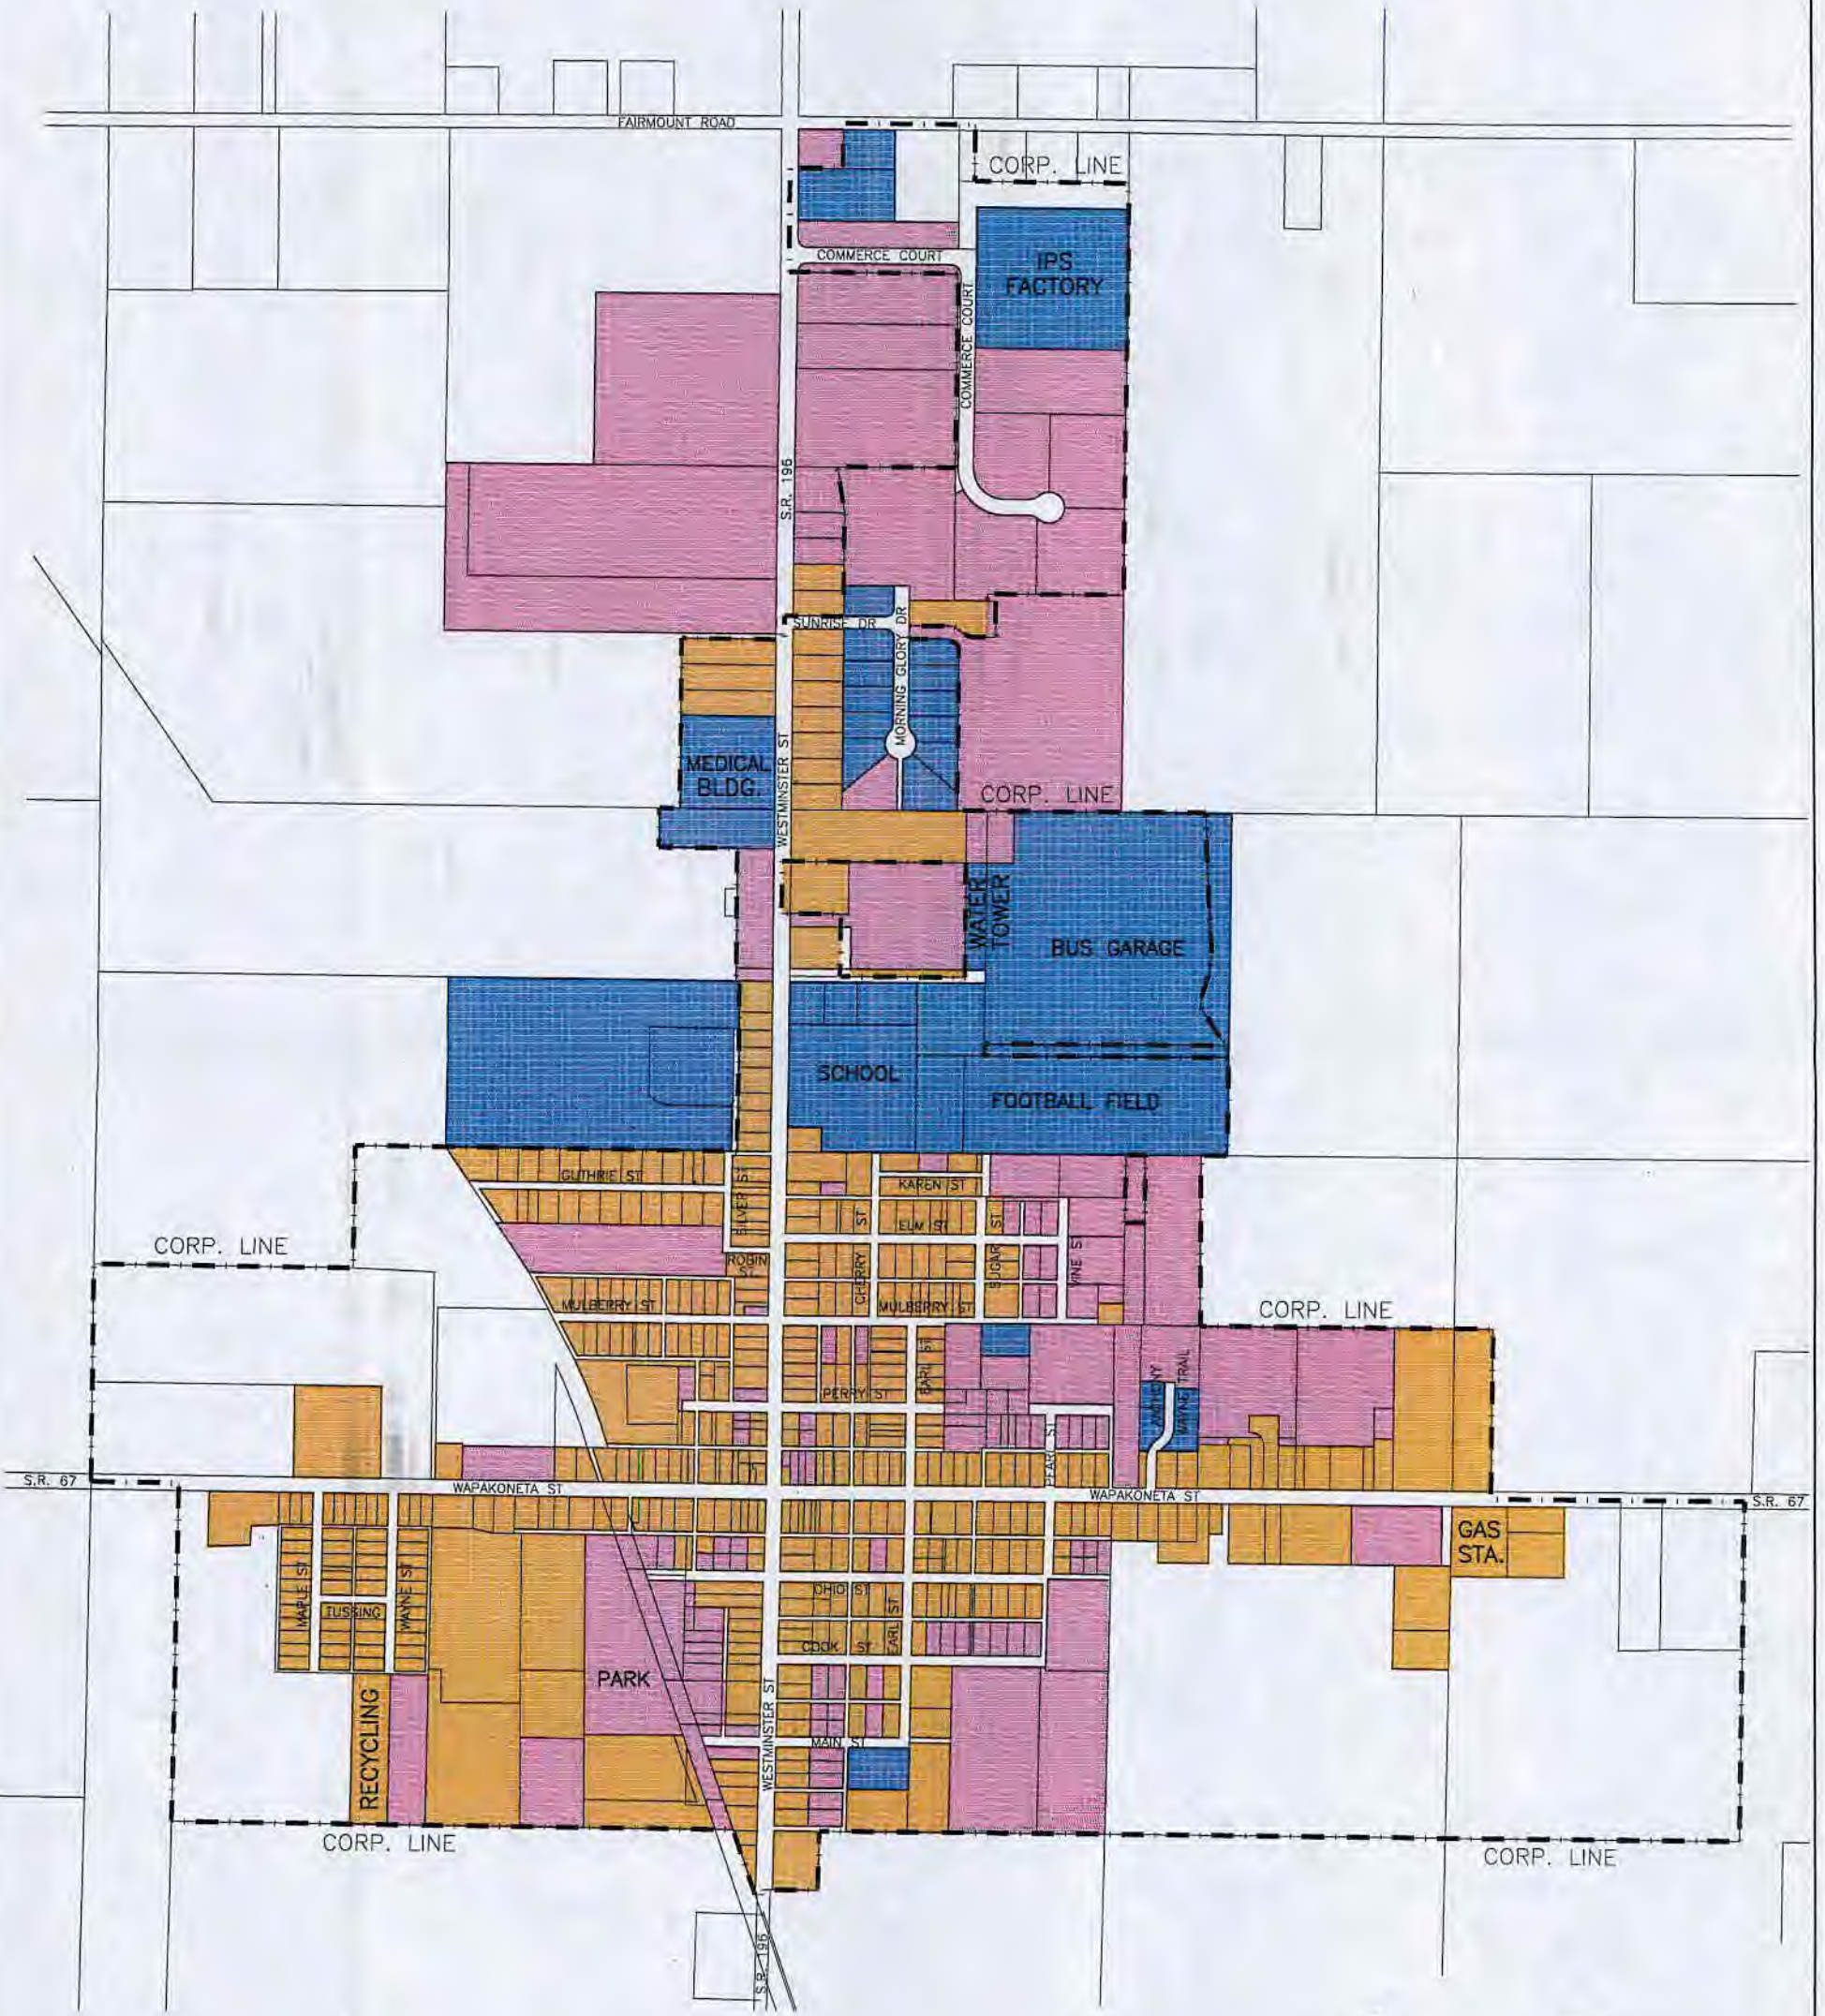

LEGEND

BUILT PRIOR TO 1998;
 POSSIBLE LEAD IN PLUMBING
 FITTINGS



HIGHEST
 RISK

BUILT AFTER 1998 AND PRIOR
 TO 2014; NO MORE THAN 8%
 LEAD IN PLUMBING FITTINGS




↑

BUILT AFTER 2014; LESS
 THAN 0.25% LEAD IN
 PLUMBING FITTINGS



↓
 LOWEST
 RISK

NO HOUSE ON LOT OR NO
 WATER SUPPLIED BY THE
 VILLAGE



SCALE: 1" = 700'

ACCESS
 Engineering Solutions

www.accessengllc.com | 419-586-1430