RE:

Alger Village Report Drinking Water Program Hardin County PWS ID: OH3300112

VILLAGE OF ALGER WATER TREATMENT PLANT 8116 ST. RT. 235 ALGER, OHIO 45812

RECEIVED

MAR 0 6 2017

OHIO E.P.A.

N.W.D.O.

3-3-2017

PWS# OH3300112

LEAD SERVICE LINE; Mapping Statement

The Village of Alger, Ohio has no lead service lines!

This information is based on the following parameters:

- Interviews with past and present water distribution personnel who have been directly and/or in-directly involved with the distribution system for quite some time.
- 2. Verbal statements on materials found or installed during projects or excavations.
- Direct statement of "the Village has no lead service lines" from the previous ORC who re-signed his position 2-28-2017.

Contained within the shaded area of green and yellow striping are components that are likely to have lead content.

Buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

Dale Albert Village of Alger

Water Superintendent

VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS MAR 0 6 2017
CLAIMING NO LEAD SERVICE LINES

OHIO E.P.A.

NOTICE THE PUBLIC WATER SYSTEMS ARE 20 10 2017

OHIO E.P.A.

NOTICE THE PUBLIC WATER SYSTEMS ARE 20 10 2017

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):


LEAD SERVICE LINE VERIFICATION

This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):

- ☐ Historical permit records and/or local ordinances
- Distribution maintenance records (i.e. meter replacement, waterline break repairs)
- ☐ Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)
- Service line material of all service lines is known (i.e. all service lines are known to be PVC)

1/all all	3-3-2017		W OI
Signature of Responsible Person	Date	PWS NAME:	VIO Alger
DAJE Alber - WATER	Superintendent	PWS ID:	OH_ 3300112
Printed Name and Title of Responsib	ole Person		

For Ohio EPA use only:	
Date Verification Rec'd:	

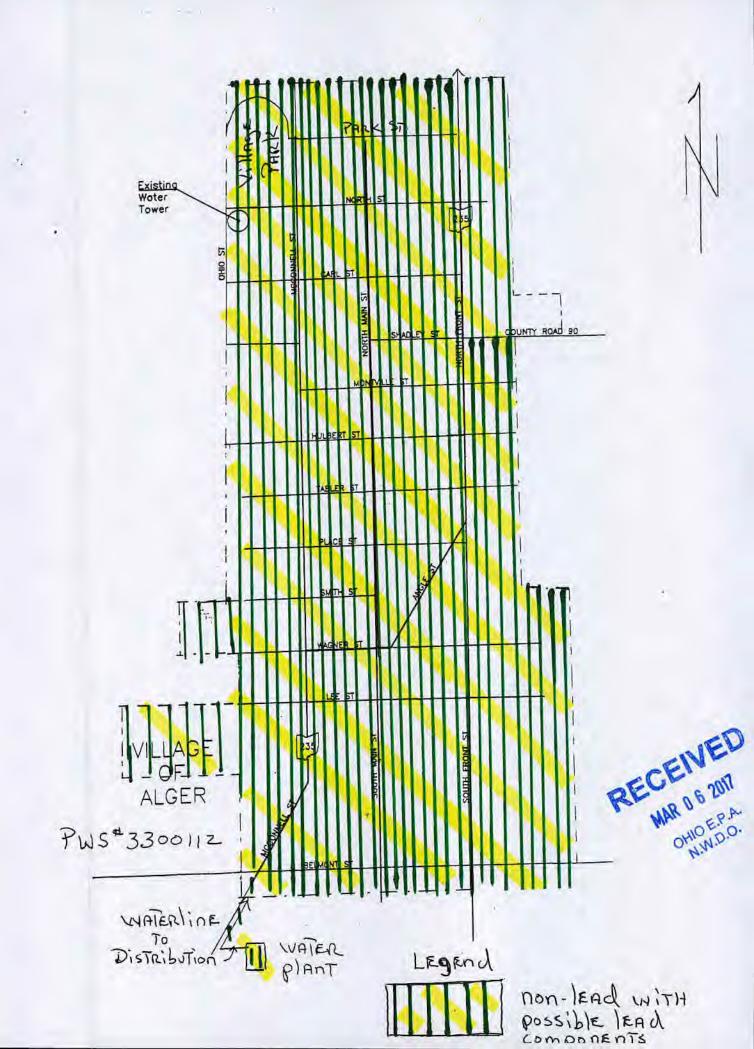

Village of Alger

