

RE: Wayne Village
Report
Drinking Water Program
Wood County
PWS ID: OH8703112

Village of Wayne Public Water System Lead (Pb) Components

Prepared March 2017

To comply with Section 6109.21 of the Ohio Revised Code, enacted in September 2016, the Village of Wayne in Wood County, Ohio has created the following report and attached map to identify known and potential components of its public water system that contain lead (Pb).

Service Lines and Ownership

The Village of Wayne Water Department distributes water to 383 services. The Village owns and maintains service lines from the water distribution mains up to the meters that are located in the Village right-of-way. The remainder of each service line from the meter to the building is the responsibility of the property owner. **Joe St. Claire is the Village Administrator and oversees the water system. He has been with the Village for 29 years.**

The table below provides information about the possibility of lead service lines and use of leaded plumbing materials to the customers Wayne serves. Each service line's probability rating is based on the water system replacement project completed in 2005, and on the private side, based on the year each structure was built.

Possibility of Lead	Public	% of the System	Private	% of the System
Very Likely or Verified	0	0%	0	0%
High	0	0%	0	0%
Moderate	0	0%	3	0.70%
Low	0	0%	259	67.60%
No Lead	383	100%	99	25.80%
Unknown	0	0%	22	5.70%

Distribution System

The Village replaced its entire water system including the public side of the water service lines in 2005. Documentation of this project is attached. As a result of the project, the Village can speak with great certainty there is no lead within its distribution system. The Village only chlorinates its water, and does not require the use of any corrosion control treatment.

Indoor Plumbing

Buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998.

Buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

Customer Self-Reporting

The information on this map regarding privately owned service lines is based on the information from the water system staff. Property owners are encouraged to inspect their own service lines entering their buildings if these are in anyway exposed, and notify the Village of Wayne Water Department if they have determined whether or not a lead service line exists. Please contact the Village Administrator by calling 419-575-3568. A representative from the water department will contact you to confirm and update this information for the next map release.

Contacts and Resources

If you have questions about known and potential lead components within the Village of Wayne Public Water System, please contact:

Joe St. Claire, Village Administrator


419-575-3568

For more information about lead service lines and their removal, we recommend the following resources:

- **The Lead Service Line Replacement Collaborative**
<http://www.lslr-collaborative.org/resources-for-concerned-consumers.html>
- **Ohio EPA 'Learn About Lead' page**
<http://epa.ohio.gov/pic/lead.aspx>
- **US EPA Lead in Drinking Water Information Page**
<https://www.epa.gov/ground-water-and-drinking-water/basic-information-about-lead-drinking-water>

Village of Wayne Lead Probability

PWS ID:OH8703112

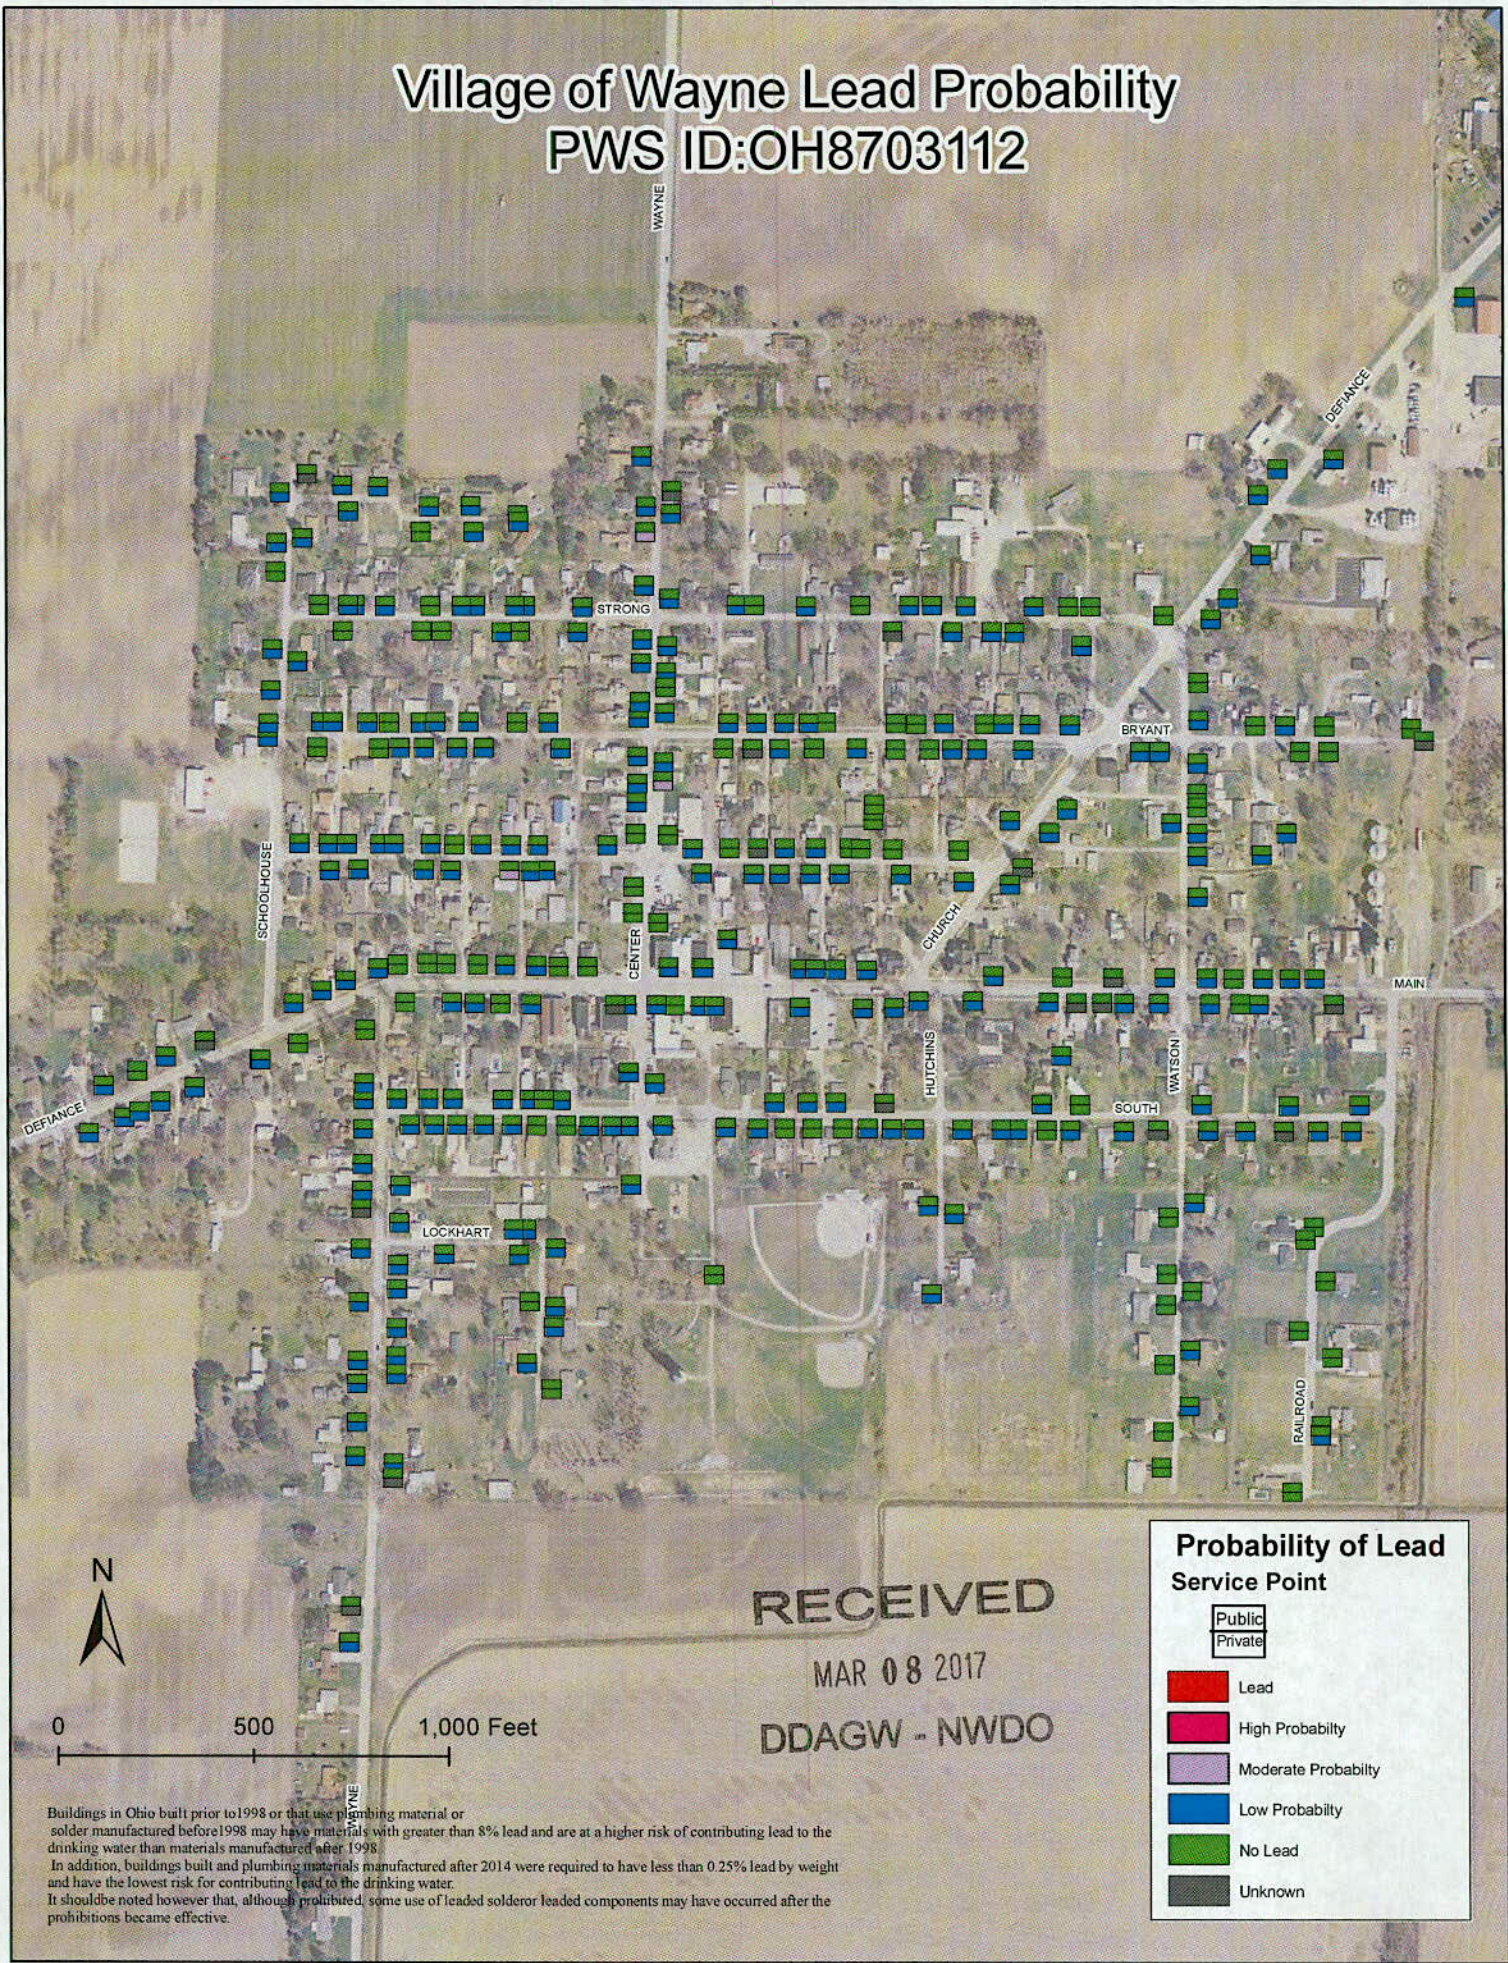

Probability of Lead Service Point

<input type="checkbox"/>	Public
<input type="checkbox"/>	Private
■	Lead
■	High Probability
■	Moderate Probability
■	Low Probability
■	No Lead
■	Unknown

Buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998.

In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water.

It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

RECEIVED
 MAR 08 2017
 DDAGW - NWDO

VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS CLAIMING NO LEAD SERVICE LINES

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
<p>This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):</p> <ul style="list-style-type: none"><input type="checkbox"/> Historical permit records and/or local ordinances<input checked="" type="checkbox"/> Distribution maintenance records (i.e. meter replacement, waterline break repairs)<input checked="" type="checkbox"/> Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)<input checked="" type="checkbox"/> Service line material of all service lines is known (i.e. all service lines are known to be PVC)

Melissa Prepasz 3/16/17
Signature of Responsible Person Date

Melissa Prepasz Fiscal Officer
Printed Name and Title of Responsible Person

PWS NAME: Village of Wayne
PWS ID: OH 8703112
COUNTY: Lorain

<p><u>For Ohio EPA use only:</u></p> <p>Date Verification Rec'd: _____</p>

RECEIVED
MAR 08 2017
DDAGW - NWDO

WATER SYSTEM IMPROVEMENTS VILLAGE OF WAYNE WOOD COUNTY, OHIO CONTRACT "A" 2003


DESIGN ENGINEERS



Thomas E. Stalter DATE 2/5/03
THOMAS E. STALTER, P.E. - 53582



Daniel A. Lindsay DATE 2-5-03
DANIEL A. LINDSAY, P.E. - 49016

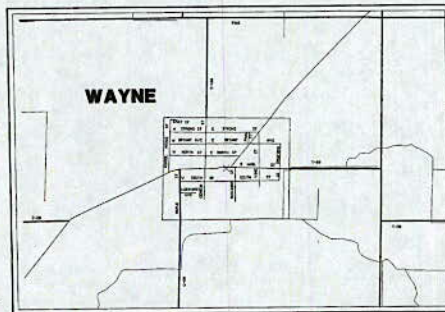

SITE MAP
NOT TO SCALE

APPROVALS

APPROVED: *James P. Davis* DATE 2-5-03
MAYOR - VILLAGE OF WAYNE, OHIO

APPROVED: *Joe McClass* DATE 2-5-03
VILLAGE ADMINISTRATOR - VILLAGE OF WAYNE, OHIO

POGEMEYER DESIGN GROUP, INC.
PLANNERS
ENGINEERS
ARCHITECTS
1188 NORTH MAIN STREET
BOWLING GREEN, OHIO 43402
(419) 352-7537



SET NO.

20

ISSUANCE

DATE DESCRIPTION

REVISION

DATE DESCRIPTION

COPYING PERMITTED
TWO WORKING DAYS
BEFORE YOU DIG
Call 1-800-282-2724 (Toll Free)
Ohio State Protection Service
NON-MEMBERS
MAY BE CALLED DIRECTLY

RECORD DRAWING

**WATER SYSTEM
IMPROVEMENTS
CONTRACT "A"
VILLAGE OF
WAYNE
WOOD CO., OH.**
PDG NO. 3140-007

RECEIVED

MAR 08 2017

DDAGW - NWDO

I:\3140\007\env\water\ipn\cover.dwg 02/03/2003 10:44:54 PM EST

Village of Wayne Sampling Sites

PWS ID: OH8703112



RECEIVED
MAR 08 2017
DDAGW - NWDO



HouseNum	Street	year	pub	priv	site	address	zip	State
129	West North St	1900	5	4	Lead Sample Site	129 West North St	43466	Ohio
122	East North St	1900	5	4	Lead Sample Site	122 East North St	43466	Ohio
213	North Center St	1943	5	4	Lead Sample Site	213 North Center St	43466	Ohio
313	North Center St	1900	5	4	Lead Sample Site	313 North Center St	43466	Ohio
107	Park St	1951	5	4	Lead Sample Site	107 Park St	43466	Ohio
122	Watson St	1900	5	5	Lead Sample Site	122 Watson St	43466	Ohio
114	East South St	1996	5	4	Lead Sample Site	114 East South St	43466	Ohio
302	East South St	1952	5	4	Lead Sample Site	302 East South St	43466	Ohio
340	Watson St	1973	5	5	Lead Sample Site	340 Watson St	43466	Ohio
117	West South St	1947	5	4	Lead Sample Site	117 West South St	43466	Ohio

RECEIVED

MAR 08 2017

DDAGW - NWDO