

RE: Fulton / Lucas Waterline
Report
Drinking Water Program
Fulton County
PWS ID: OH2601403


LEAD SERVICE LINE CERTIFICATION

WATER SYSTEM Fulton/Lucas Waterline Water System
OWNER Fulton County Commissioners
PWS ID OH2601403
SERVICE AREA North Star BlueScope Steel Facility

This lead service line certificate applies to the current premise that is served by the above listed water system. Based on the following, this water system has no records of lead service lines within the current service area:



1. The entire water system was constructed and placed in operation in 1996.
2. The water service line is ductile iron material.

Ziad Musallam, PE
Director/Sanitary Engineer & Operator-of-Record

Signature: 

Date: 3-7-2017

RECEIVED
MAR 08 2017
DDAGW - NWDO

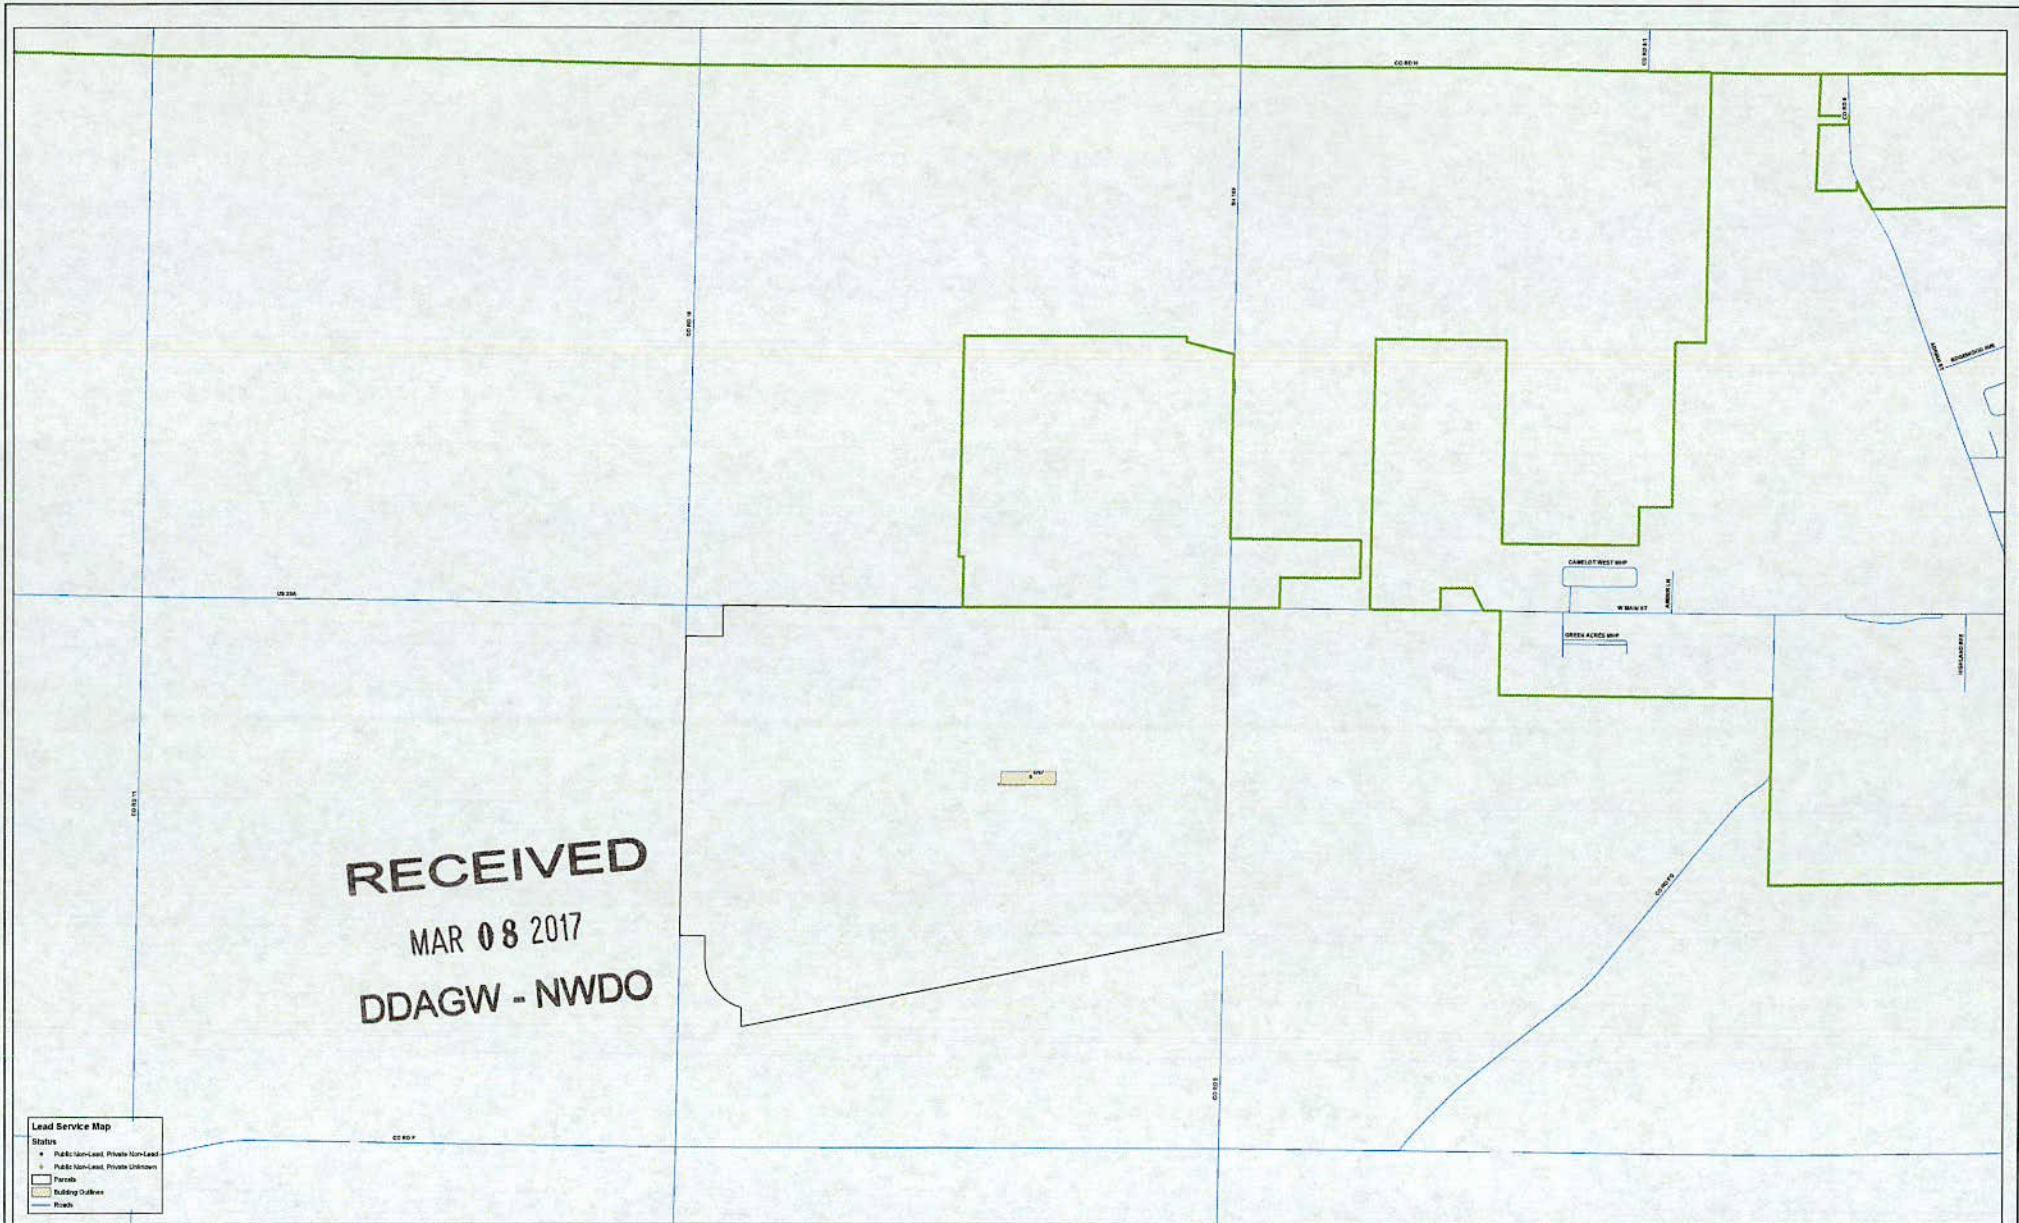

Lead Service Map
 Fulton/Lucas Waterline – PWS ID OH2601403

"Buildings in Ohio built prior to 1936 or that use plumbing material or solder manufactured before 1936 may have materials with greater than 9% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1936. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective."

Created by FC GIS, S Yoder Date: 3/8/2017