

### **Lead Line Mapping Narrative**

The Village of Junction City owns and maintains a public water system that serves approximately 360 customers. The water mains were all replaced throughout the late 90s and early 2000's and are all PVC pipe. The public portion of the service lines were all replaced in 2016 with polyethylene line. Therefore, the entire public portion of the system can be classified as not containing lead.

The Village lacks sufficient records to accurately determine areas within the system containing lead service lines on private property. They do not have a building department or permit records. There are no as-built drawings for the original system that may identify material utilized for service line installation. Their existing operation and maintenance records do not contain information about the material of existing lines that were repaired. The Village does not use tap cards for new installations nor do they have any historic tap card records. The Village has not implemented a customer self-reporting program to identify lead lines within the distribution system, but is planning to do so in the near future. Due to the lack of adequate record information, the only basis of determination for preparation of the lead line map for private service lines is the age of the building.


Because it is practically impossible to determine the lead content of an installed fixture, fitting or pipe, it is assumed that the manufacture or installation date is the primary indicator of the lead content. Therefore, the characteristics of buildings and piping solder or fixtures would be buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

For the mapping purposes, any buildings or areas constructed prior to 1998 were classified as "no information available", while buildings or areas constructed in 1998 or after were classified as "no lead". The age of the building and area was obtained from the knowledge of Village staff.

The Village is not aware of the presence of any lead service lines within the system, but cannot rule out the possibility due to the lack of information.

PERRY COUNTY, OHIO  
VILLAGE OF JUNCTION CITY

## LEAD MAP

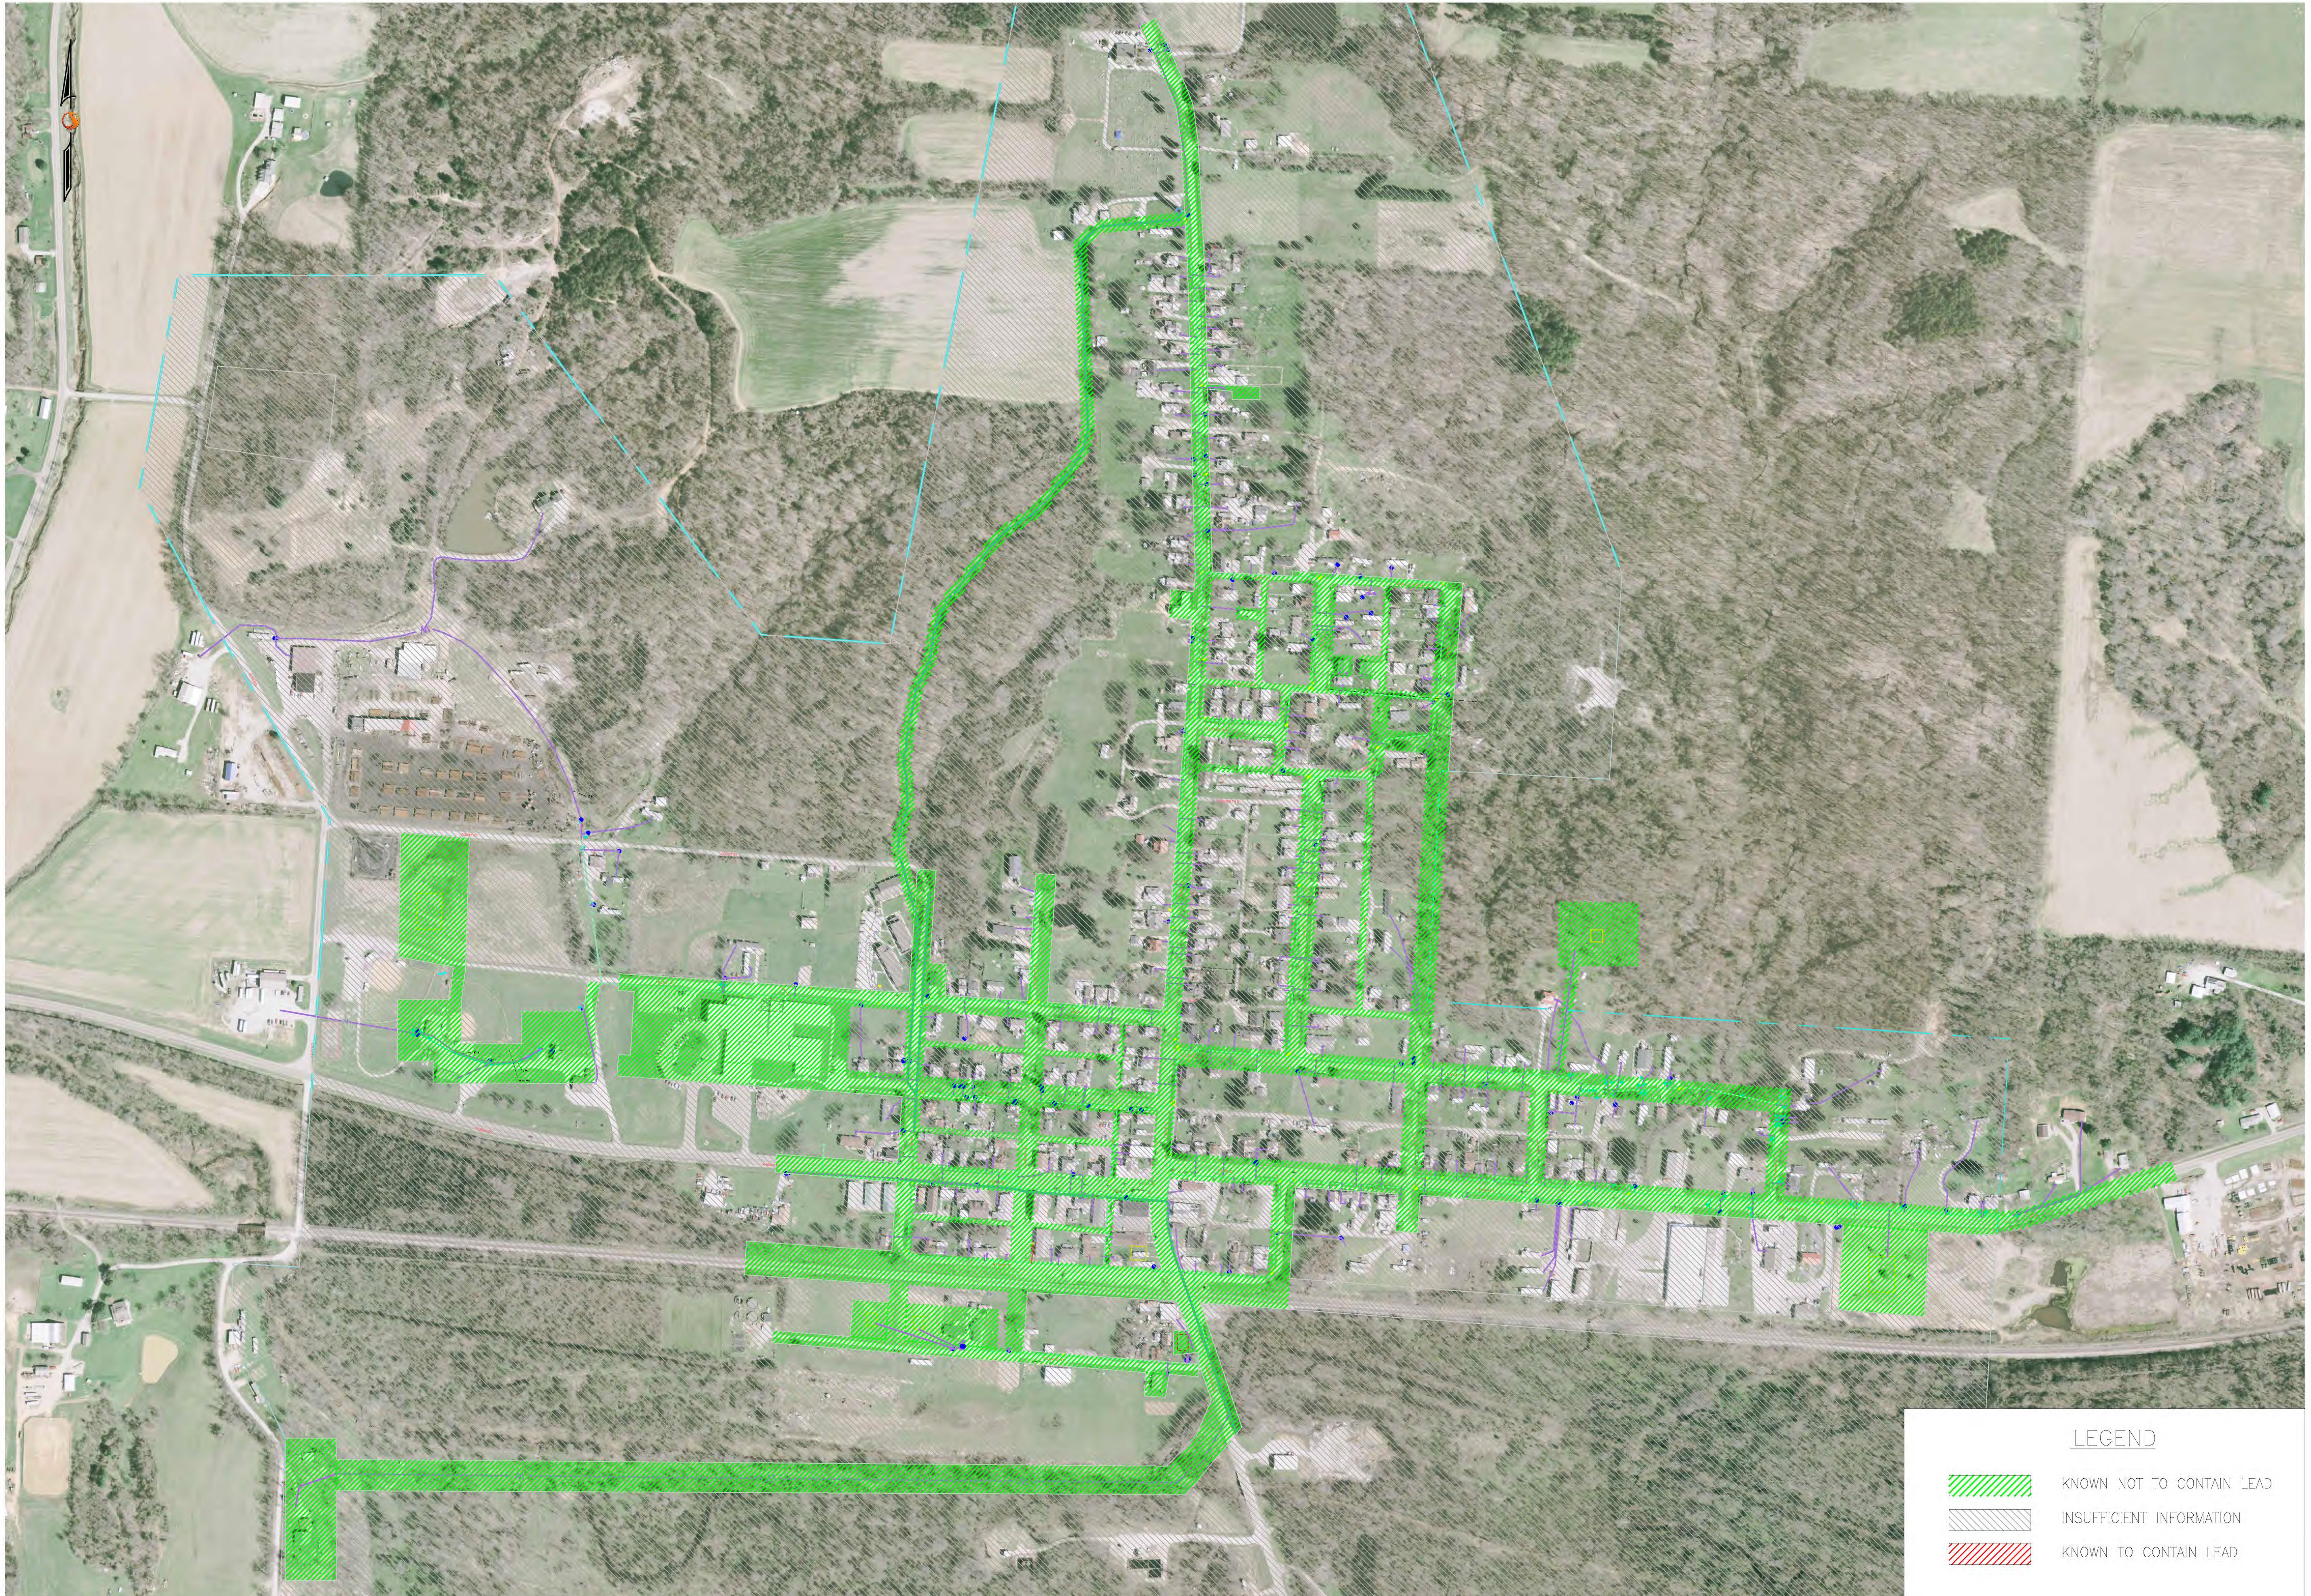

UNDERGROUND UTILITIES  
Two Working Days  
**BEFORE YOU DIG**  
Call 811 (Toll free)  
OHIO UTILITIES PROTECTION SERVICE  
NON-MEMBERS  
MUST BE CALLED DIRECTLY

**OGPUPS**   
Ohio Oil & Gas Producers Underground Protection Service  
Call (800) 925-0988

## REVISIONS

**Stantec**   
1517 W. HUNTER STREET, LUCAS, OHIO 43136  
(740) 380-2828 FAX (740) 380-1565

DESIGN: MDB  
DRAWN: EZS  
SCALE: 1" = 250'

Copyright Reserved  
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing — any errors or omissions shall be reported to Stantec without delay.  
The Contractor's designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.