

**Disclaimer- Service Lines**

-Most of the villages WDS network was built in the early 1910's. There is a possibility for lead services in these areas. These areas are shown as yellow.

-In the early 2000's the water main extensions to Crestwood schools and the village fire station were built. These areas are shown as green.

**Disclaimer- Building Characteristics**

-In 1986 the Safe Drinking Water Act (SDWA) banned lead solder in excess of 0.2% lead for residential and human consumption and lead free pipes and fittings were considered to have no more than 8.0% lead


- The lead ban provisions of the act became effective in the Ohio Plumbing Code on March 30, 1998. Thus, primarily residential and commercial buildings built after this date are NOT LIKELY to contain lead solder and fixtures. Buildings built before this date are more likely to have a higher risk to exposure of lead.

-Buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have to lowest risk for contributing lead to the drinking water.

-Although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

-Information contained in this figure are not intended to identify specific water services, homes, and/or buildings, but rather are to identify general areas of potential for lead based materials

-We neither confirm nor deny the presence of lead at any specific site

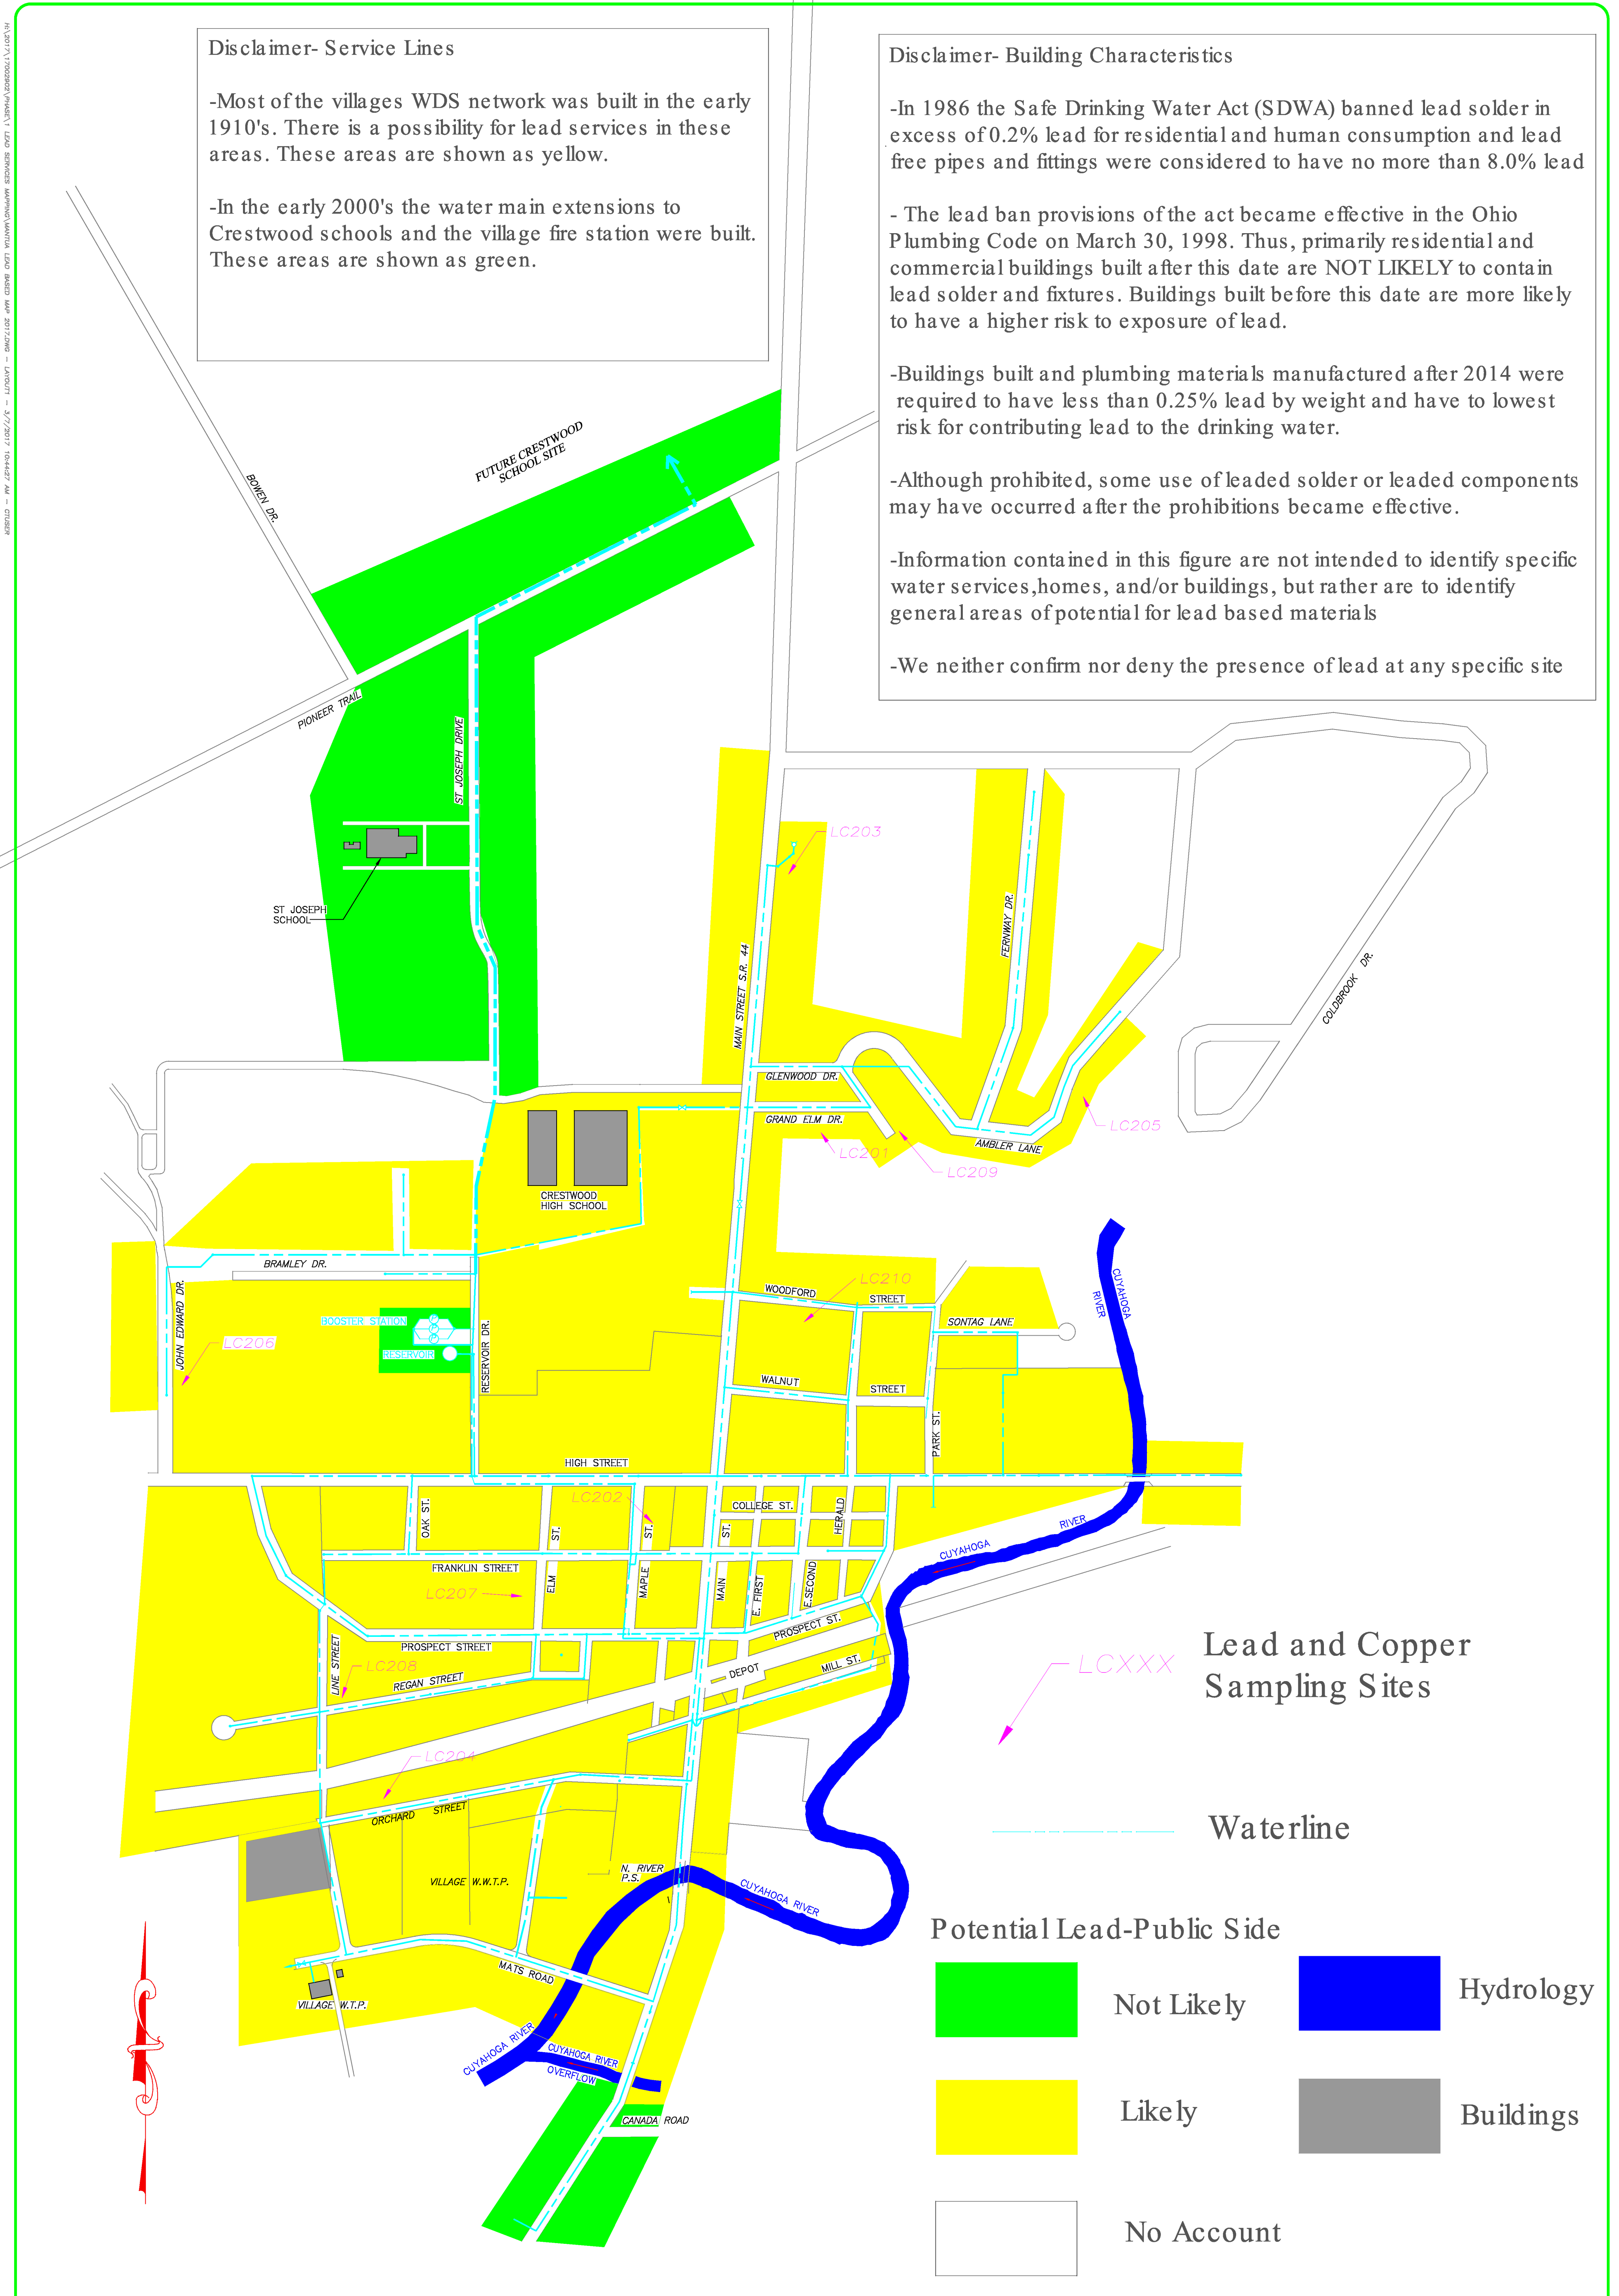

PROJECT NO: <b>17002902</b>	DRAWING NAME: <b>Lead Map</b>	SHEET OF: <b>1 1</b>	<b>Mantua Lead Based Mapping</b>			SCALE: No Scale DATE: 3/7/17 DESIGNED BY: KDB DRAWN BY: KDB CHECKED BY: XXX	NO . . . . . .	REVISION . . . . . .	DATE . . . . . .		<b>PRELIMINARY</b>
			PWS ID #OH6702212								