

RE: COBURN  
Report  
Drinking Water Program  
Ashland County  
PWS ID: OH0338412

RECEIVED

VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS  
CLAIMING NO LEAD SERVICE LINES

MAR 07 2017



OHIO E.P.A.

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.


Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
<p><b>This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):</b></p> <ul style="list-style-type: none"> <li><input type="checkbox"/> Historical permit records and/or local ordinances</li> <li><input type="checkbox"/> Distribution maintenance records (i.e. meter replacement, waterline break repairs)</li> <li><input checked="" type="checkbox"/> Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)</li> <li><input type="checkbox"/> Service line material of all service lines is known (i.e. all service lines are known to be PVC)</li> </ul>

  
 Signature of Responsible Person      Date 3-3-2017  
  
 Printed Name and Title of Responsible Person

PWS NAME: Coburn  
 PWS ID: OH 040338412  
 COUNTY: Ashland

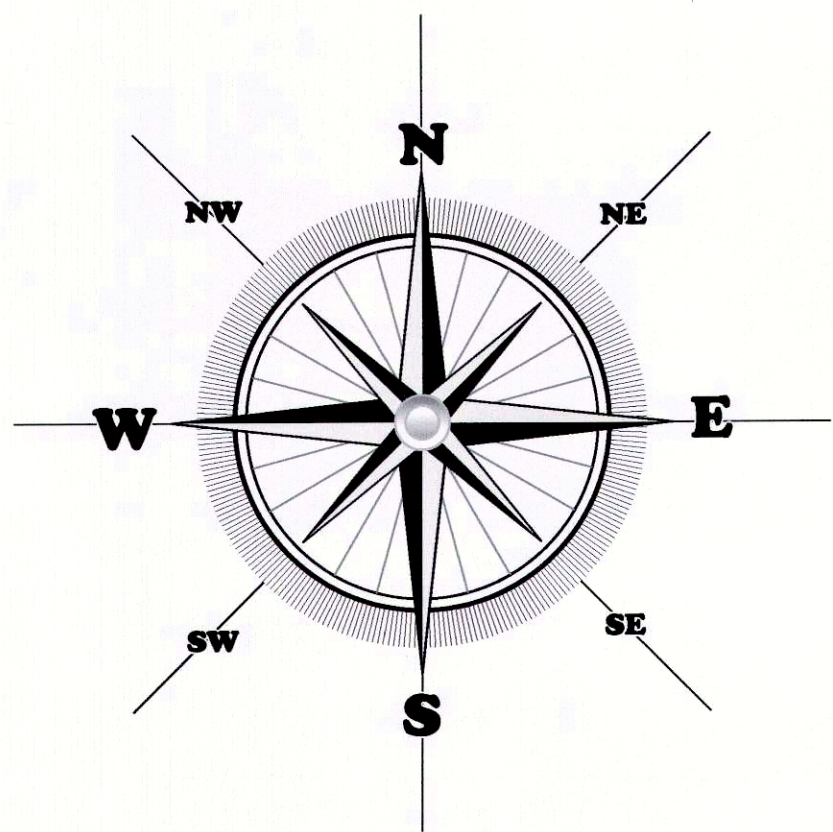

- A** 18080 ft<sup>2</sup> 1SMTL 80 X 226
- B** 13460 ft<sup>2</sup> 1SCB IRR
- C** 7800 ft<sup>2</sup> 1SCB 60 X 130
- D** 8320 ft<sup>2</sup> 1SCB IRR
- E** 8848 ft<sup>2</sup> 1SMTL 156 X 56

**02**

## COBURN CARTON SOLUTIONS

636 ASHLAND COUNTY ROAD 30A


HAYESVILLE, OH 44838

(419) 368-4051

PWSID-OH0338412

- A - Well Head
- B - Pressure Tank
- C - Softner
- d** d - Hot Water Tank
- e** e - Water Dispenser
- f** f - Coffee Machine
- g** g - Eye Cleaning Stations
- H** - Hose Hookups
- S** - Hand Sinks
- Non-Lead (PVC)
- Possible Lead (Copper)
- Hot Water Lines

\*All water fixtures were replaced between 2002-2004 along with copper tubing. The water lines are all pvc until they reach a dispensing point where they go into copper tubing.

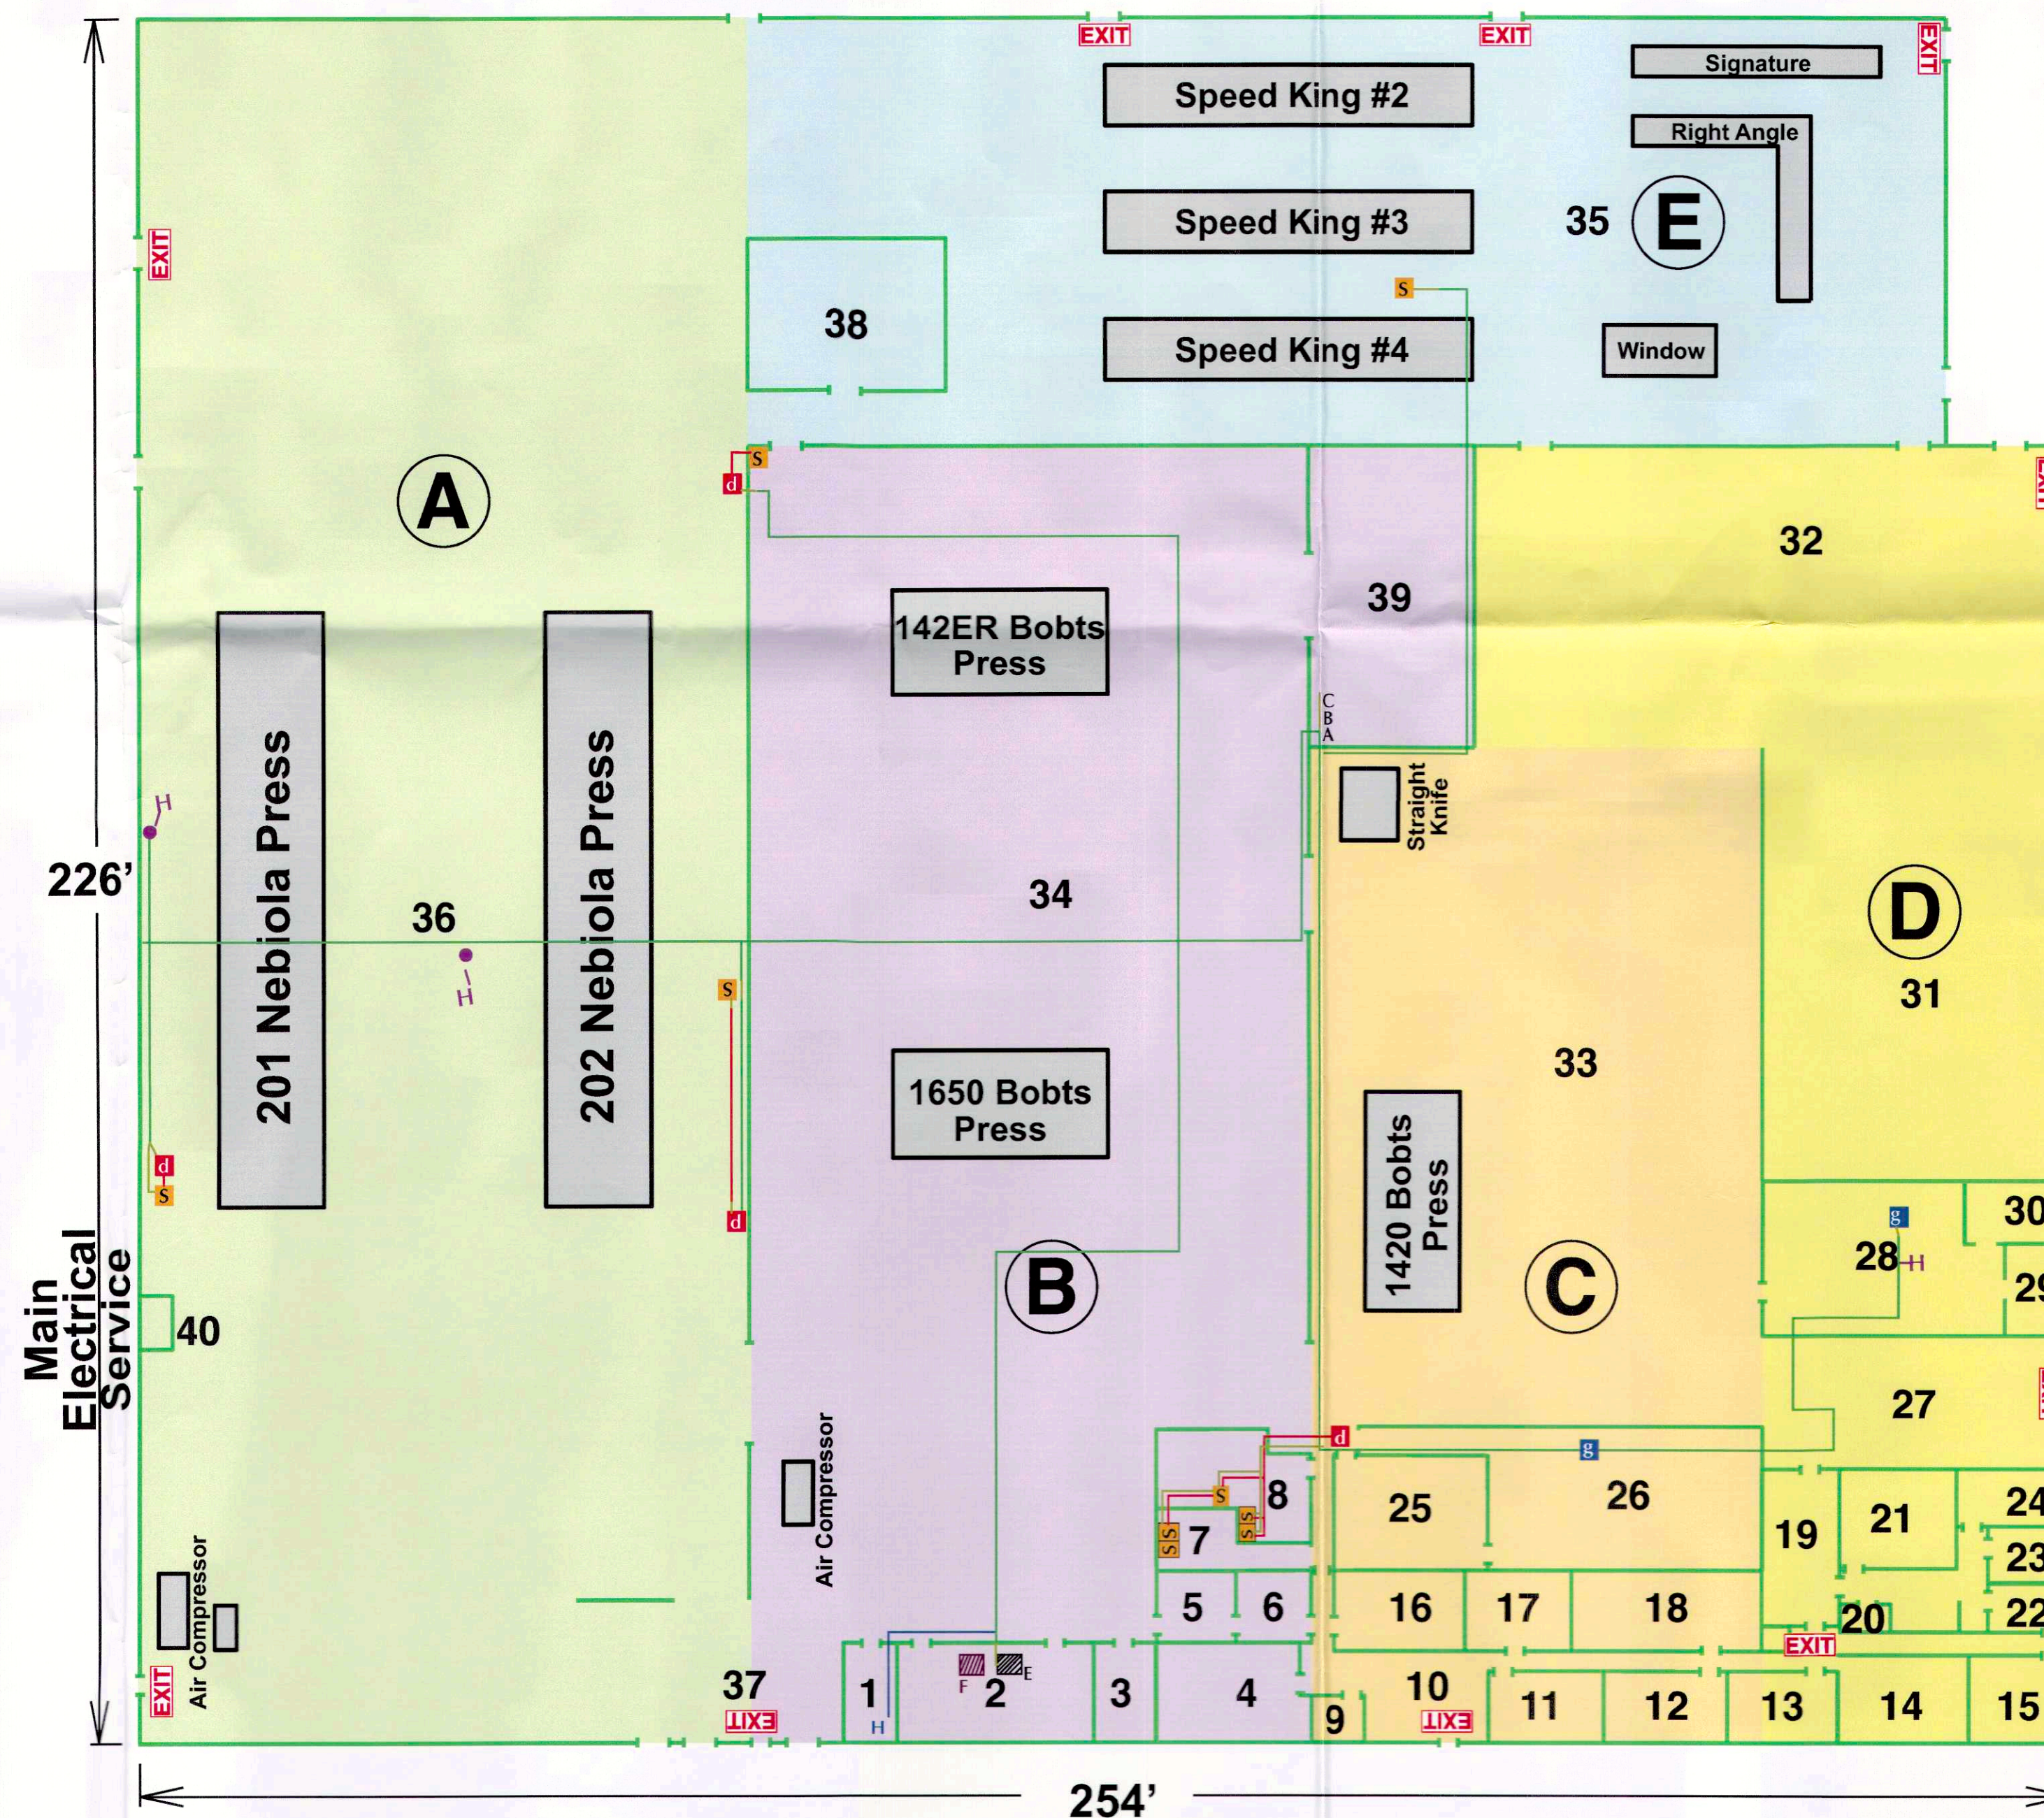

**EXIT** LIGHTED EXIT SIGNS



Fire Extinguisher Location

**02**

- 1 Janitors Closet
- 2 Break Room
- 3 Shipping Office
- 4 Office
- 5 Office
- 6 Phone/Copy Room
- 7 Woman's Rest Room
- 8 Men's Rest Room
- 9 Copy Room
- 10 Main Lobby
- 11 Office
- 12 Office
- 13 Office
- 14 Office
- 15 Storage
- 16 Supply Room
- 17 Office
- 18 Conference Room
- 19 Sample Room
- 20 Boiler
- 21 Sales Office
- 22 Sales Office
- 23 Sales Office
- 24 Sales Office
- 25 Cad/Cam Room
- 26 Plate Room
- 27 Plate Storage
- 28 Maintenance Room
- 29 Maintenance Office
- 30 Parts Room
- 31 Die Storage
- 32 Stripping
- 33 Die Cutting #1
- 34 Die Cutting #2
- 35 Gluing
- 36 Press Room
- 37 Dock
- 38 Solvent Room
- 39 Ink Room
- 40 Main Electrical Service

RECEIVED  
MAR 07 2017  
OHIO E.P.A.  
N.W.D.O.