

## Map Details

### Title


Ripley Union Rural Water Lead and Copper map

### Description

The Ripley Union Rural Water was started in 1966. In 1968 Roy Griffith started with them. He is the chairman of Ripley Union Rural Water now. He told me that plastic water line have been used from the beginning till now. I all so talk to Randy King who was the maintenance man for Ripley Union Rural Water until the first of this year told me that he work on plastic line only.

The Legend is as follows: The Line number indicates type and size of water line. The Point number 72 indicates Ripley union Rural water pump station. The point number 56,57,58,59,69,70,71,72,73,and74 indicates the location of the homes that were used during the Lead and Copper testing. All of these homes were build before 1983. It is possible that they may have lead content of an installed fixtures, fittings or pipes.

[DONE](#)

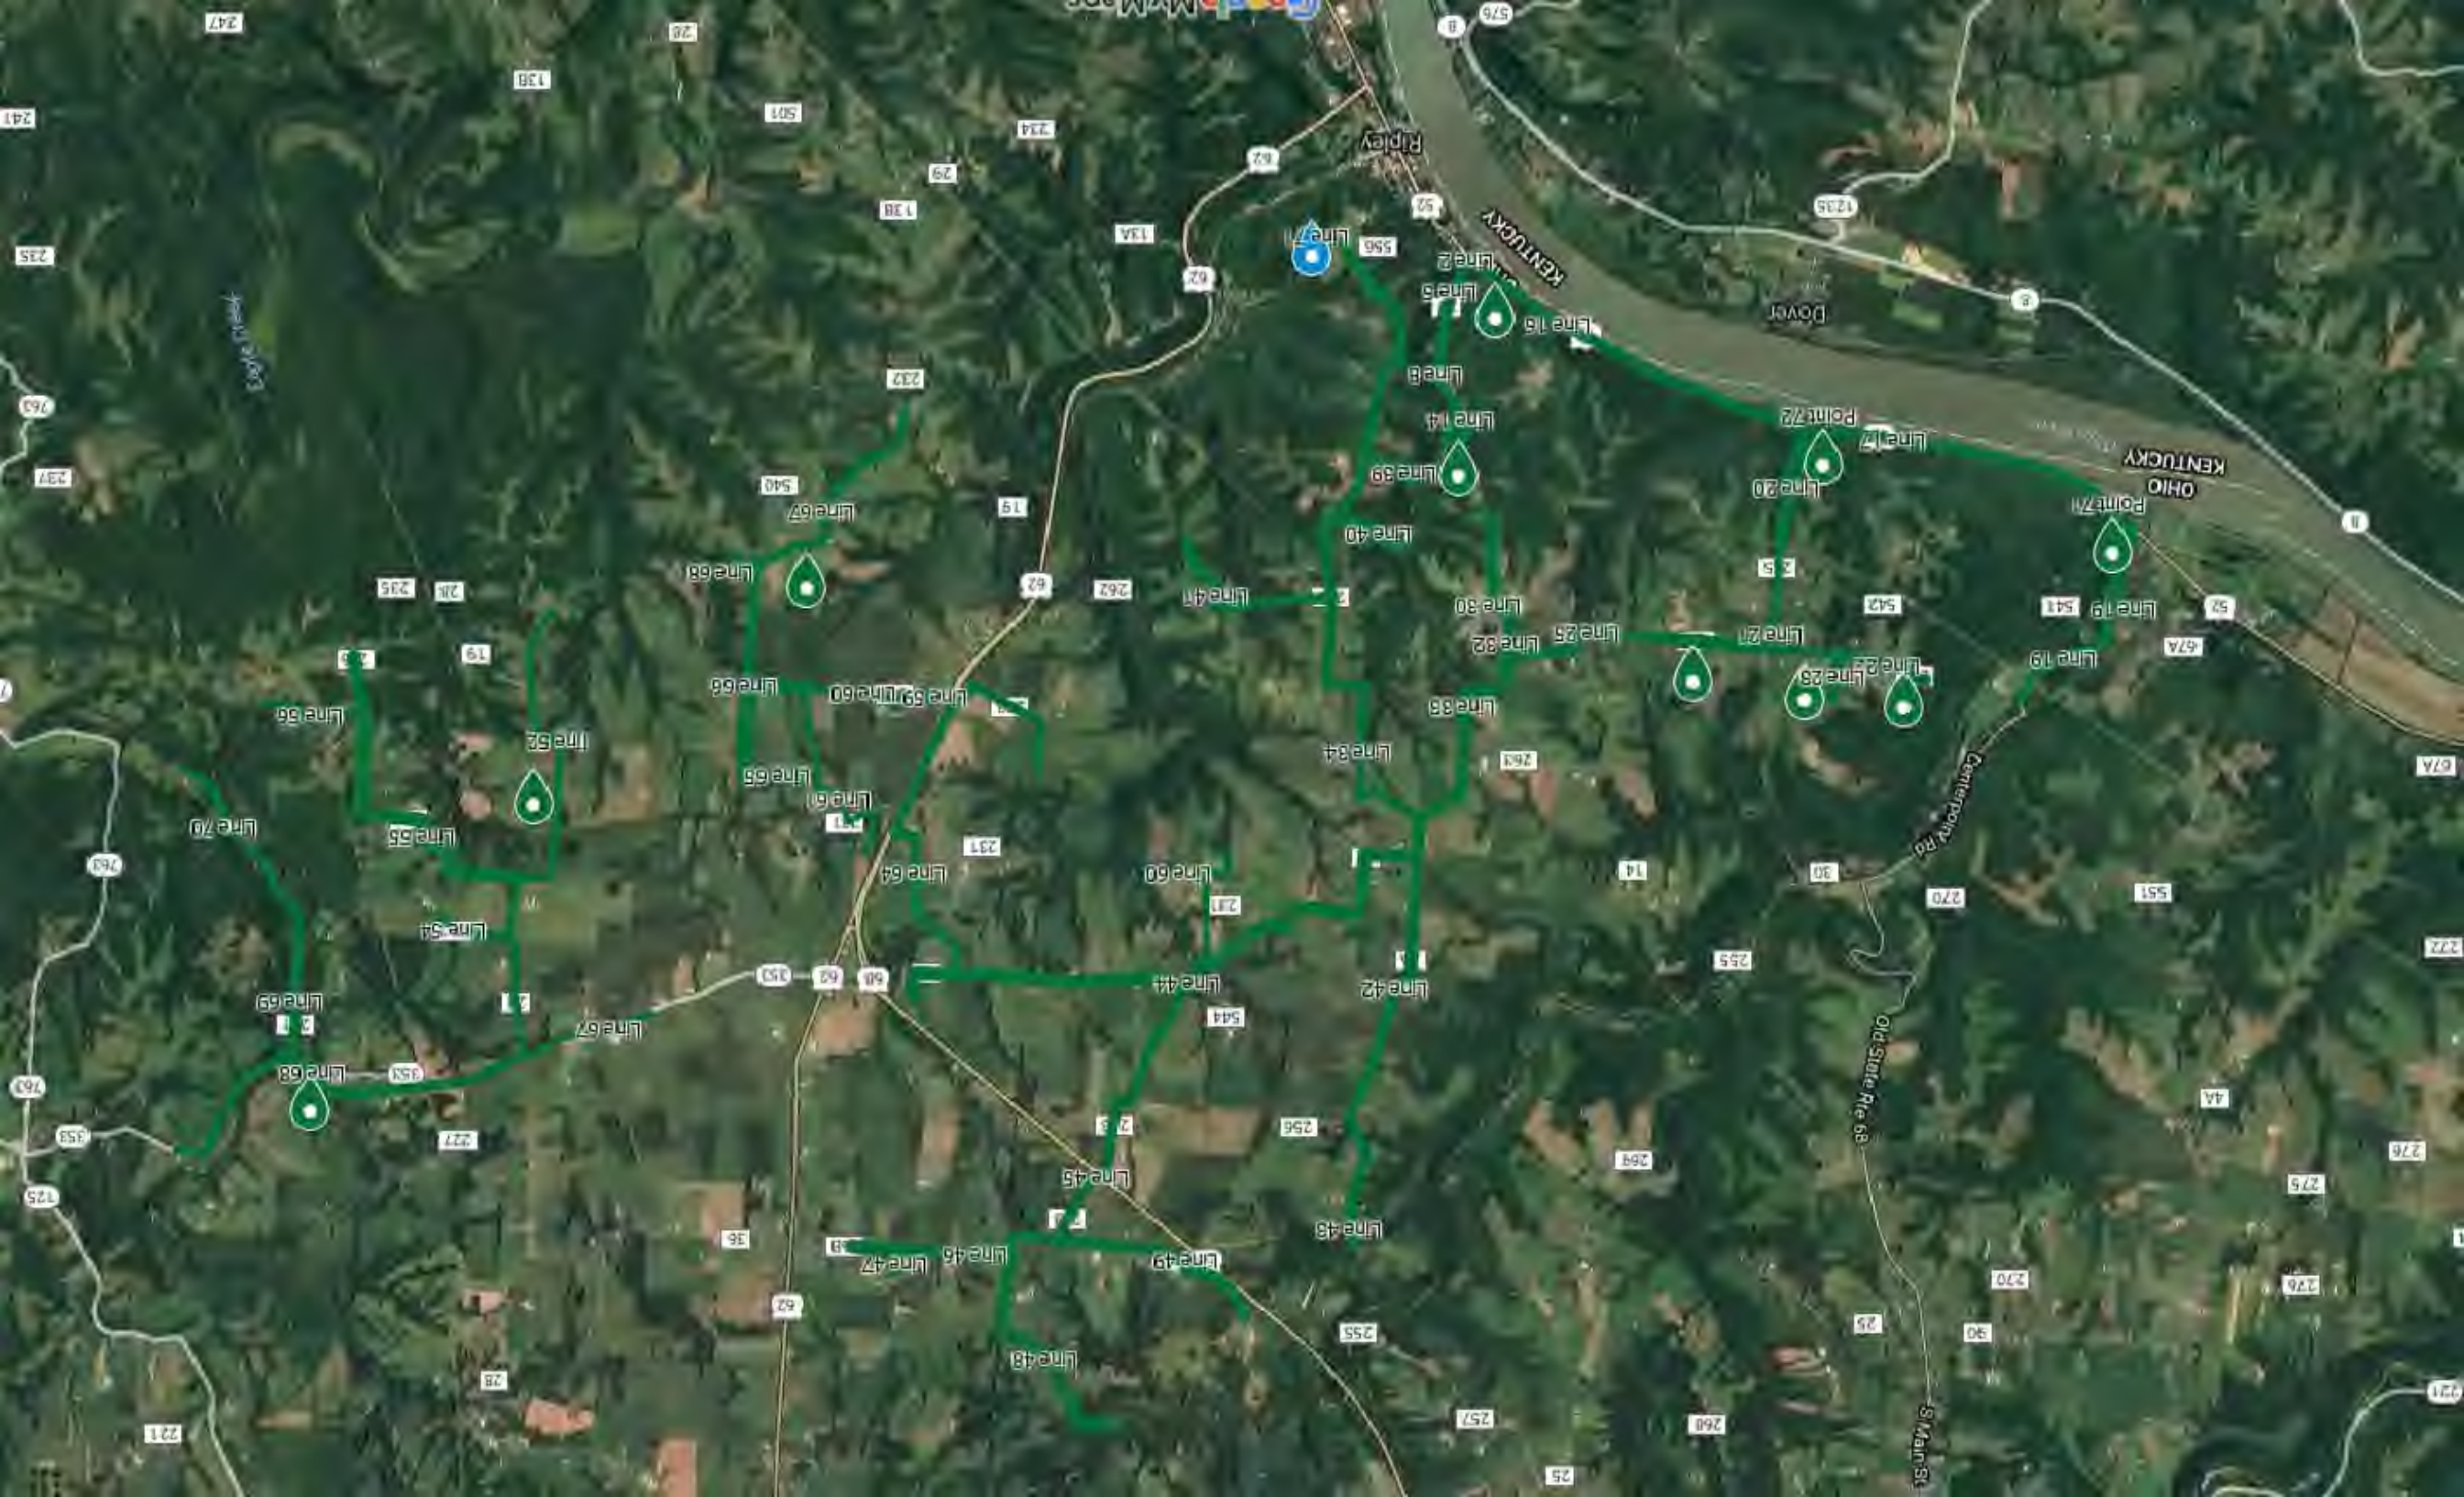

**VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS  
CLAIMING NO LEAD SERVICE LINES**

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
<p><b>This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):</b></p> <ul style="list-style-type: none"> <li><input type="checkbox"/> Historical permit records and/or local ordinances</li> <li><input checked="" type="checkbox"/> Distribution maintenance records (i.e. meter replacement, waterline break repairs)</li> <li><input checked="" type="checkbox"/> Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)</li> <li><input type="checkbox"/> Service line material of all service lines is known (i.e. all service lines are known to be PVC)</li> </ul>

Mark Plymesser 3/9/2017  
Signature of Responsible Person Date

Mark Plymesser Person in Charge  
Printed Name and Title of Responsible Person

**PWS NAME:** Ripley Union Rural Water  
**PWS ID:** 801203  
OH \_\_\_\_\_  
**COUNTY:** Brown

Le **For Ohio EPA use only:**

Date Verification Rec'd:
--------------------------