

The Village of Christiansburg

The Village of Christiansburg installed the City water system in 1949 and finished it in 1950; therefore no lead service lines were installed in the system. All service lines from the water mains are K-Copper to the curb stop.

The majority of the structures in town were constructed in the 1890s into the early 1900s, with a few homes added since that time.


Because it is practically impossible to determine the lead content of an installed fixture, fitting or pipe, it should be assumed that the manufacture or installation date is the primary indicator of the lead content. Therefore, the characteristics of buildings and piping solder or fixtures would be buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

WATER SYSTEM POSSIBLE LEAD MAP

VILLAGE OF CHRISTIANSBURG (WITHIN VILLAGE LIMITS)

CHAMPAIGN COUNTY, OHIO

UPDATED FEBRUARY, 2017

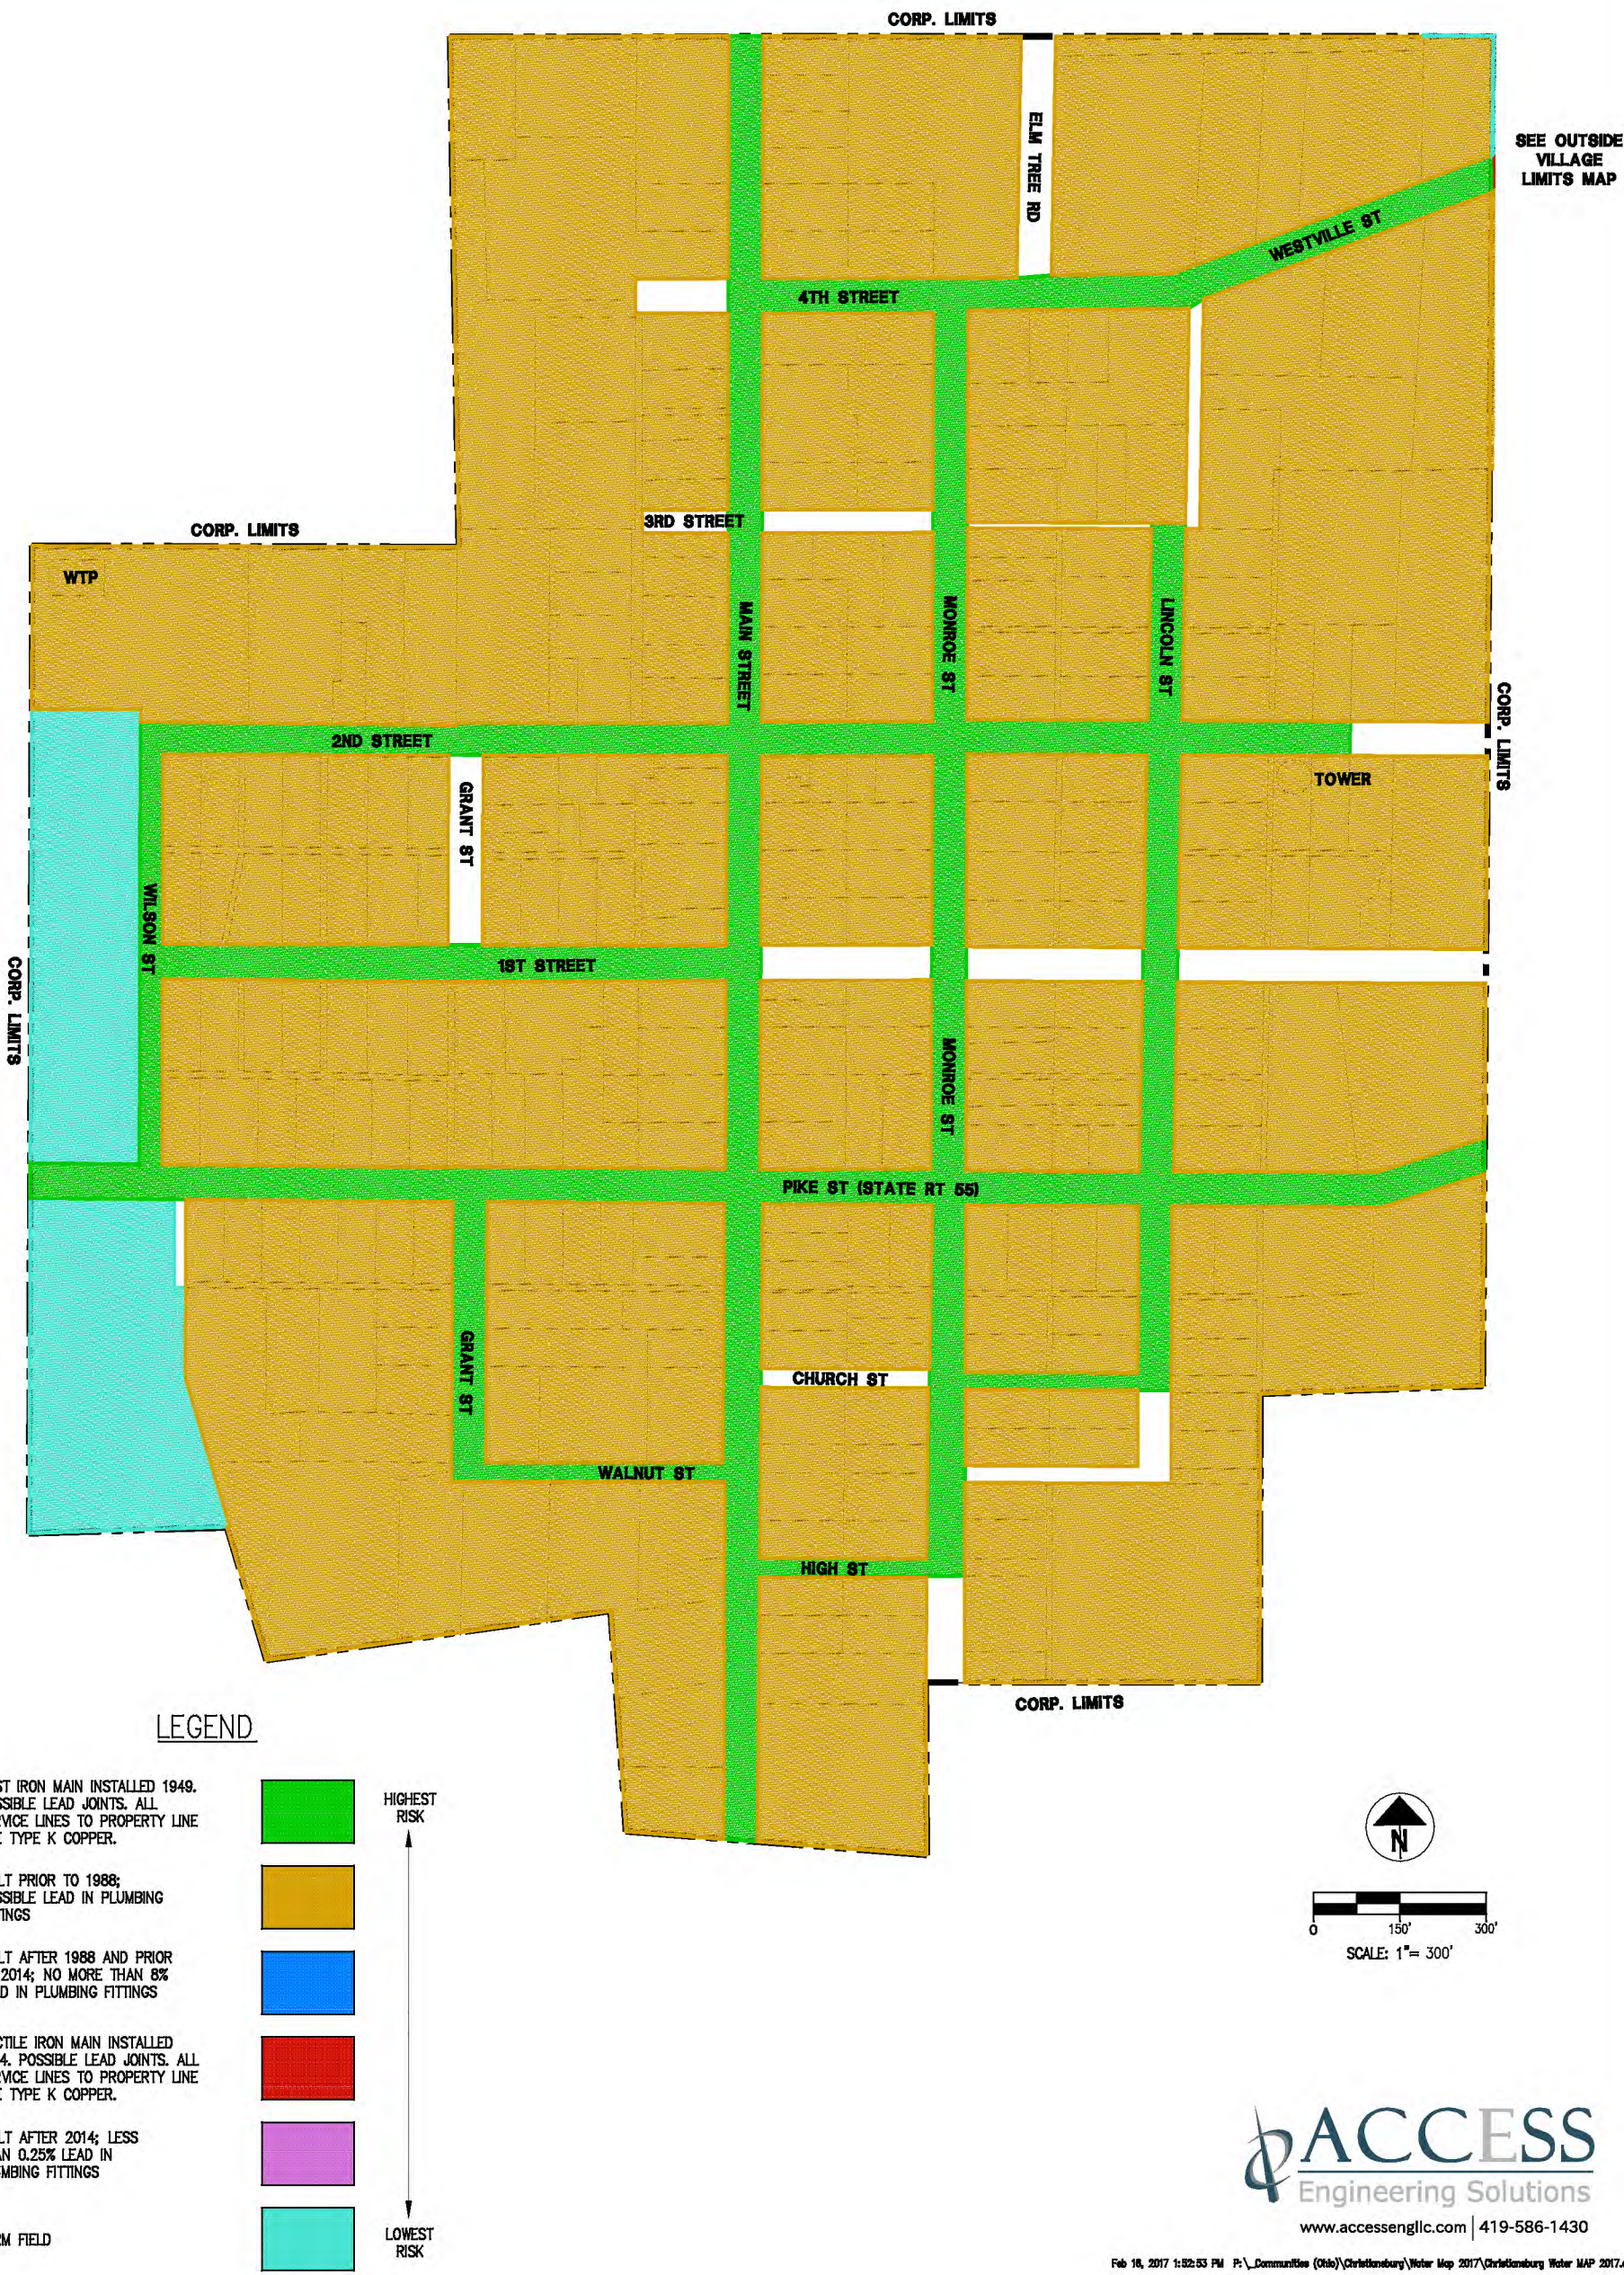

WATER SYSTEM POSSIBLE LEAD MAP

VILLAGE OF CHRISTIANSBURG (OUTSIDE VILLAGE LIMITS)

CHAMPAIGN COUNTY, OHIO

UPDATED FEBRUARY, 2017



LEGEND

CAST IRON MAIN INSTALLED 1949. POSSIBLE LEAD JOINTS. ALL SERVICE LINES TO PROPERTY LINE ARE TYPE K COPPER.


BUILT PRIOR TO 1988; POSSIBLE LEAD IN PLUMBING FITTINGS

BUILT AFTER 1988 AND PRIOR TO 2014; NO MORE THAN 8% LEAD IN PLUMBING FITTINGS

DUCTILE IRON MAIN INSTALLED 1964. POSSIBLE LEAD JOINTS. ALL SERVICE LINES TO PROPERTY LINE ARE TYPE K COPPER.

BUILT AFTER 2014; LESS THAN 0.25% LEAD IN PLUMBING FITTINGS

FARM FIELD



HIGHEST RISK



LOWEST RISK



0 150' 300'
SCALE: 1"= 300'

 ACCESS
Engineering Solutions

www.accessengllc.com | 419-586-1430

VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS CLAIMING NO LEAD SERVICE LINES

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION

This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):

- ☐ Historical permit records and/or local ordinances
- ☐ Distribution maintenance records (i.e. meter replacement, waterline break repairs)
- ☒ Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)
- ☒ Service line material of all service lines is known (i.e. all service lines are known to be PVC) *Copper*

Harvey W. Zimmerman *Mar. 7 2017*
Signature of Responsible Person Date

HARVEY W. ZIMMERMAN *JGL*
Printed Name and Title of Responsible Person

PWS NAME: *Village of Christiansburg*
PWS ID: OH *1100112*
COUNTY: *Champaign*

For Ohio EPA use only:

Date Verification Rec'd: _____