













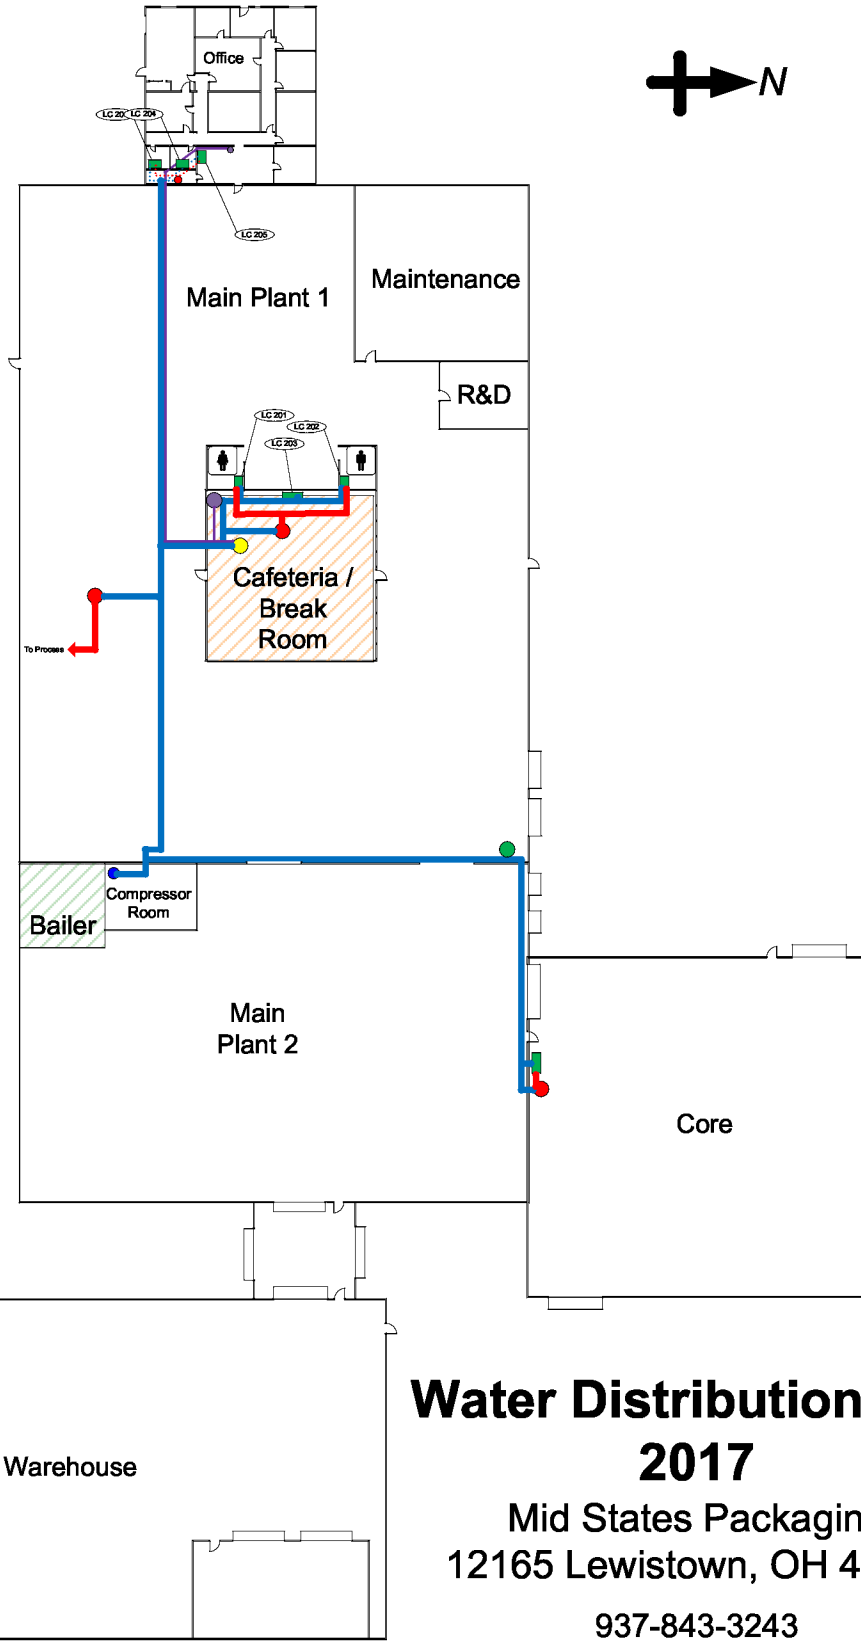




**Key**

- Main Water Well (pump) 
- Main Water Line plastic (Cold) 
- Main Water Line copper (Cold) 
- Main Water Line plastic (Hot) 
- Main Water Line copper (Hot) 
- RO Water Line plastic (drinking water) 
- RO Water Filter (drinking water) 
- Drinking Water Access 
- Hot Water Tank 
- Water Hose Bib 
- Sink (Test Point) 
- Woman's Restroom 
- Men's Restroom 
- EPA Water Sample Sites 




# Water Distribution Map 2017

Mid States Packaging  
12165 Lewistown, OH 43333  
937-843-3243

**Key**

- Main Water Well (pump)
- Main Water Line plastic (Cold)
- Main Water Line copper (Cold)
- Main Water Line plastic (Hot)
- Main Water Line copper (Hot)
- RO Water Line plastic (drinking water)

- RO Water Filter (drinking water)
- Drinking Water Access
- Hot Water Tank
- Water Hose Bib
- Sink (Test Point)
- Woman's Restroom ♀
- Men's Restroom ♂
- EPA Water Sample Sites LC XXX

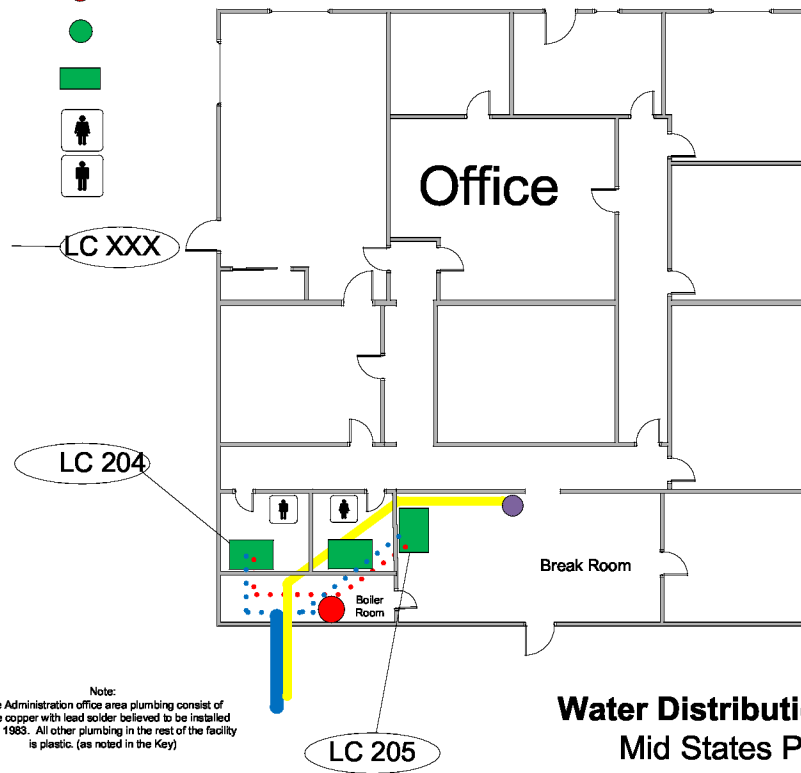


Note:  
The Administration office area plumbing consist of some copper with lead solder believed to be installed before 1983. All other plumbing in the rest of the facility is plastic. (as noted in the Key)

Note:  
All designated drinking water locations have no lead or copper lines

**Water Distribution Map 2017**  
**Mid States Packaging**  
 12165 Lewistown, OH 43333  
 937-843-3243

# Mid-States Packaging, Inc.

*Manufacturers of Packaging Products*



March 8, 2017

Re: Lead Mapping Revision Narrative  
PWS#4655759

Please include the following narrative with our Lead Mapping:

“Because it is practically impossible to determine the lead content of an installed fixture, fitting or pipe, it should be assumed that the manufacture or installation date is the primary indicator of the lead content. Therefore, the characteristics of building and piping solder or fixtures would be buildings built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded component may have occurred after the prohibitions became effective. The fixtures in all of our bathrooms were installed approximately 2007.”

Mid-States Packaging, Inc.  
12163 State Route 274  
Lewistown, Oh 43333  
937-843-3243