

RE: EDGERTON VILLAGE
Report
Drinking Water Program
Williams County
PWS ID: OH8600312



March 7, 2017

RECEIVED

MAR 07 2017

DDAGW - NWDO

Via Email: lara.schramm@epa.ohio.gov

Ms. Lara Schramm
Ohio EPA Northwest District Office
Division of Drinking and Ground Waters
347 North Dunbridge Road
Bowling Green, Ohio 43402

Re: HB-512 Lead and Copper Map Updates
Edgerton, Ohio
PWS# OH8600312
PDG Job No. 161000-00081

Dear Ms. Schramm:

Enclosed, please find the following items for your review and approval for compliance with HB-512 Lead and Copper Mapping.

1. An updated distribution map of the Village of Edgerton water distribution system.
2. Summary Report of the Village's distribution system and structures within the Village served by the water system.
3. List of Tier 1 Site and addresses that are currently used to test for lead and copper.

All information herein has been obtained from the Village of Edgerton, compiled by PDG, and reviewed by all parties. This information is to the best of our knowledge complete and accurate given the information and documentation available to all parties at this time.

If you have any comments or need additional information, please don't hesitate to contact this office or the Village of Edgerton.

POGGEMEYER DESIGN GROUP, INC.

Lee P. Rausch, PE
Sr. Project Manager


cc: Dawn Fitzcharles, Edgerton Village Administrator
Ohio Department of Health
Ohio Department of Job and Family Services

Enclosures: 24" x 36" Map
Summary Report
Tier 1 Sites

Legend

- Sample Sites
- Waterlines

- Pre - 1986 Buildings
- 1986 - 1998
- 1998 - 2011
- 2011 - Present

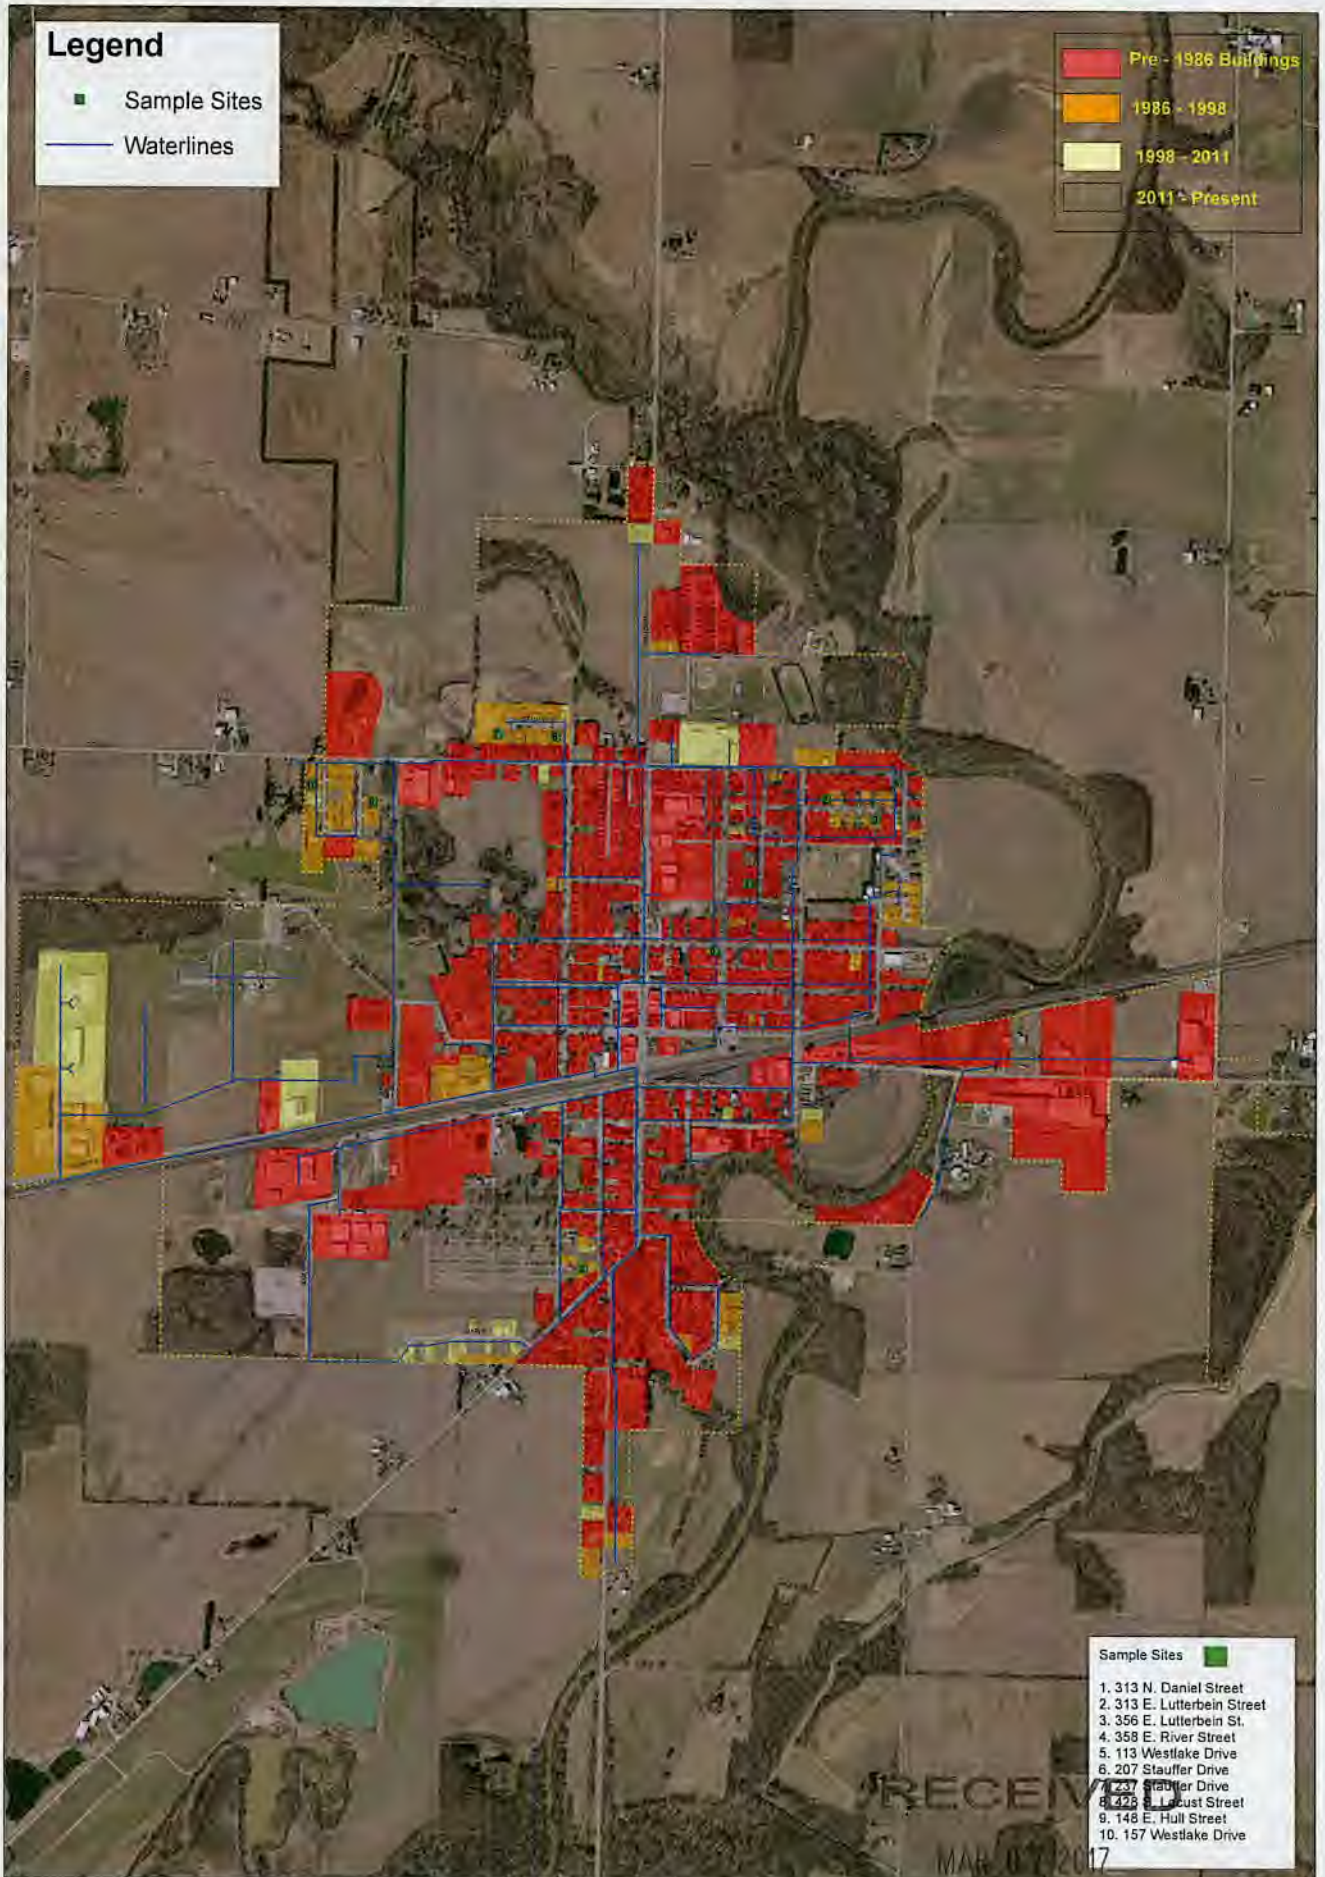

- Sample Sites**
1. 313 N. Daniel Street
 2. 313 E. Lutterbein Street
 3. 356 E. Lutterbein St.
 4. 358 E. River Street
 5. 113 Westlake Drive
 6. 207 Stauffer Drive
 7. 237 Stauffer Drive
 8. 228 E. Locust Street
 9. 148 E. Hull Street
 10. 157 Westlake Drive

0 500 1,000 2,000 Feet



*Disclaimer: Building Age Inferred from data provided by the City.

Village of Edgerton Distribution System
Lead & Copper Mapping HB - 512
PWS # OH8600312

DDAGW - NWDO

Document Path: S:\16\1000\0018\16Edgerton Copper and Lead CU.mxd



RECEIVED

MAR 07 2017

DDAGW - NWDO

Village of Edgerton, Ohio

Williams County

PWS# OH8600312

NARRATIVE for 2017 LEAD MAPPING

Distribution System Mains: After review of the Village distribution system as-builts, mapping and various other records available to current Village personnel as well as past operational efforts revealing mainline construction materials, the Village doesn't believe to have mains containing molten leaded joints.

Service Line Material: No tap records exist for individual service lines detailing service line materials. It is believed that the majority of service lines in the Village are copper up to the public R/W. Where cast iron main lines are located, leaded "goosenecks" on the individual service lines may exist, however the location and presence of these is unknown.

Buildings served by PWS likely to contain lead solder, plumbing or fixtures: The map submitted details by parcel, homes and buildings built within the specified time frames. Those structures built within the timeframes determined to have the potential of lead solder, plumbing or fixtures beyond the service lateral are detailed based on structure age information obtained from the Williams County Auditor's office and local knowledge of the Village.

Description of areas of the PWSD where susceptible buildings are located: Buildings that may or may not have lead solder, fixtures or plumbing are located in most of the service area of the Village.

History of Lead Sampling: Review of historical data shows that the Village has been below the Action level for lead and copper sampling over the past several years.

Lead and Copper Sample Sites: A listing of Tier 1 sample sites, complete with addresses and contact information is attached.