

RE: AYERSVILLE WATER AND  
SEWER DISTRICT

Report

Drinking Water Program

Defiance County

PWS ID: OH2000903



# **AYERSVILLE WATER AND SEWER DISTRICT**

---

13961 Fruit Ridge Road  
Defiance, OH 43512

PH: 419-395-1733  
FAX: 419-395-2533  
WEBSITE: ayersvillewsd.com

## **BOARD**

---

**President, Mike Jacob**      **Vice President, Greg Schafer**      **Treasurer, Robert Cooper**      **Secretary, Ronda Phillips**  
**Members: John Ehlinger, John Miller, Janet Beardsley**

## **EMPLOYEES**

---

**District Manager, David Wright**      **Clerk, Gayle Decatur**      **Field Operators, James Kuhlman and Mark Manon**

**RECEIVED**

**MAR 07 2017**

**DDAGW - NWDO**

March 7, 2017

To Whom It May Concern,

Ayersville is a small rural community just southeast of Defiance, Ohio. Ayersville receives its water from the City of Defiance and distributes to approximately 617 customers, Ayersville School being our largest customer. The majority of our customers are residential with a couple of very small businesses. Most of the homes and other structures in the District, including Ayersville School, pre-date the 1967-68 creation of the Ayersville Water and Sewer District. To the best of my knowledge we have not issued any new taps to residents except for Ayersville School new construction since 2014. Again, to the best of my knowledge there are no lead lines servicing any customers in the District. The majority of our mains and services are plastic in nature except for a small section of 10" main which is believed to be asbestos lined concrete.

Service work that I have been personally involved in, being main and service repair, has shown evidence of all plastic, including service lines to homes. I have been informed by staff that all lead inventory has been removed from our stock prior to my employment meeting any guidelines put in place to address lead contamination. Past service records that I have examined do not show lead service installation or other components. I can't say for certain all properties serviced by the District have performed plumbing updates, and the potential may be there for solder and fittings containing lead in private residents plumbing.

Ayersville Water and Sewer District will continue to work through all OEPA requirements so that we can make certain the quality of potable water being distributed to our customers meets all adopted guidelines. If there is anything I or my staff can do to further aid in providing the information you need, please let us know.


Sincerely,  
David R. Wright

# AWSD Water District/Lead and Copper Mapping

Untitled layer

- 6" Water Main1
- 6" Water Main2
- 6" Water Main3
- 6" Water Main4
- 6" Water Main5
- 6" Water Main6
- 6" Water Main7
- 6" Water Main8
- 6" Water Main9
- 8" Water Main1
- 6" Water Main10
- 8" Water Main2
- 6" Water Main11
- 6" Water Main12
- 3" Water Main1
- 4" Water Main1
- 4" Water Main2
- 2" Water Main1
- 2" Water Main2
- 2" Water Main3
- 8" Water Main2
- 8" Water Main3
- 3" Water Main2
- 2" Water Main4
- 2" Water Main5
- 8" Water Main4
- 10" Water Main1
- 8" Water Main5
- 2" Water Main6
- 2" Water Main7
- 4" Water Main3
- 2" Water Main8
- 2" Water Main9
- 3" Water Main3
- 3" Water Main4
- 2" Water Main10
- 2" Water Main11
- 2" Water Main12
- 4" Water Main4
- 3" Water Main5
- 2" Water Main13
- 2" Water Main14
- 3" Water Main6

No Lead Services/AWSD Boundary

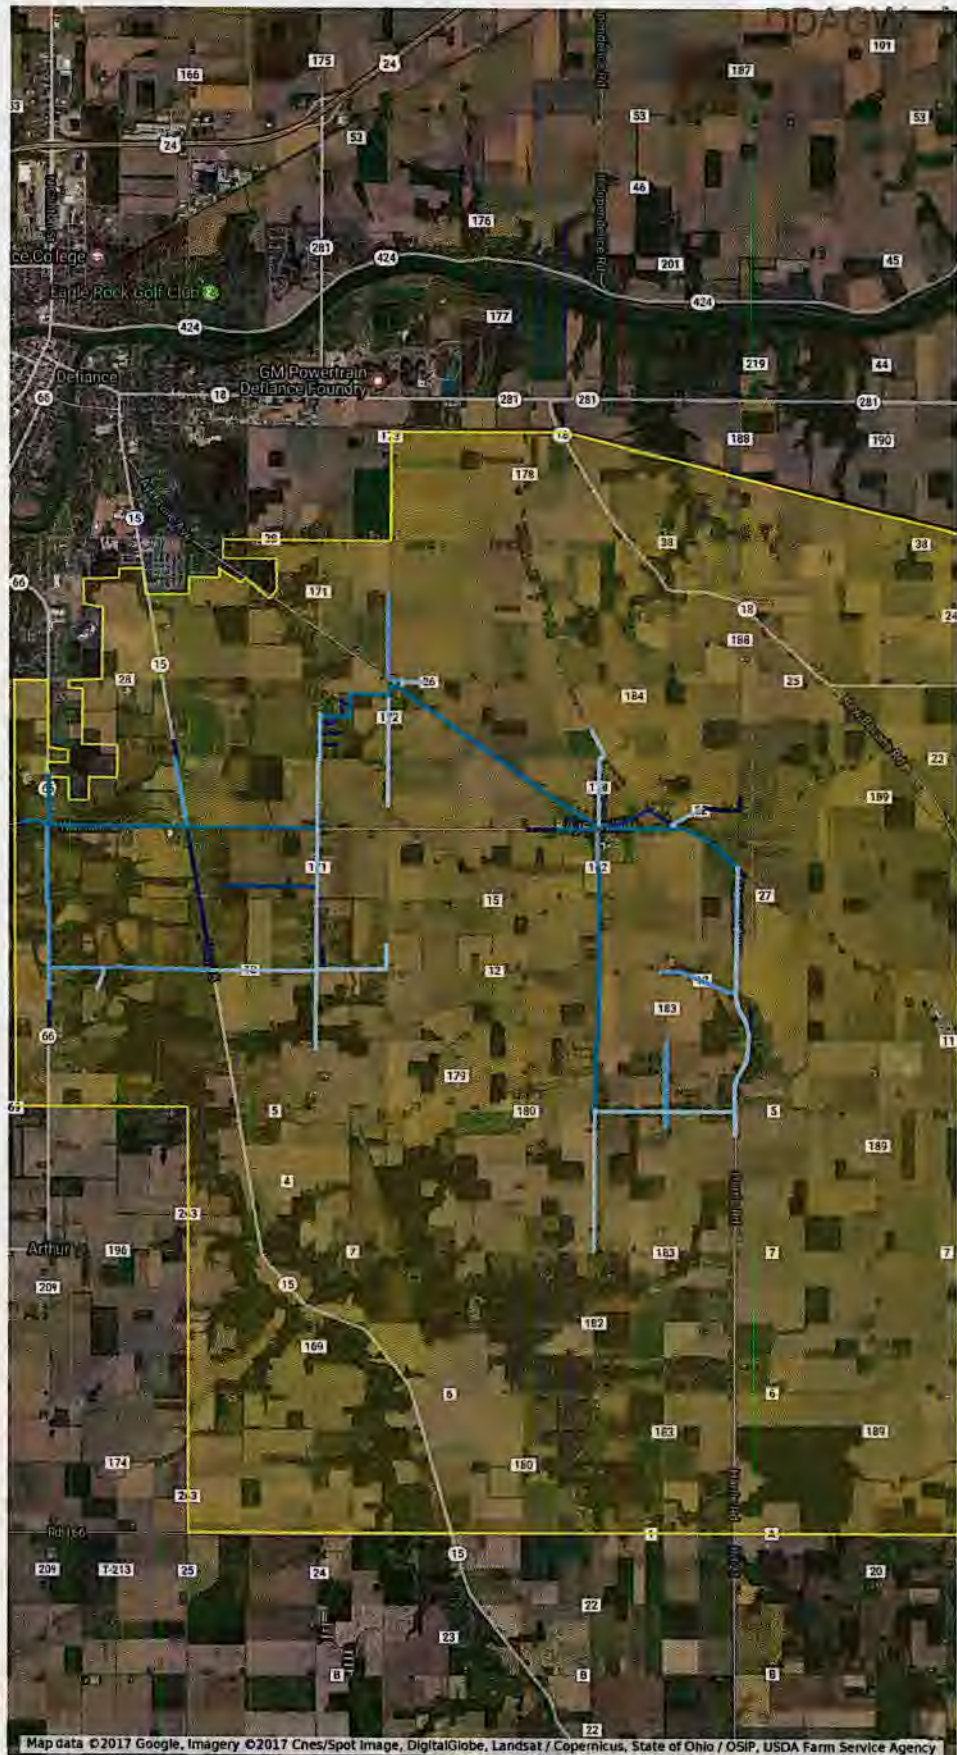

Buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to drinking water than materials manufactured after 1998. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.