


WOODROW CORPORATION
4300 RIVER RD.
SPRINGFIELD, OH

PLANT LAYOUT



- LC SAMPLING LOCATIONS**
- PVC WATER LINE
- HOT WATER COPPER LINES*
- COLD WATER COPPER LINES*
- *Copper pipes & fixtures installed prior to 1986 which may have potential to contain lead
- ★ WATER HEATER
- F FURNACE
- WATER PRESSURE TANK
- ⬠ FIRE EXTINGUISHER
- GAS METER SHUT-OFF
- ▲ ELECTRIC DISCONNECT
- P FLAMMABLE PROPANE GAS BOTTLES
- ◆ CAUSTIC SODA TANK
- FLAMMABLE LIQUIDS

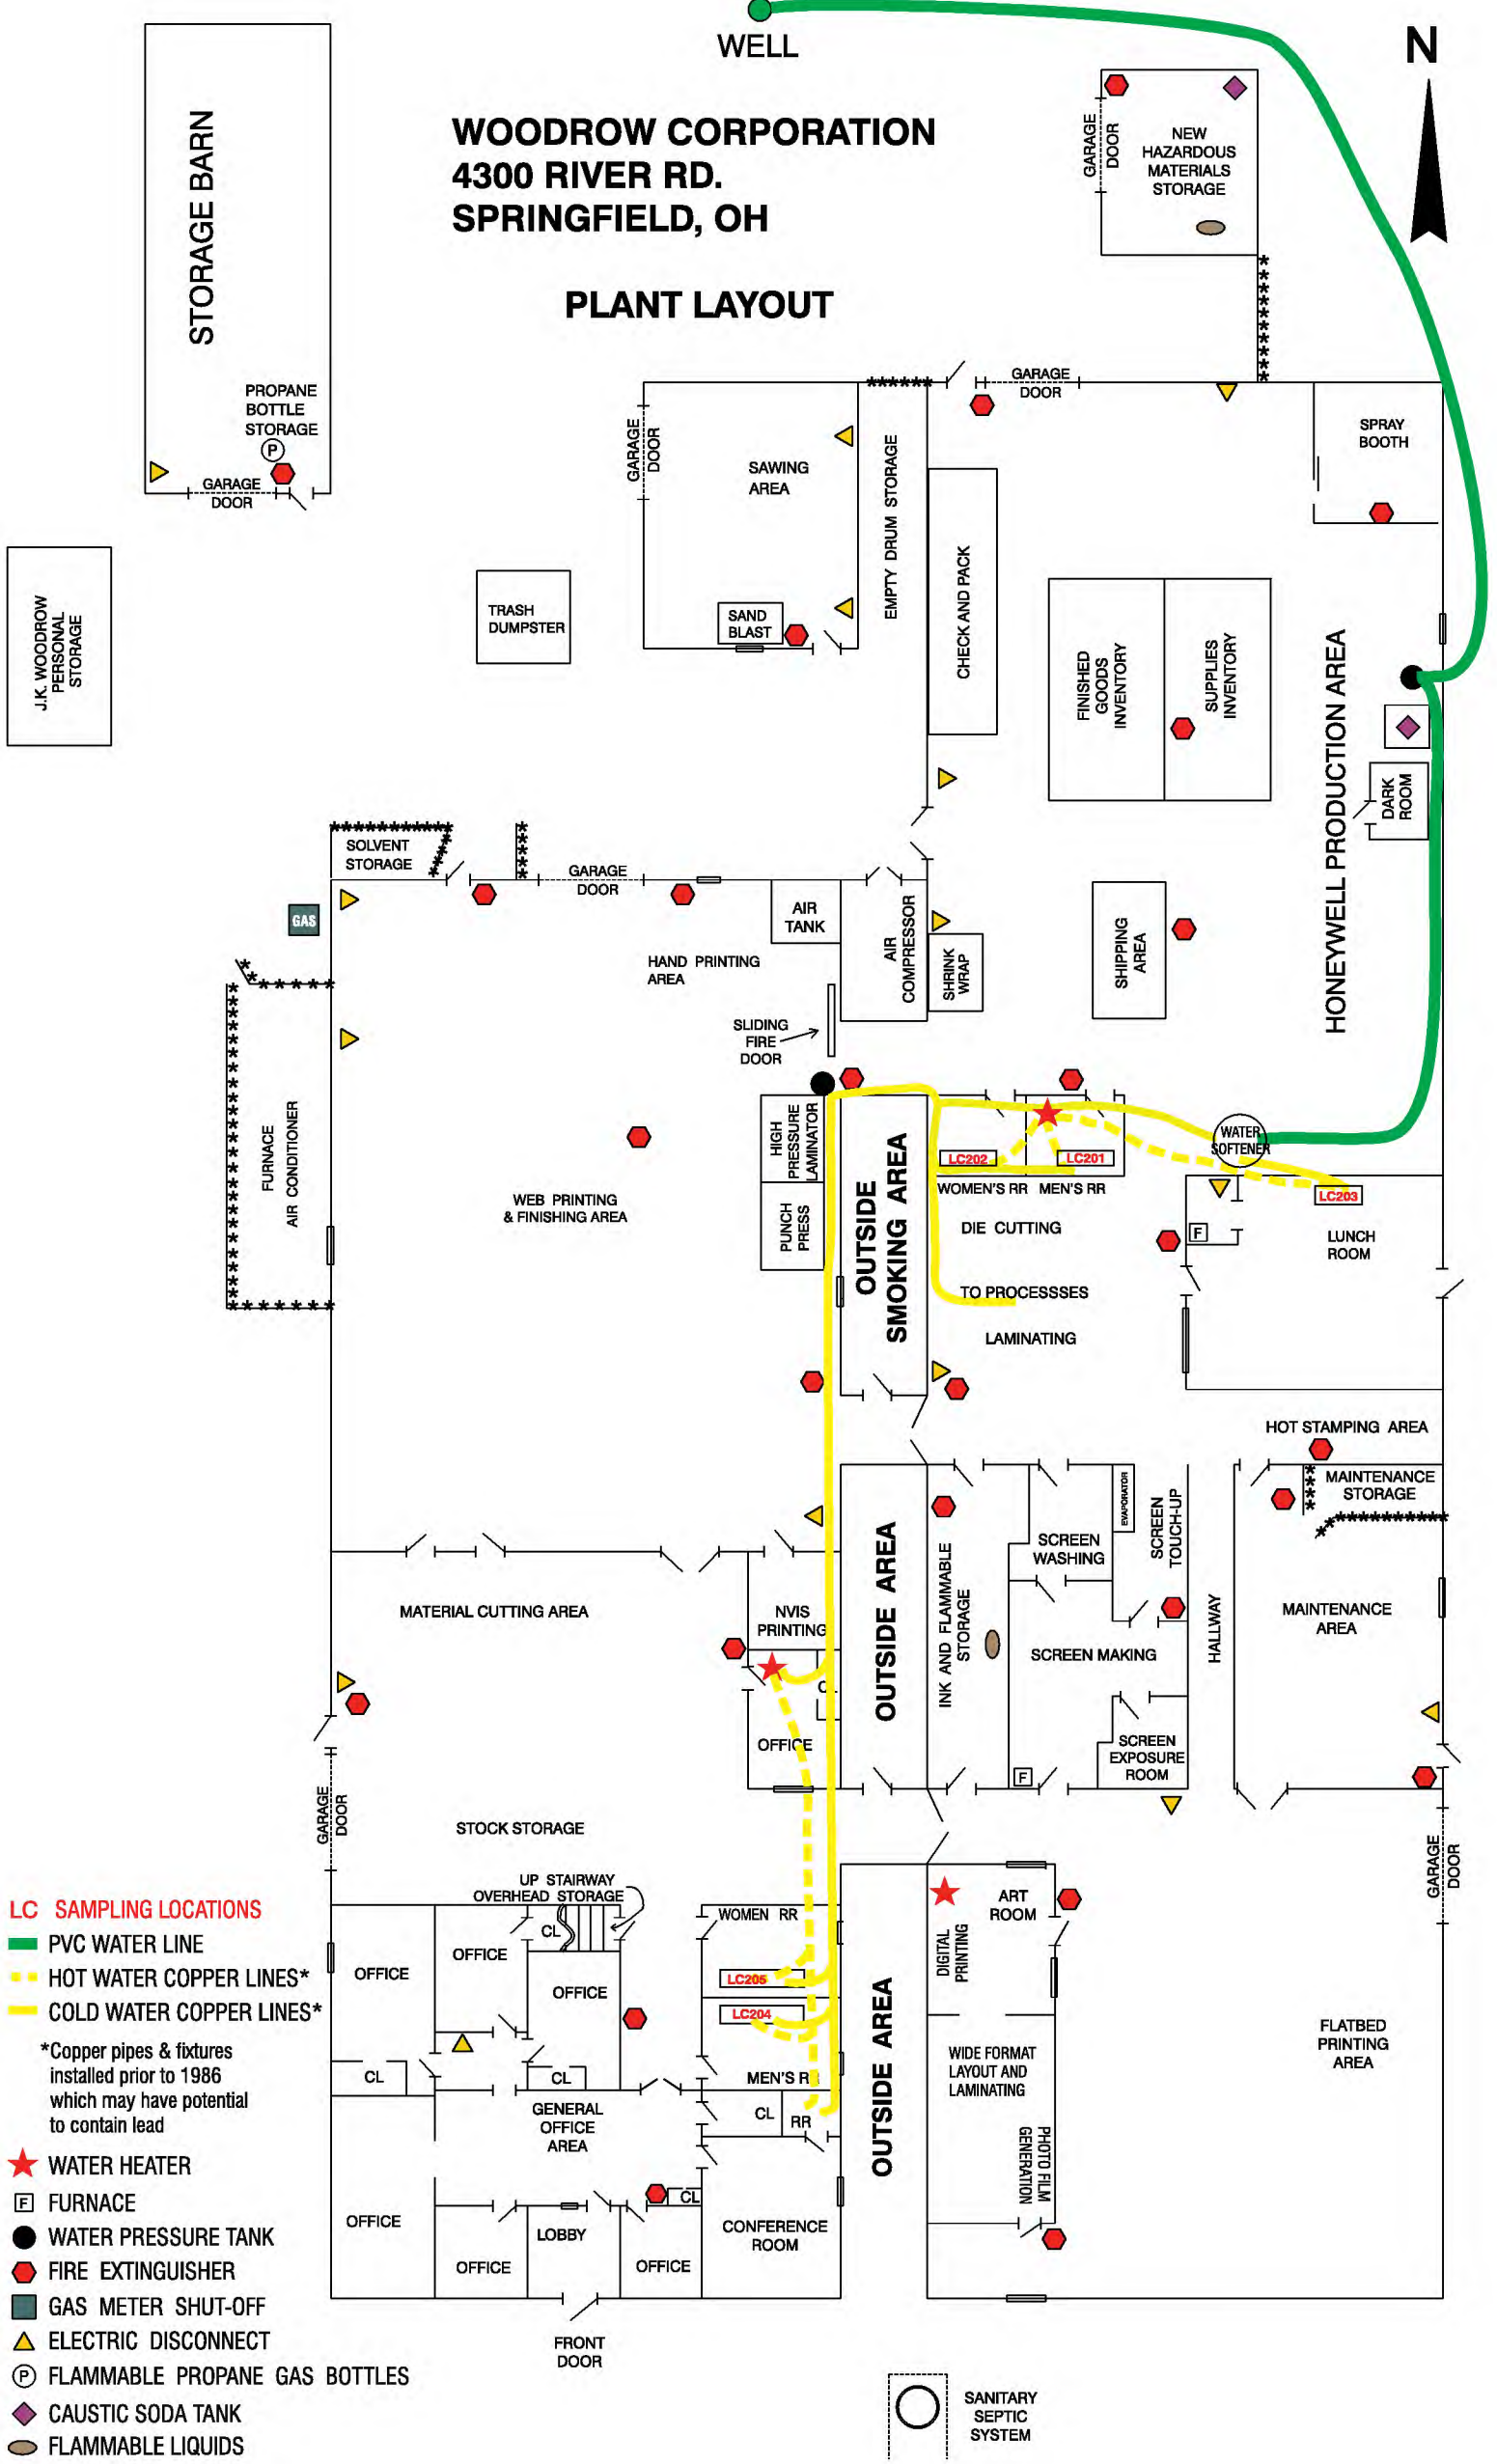