



City of Bellbrook
Water Department
29 N. West Street
Bellbrook, Ohio 45305
T (937) 848-8415
F (937) 848-5197
www.cityofbellbrook.org

— Distribution Boundary

Although the City of Bellbrook has not identified every water service line that supplies every structure within our distribution system, there are NO KNOWN lead service lines. This information is based on water main repairs, water service repairs, fire hydrant replacements, and water meter change outs.

Buildings built prior to 1988 or that use plumbing material or solder manufactured before 1988 may have materials with greater than 8% lead and are at a higher risk of contributing lead to drinking water than materials manufactured after 1988. In addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.2% lead by weight and have the lowest risk for contributing lead to drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.

Areas within our distribution system with structures built prior to 1988 are marked in YELLOW.

Areas within our distribution system not marked in YELLOW either have structures built after 1988 or no structures at all.


Areas within our distribution system with structures built after 2014 are shaded in GREEN.

Water mains within our system are made of cast/ductile iron, plastic, and transite (A/C).

— Cast/Ductile
— Plastic
— Transite (A/C)

Water services in our distribution system from the main tap up to customer owned services are made of copper. Customer owned services are primarily made of copper but some are made of plastic.

● Copper service from main to customer owned

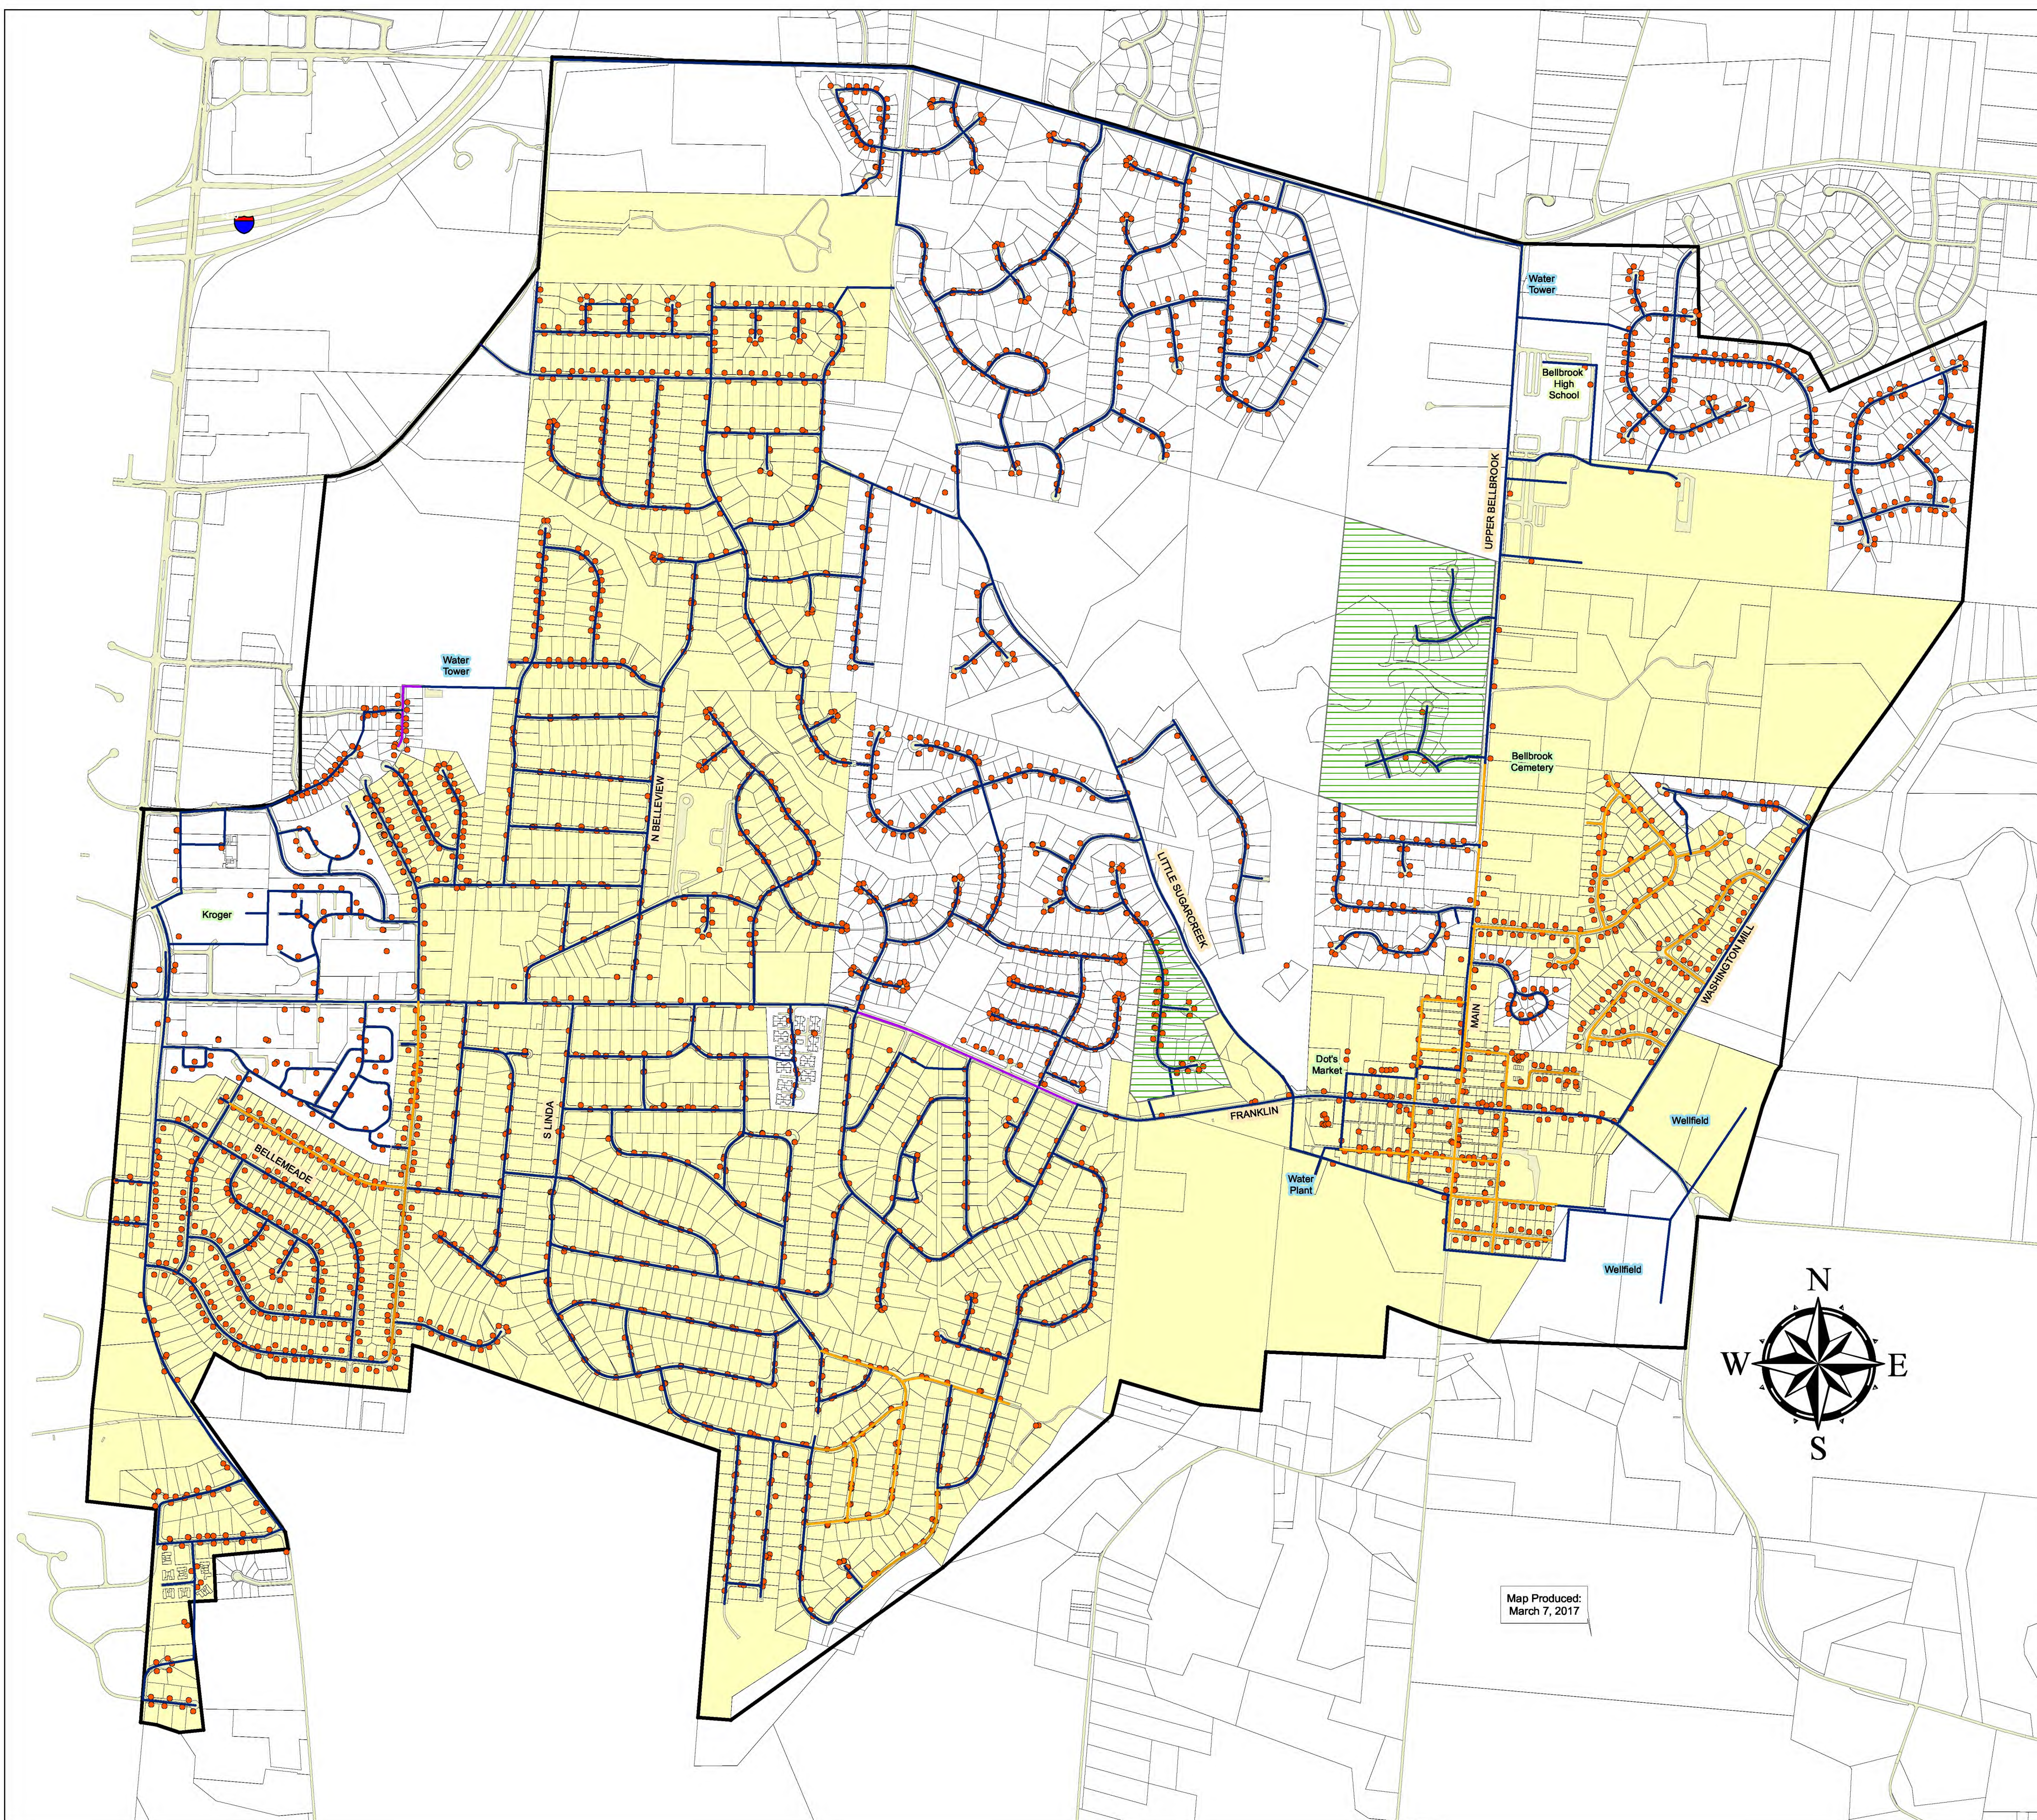


VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS CLAIMING NO LEAD SERVICE LINES

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
<p>This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):</p> <ul style="list-style-type: none"><input type="checkbox"/> Historical permit records and/or local ordinances<input checked="" type="checkbox"/> Distribution maintenance records (i.e. meter replacement, waterline break repairs)<input type="checkbox"/> Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)<input type="checkbox"/> Service line material of all service lines is known (i.e. all service lines are known to be PVC)



Signature of Responsible Person Date 3-6-17
Ryan Pasley Service Foreman

Printed Name and Title of Responsible Person

PWS NAME: Bellbrook Water Works
PWS ID: OH 2901112
COUNTY: Greene

For Ohio EPA use only:

Date Verification Rec'd: _____