

LEGEND

CORP. LIMITS

BUILDINGS CONSTRUCTED
2014-2017

BUILDINGS CONSTRUCTED
1998-2013

BUILDINGS CONSTRUCTED
BEFORE 1998

(SMPID) LEAD AND COPPER
SAMPLE SITES

WATER VALVE



WATER MAINS TYPE

CAST IRON

DUCTILE IRON

AC/TRANSITE

MUNICIPALITY OF WEST MILTON
MIAMI COUNTY, OHIO
WATER ATLAS

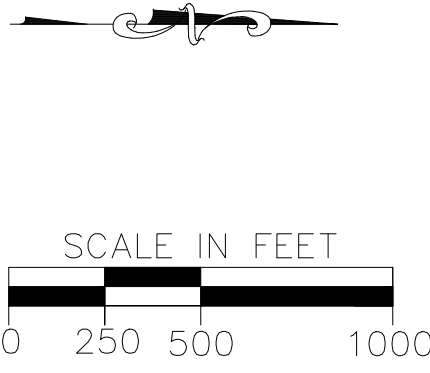

"BECAUSE IT IS PRACTICALLY IMPOSSIBLE TO DETERMINE THE LEAD CONTENT OF AN INSTALLED FIXTURE, FITTING OR PIPE, IT SHOULD BE ASSUMED THAT THE MANUFACTURE OR INSTALLATION DATE IS THE PRIMARY INDICATOR OF THE LEAD CONTENT. THEREFORE, THE CHARACTERISTICS OF BUILDINGS AND PIPING SOLDER OR FIXTURES WOULD BE BUILDINGS IN OHIO BUILT PRIOR TO 1998 OR THAT USE PLUMBING MATERIAL OR SOLDER MANUFACTURED BEFORE 1998 MAY HAVE MATERIALS WITH GREATER THAN 8% LEAD AND ARE AT A HIGHER RISK OF CONTRIBUTING LEAD TO THE DRINKING WATER THAN MATERIALS MANUFACTURED AFTER 1998. IN ADDITION, BUILDINGS BUILT AND PLUMBING MATERIALS MANUFACTURED AFTER 2014 WERE REQUIRED TO HAVE LESS THAN 0.25% LEAD BY WEIGHT AND HAVE THE LOWEST RISK FOR CONTRIBUTING LEAD TO THE DRINKING WATER. IT SHOULD BE NOTED HOWEVER THAT, ALTHOUGH PROHIBITED, SOME USE OF LEADED SOLDER OR LEADED COMPONENTS MAY HAVE OCCURRED AFTER THE PROHIBITIONS BECAME EFFECTIVE."

REVISIONS

DATE	DESCRIPTION	INITIAL
02/22/2017	SERVICE LINE ADDITION	EKK
03/07/2017	HATCHED THE AREAS FOR LEAD LINE	RMF

PREPARED BY:

ChoiceOne

Engineering

SIDNEY, OHIO 937.497.0200
LOVELAND, OHIO 513.239.8554
www.CHOICEONEENGINEERING.com


VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS CLAIMING NO LEAD SERVICE LINES

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION	
This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):	
<input checked="" type="checkbox"/>	Historical permit records and/or local ordinances
<input checked="" type="checkbox"/>	Distribution maintenance records (i.e. meter replacement, waterline break repairs)
<input checked="" type="checkbox"/>	Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)
<input type="checkbox"/>	Service line material of all service lines is known (i.e. all service lines are known to be PVC)



Signature of Responsible Person Date 2/27/17
Bennett W. Herron - Service Director
Printed Name and Title of Responsible Person

PWS NAME: Mun. of West Milton
PWS ID: OH 45383
COUNTY: Miami


For Ohio EPA use only:


Date Verification Rec'd: _____


MUNICIPALITY OF WEST MILTON
MIAMI COUNTY, OHIO

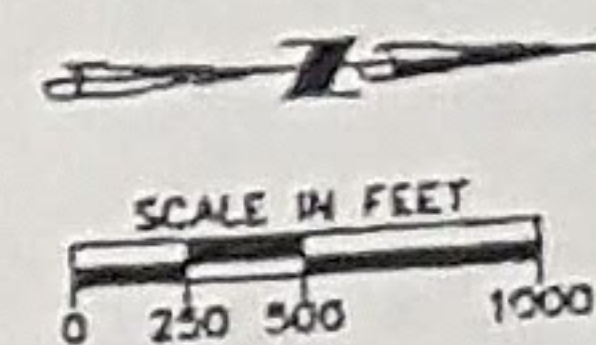

Lead and Copper Site Map

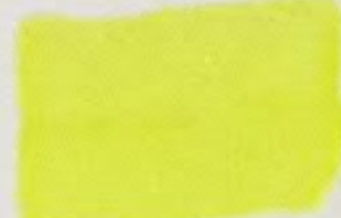 = Built Prior to 1988

 FLOOD PLAIN



Properties built prior to 1988 "may" contain lead Solder

ChoiceOne
Engineering

SIDNEY, OHIO 937.497.0200
LOVELAND, OHIO 513.238.8554
PORTLAND, INDIANA 260.766.2500
www.CHOICEONEENGINEERING.com