

RE: Ottawa County Regional Water District  
Report  
Lead Mapping  
Drinking Water Program  
Ottawa County  
PWS ID: OH6205011

**VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS  
CLAIMING NO LEAD SERVICE LINES**

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.


Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

**LEAD SERVICE LINE VERIFICATION**

**This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):**

- Historical permit records and/or local ordinances
- Distribution maintenance records (i.e. meter replacement, waterline break repairs)
- Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)
- Service line material of all service lines is known (i.e. all service lines are known to be PVC)

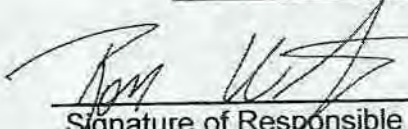  
\_\_\_\_\_  
Signature of Responsible Person

4-19-17  
\_\_\_\_\_  
Date

Ron Wetzel                      Superintendent  
\_\_\_\_\_  
Printed Name and Title of Responsible Person

**PWS NAME:** Ottawa County  
Regional  
**PWS ID:** OH6205011  
**COUNTY:** Ottawa

**For Ohio EPA use only:**





Date Verification Rec'd: \_\_\_\_\_

RECEIVED

APR 14 2017


DDAGW - NWDO

LEGEND


	= YEAR BUILT 1986 OR BEFORE	4,367 METERED ACCOUNTS	65%
	= YEAR BUILT 1986 - 1998	607 METERED ACCOUNTS	12%
	= YEAR BUILT 1999 - 2013	2,265 METERED ACCOUNTS	22%
	= YEAR BUILT 2014 TO 2016	47 METERED ACCOUNTS	01%
		<hr/>	
		6,679 TOTAL METERED ACCOUNTS	

 = EPA SMP ID#

NOTE = SHADED AREAS REPRESENT ACCOUNTS  
CONNECTED TO OTTAWA COUNTY REGIONAL WATER SYSTEM



5,000 2,500 0 5,000 Feet

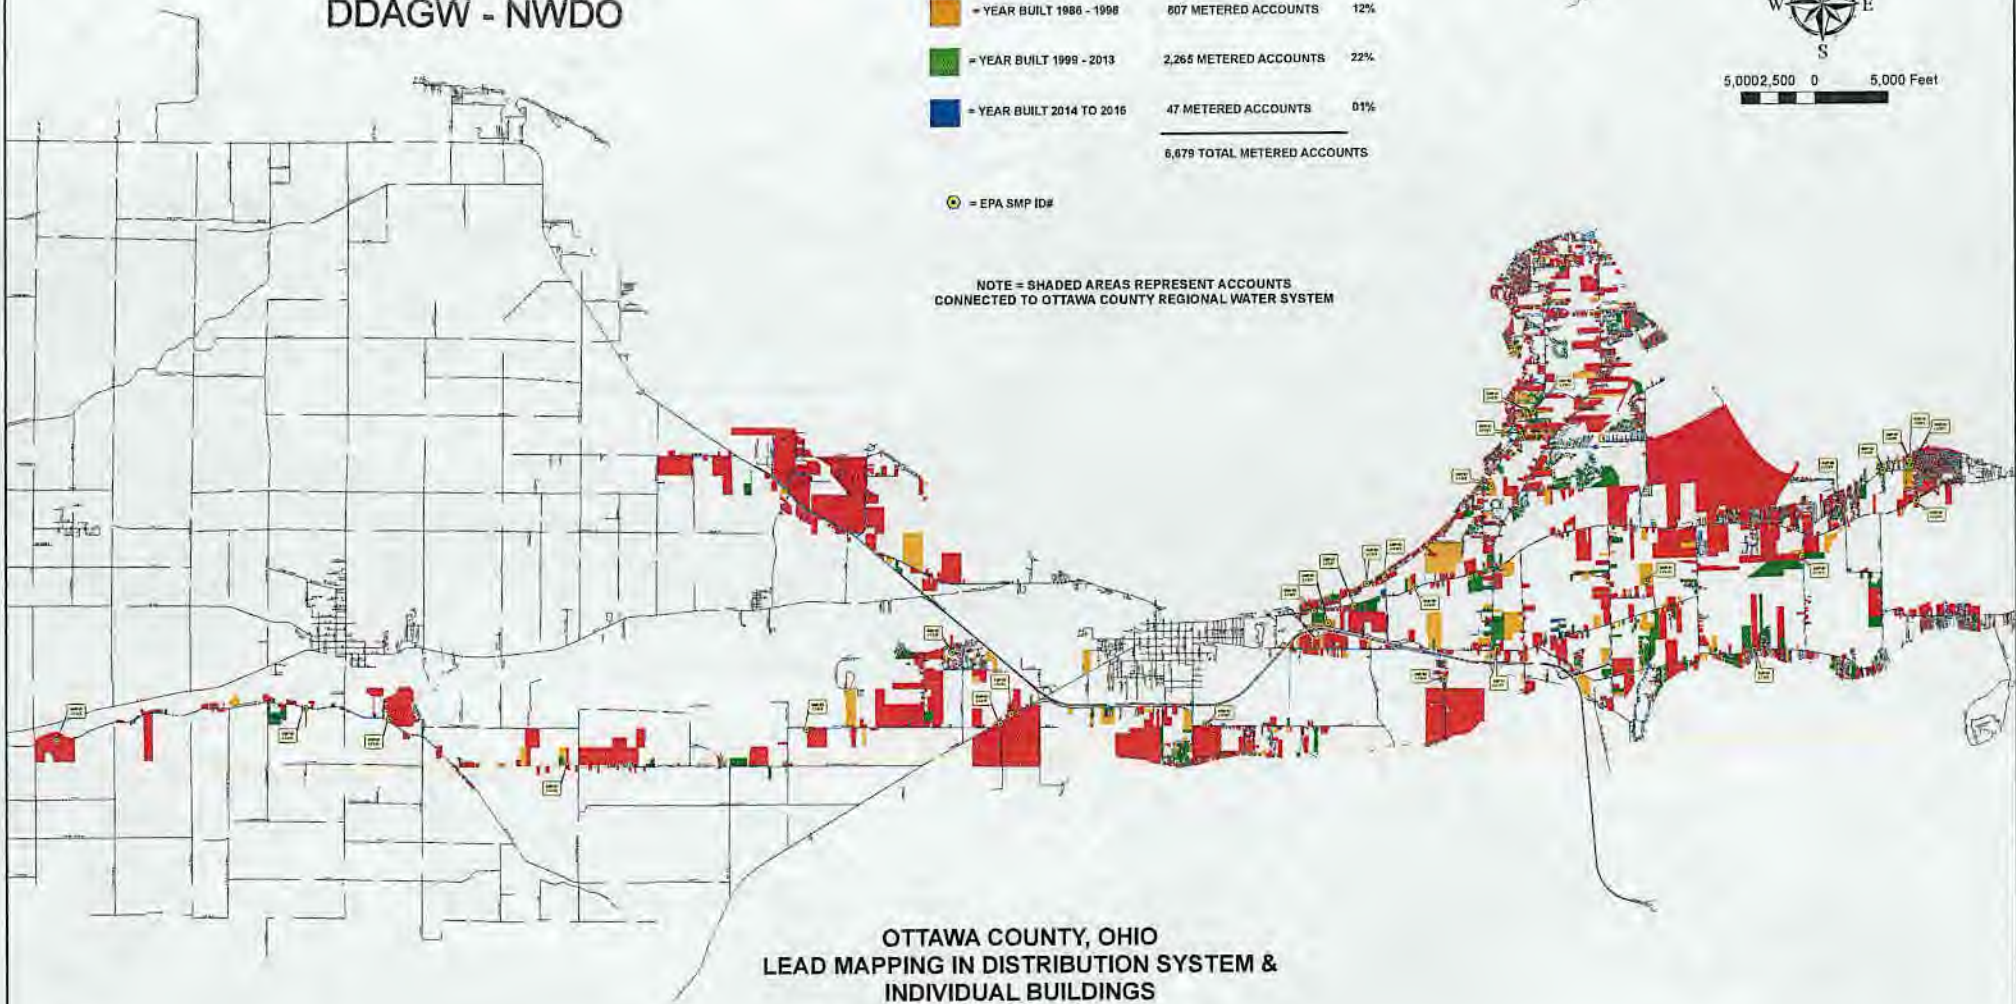

**OTTAWA COUNTY, OHIO  
LEAD MAPPING IN DISTRIBUTION SYSTEM &  
INDIVIDUAL BUILDINGS**

"Buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than material manufacture after 1998. In addition, building built and plumbing material manufactured after 2014 were require to have less than 0.25% lead by weight and have the lowest risk of contributing lead to the drinking water. It should be noted however that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective."

**OTTAWA COUNTY REGIONAL WATER SYSTEM BUILT IN 1999.  
THE PUBLIC WATER SERVICES CONTAIN NO LEAD PIPING OR LEAD SOLDER.**

**PWSID OH3200411      Village of McComb**

To the best of the owners' knowledge there are no known lead service lines in this system. Review of historical water permits and maintenance records of line repairs and replacements no lead services have been located. Water mains are primarily cast and ductile iron materials. Service connections are direct taps made of brass and copper piping. Customer service lines are made of copper, steel and HDPE materials.

**RECEIVED**  
MAR 06 2017  
DDAGW - NWDO

**VERIFICATION FORM FOR COMMUNITY PUBLIC WATER SYSTEMS  
CLAIMING NO LEAD SERVICE LINES**

The owner or operator of all community public water systems must identify and map areas of their distribution system that are known or are likely to contain lead service lines. Systems must submit a copy of the applicable map to the Ohio Department of Health and the Ohio Department of Job and Family Services. Systems must also submit a report to the director containing at least both of the following: (1) The applicable map with narrative, and (2) A list of sampling locations used to collect samples as required by Ohio Revised Code (ORC) Section 6109.121 and any rules adopted thereunder, including contact information for the owner and occupant of each sampling site.

Should a water system determine no lead service lines exist in their distribution system, they must provide information stating they reviewed, at the minimum, historical permit records and local ordinances, distribution maintenance records and information pertaining to installation dates or materials for all services lines. This information must be verified below.

I HEREBY CERTIFY THAT THE FOLLOWING METHOD(S) WERE USED TO DETERMINE NO LEAD SERVICE LINES EXIST IN THIS WATER SYSTEM'S DISTRIBUTION SYSTEM, AS REQUIRED BY ORC 6109.121(F):

LEAD SERVICE LINE VERIFICATION
<p>This PWS states they have no lead service lines and has reviewed the following information (select one or more of the following):</p> <ul style="list-style-type: none"><li><input checked="" type="checkbox"/> Historical permit records and/or local ordinances</li><li><input checked="" type="checkbox"/> Distribution maintenance records (i.e. meter replacement, waterline break repairs)</li><li><input type="checkbox"/> Information pertaining to installation dates for all service lines (i.e. after 1986 when lead services lines were banned)</li><li><input type="checkbox"/> Service line material of all service lines is known (i.e. all service lines are known to be PVC)</li></ul>

*Dan Wickard*      *Sept 3/1/17*  
Signature of Responsible Person      Date  
Dan Wickard Superintendent  
Printed Name and Title of Responsible Person

PWS NAME: Village of McComb  
PWS ID: OH3200411  
COUNTY: Hancock

<p><b>For Ohio EPA use only:</b></p> <p>Date Verification Rec'd: _____</p>
--






**RECEIVED**

MAR 06 2017

DDAGW - NWDO

# Potential Lead Services and Water Distribution Lines PWS OH3200411



-  Single Family Homes Built between 1982-1998
-  Non-Single Family Homes Built between 1982-1998
-  Single Family Homes Built 1982-Earlier
-  UNKNOWN
-  Distribution Lines

*Buildings in Ohio built prior to 1998 or that use plumbing material or solder manufactured before 1998 may have materials with greater than 8% lead and are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. In Addition, buildings built and plumbing materials manufactured after 2014 were required to have less than 0.25% lead by weight and have the lowest risk for contributing lead to the drinking water. It should be noted that, although prohibited, some use of leaded solder or leaded components may have occurred after the prohibitions became effective.*

