

# City of Canfield, Ohio

PWS ID #: OH5000503




## Lead Risk by Construction Date

- Construction Date Unknown
- Area containing predominantly structures built before 1998\*
- Area containing predominantly structures built between 1998 and 2013\*
- Original Water System Boundary circa 1935

\*The year designations are based on the presumed use of lead solders or plumbing equipment during construction. It is assumed that structures built prior to 1998 have a higher risk due to a higher allowable lead content within those materials; while structures built after 1998 have a lower or moderate risk due to the enactment of regulations reducing allowable lead contents within plumbing materials. Structures built after 2014 have the lowest risk for lead containing materials.

Based on the research of records and interviews with the City of Canfield personnel, it can be stated with a high degree of certainty that no lead service lines exist within the City of Canfield distribution system. If lead service lines exist, it is likely that they will be associated with buildings that are part of the original water system boundary.

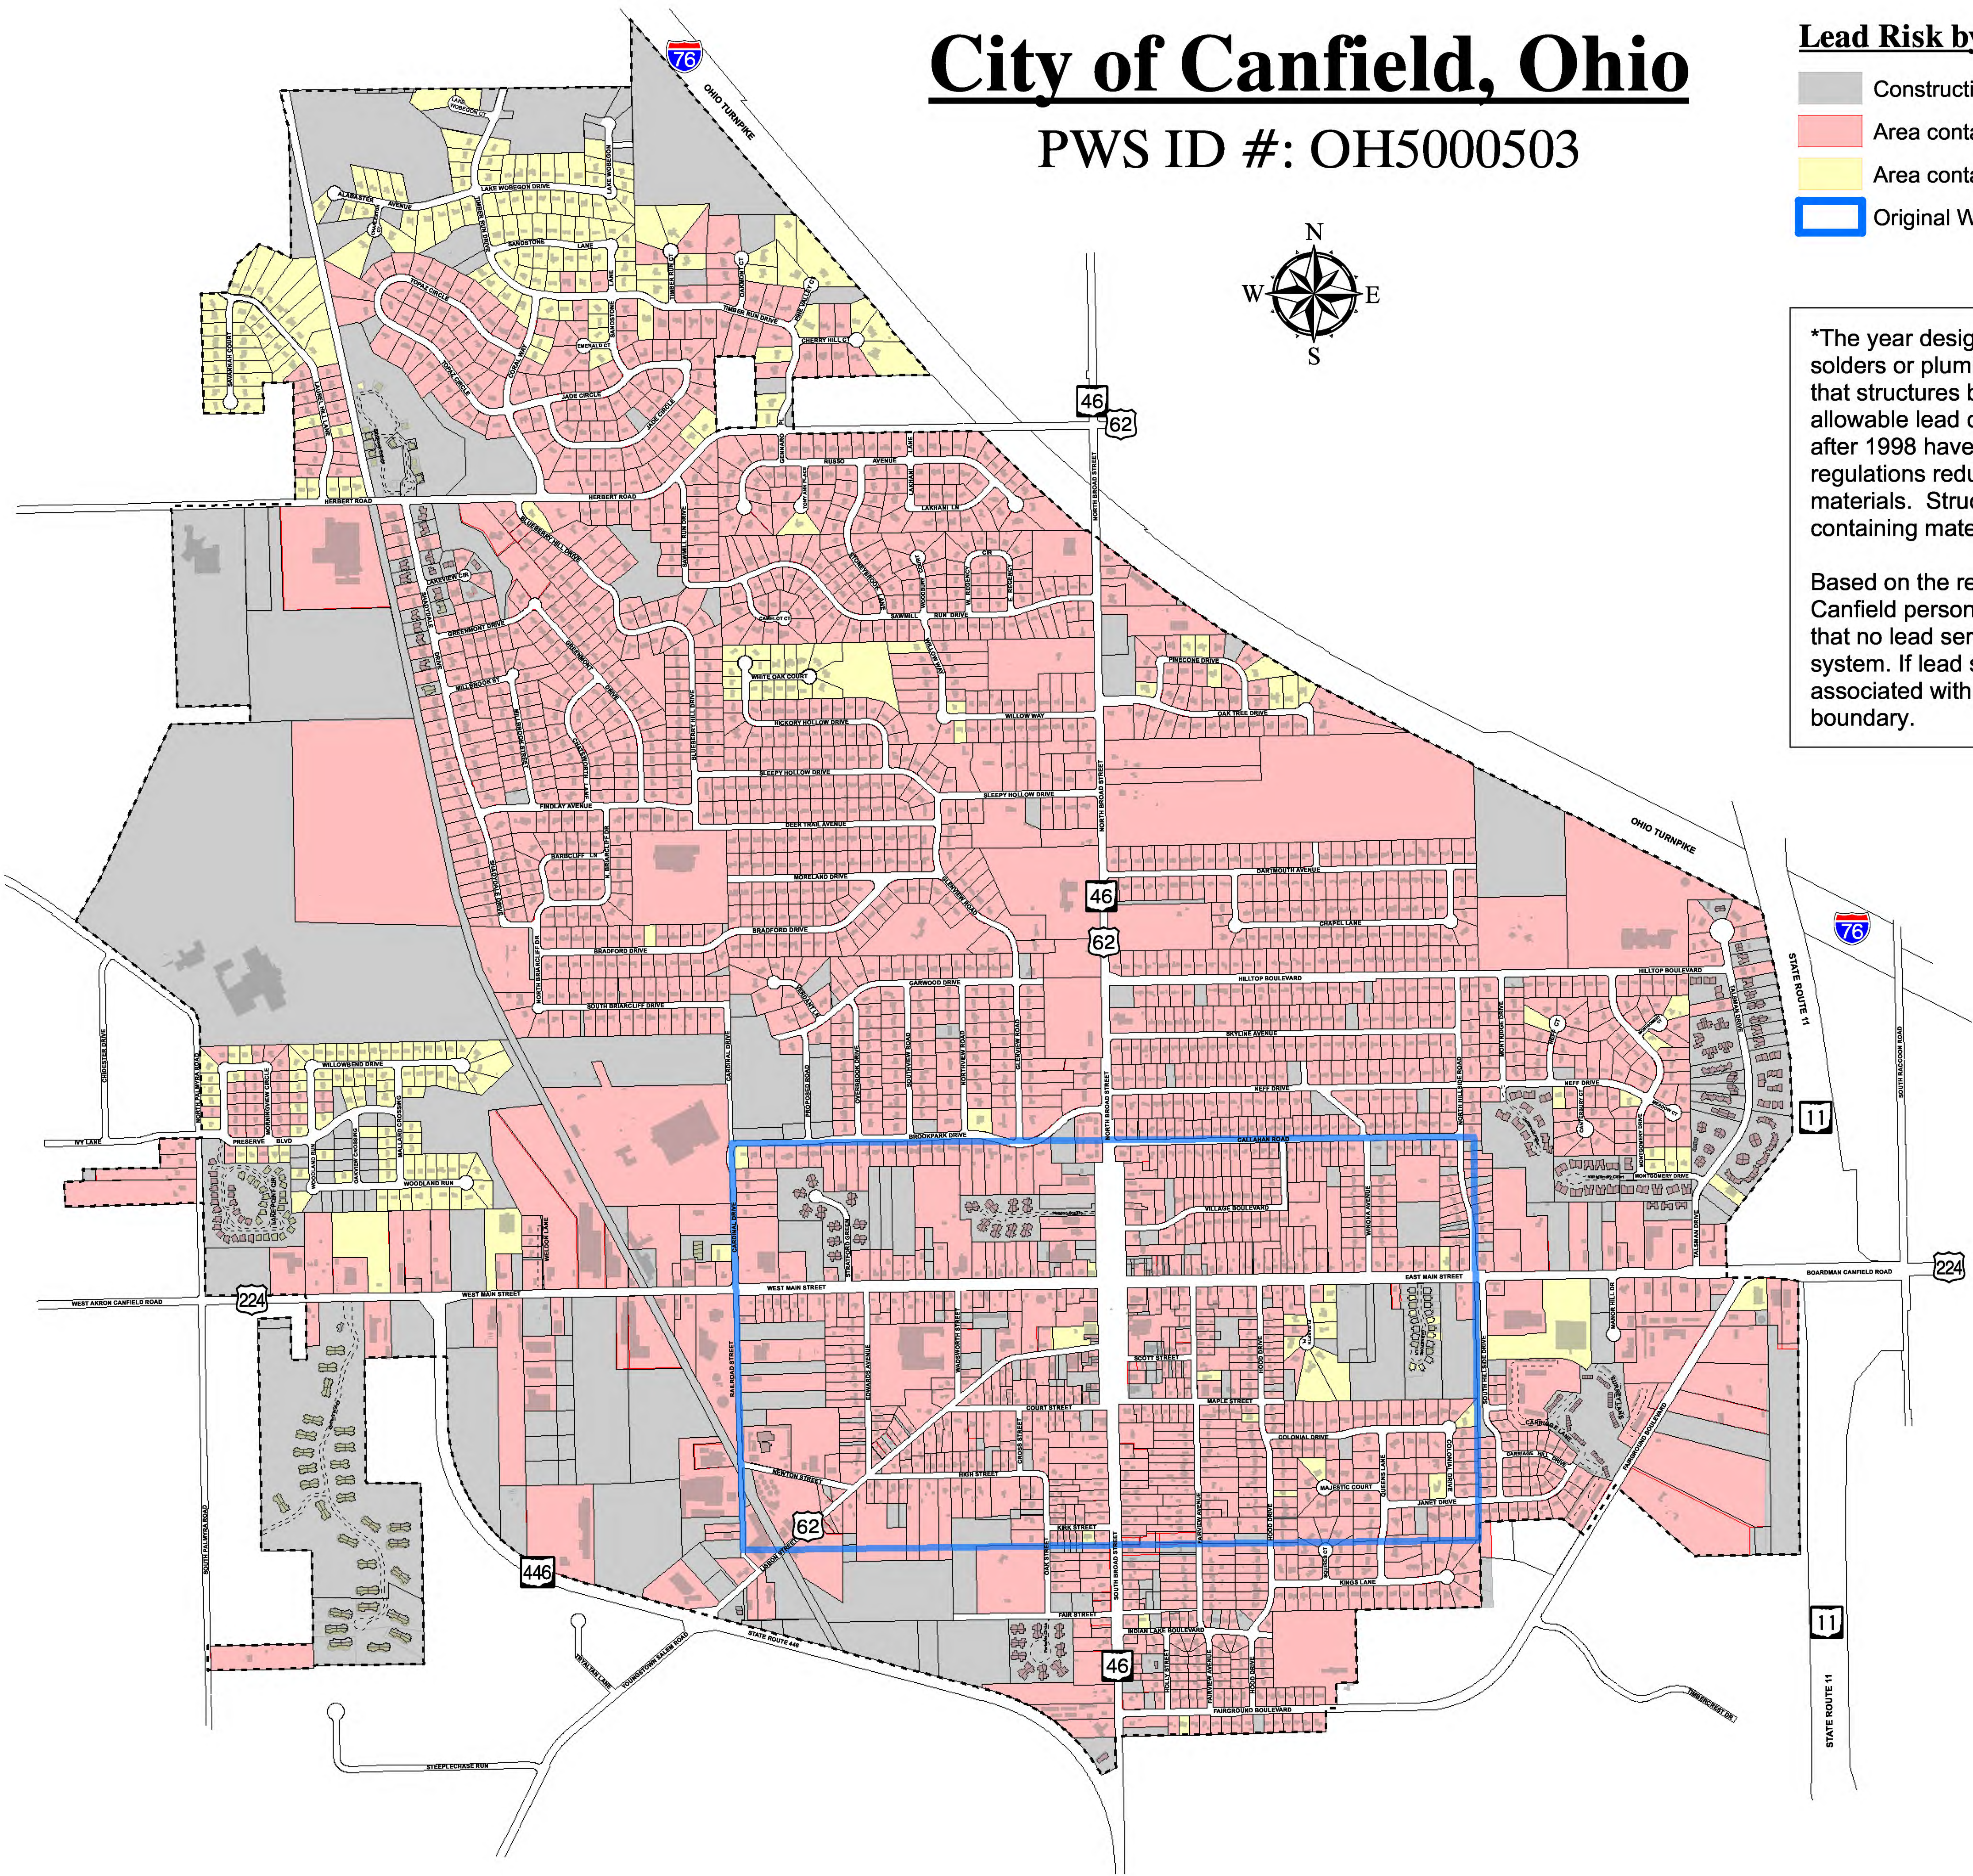

March 2017

