


Lead Mapping and Sampling Plan
 PWS ID#: OH2958715
 Wright Field Child Development
 Center 3155 Ascani Street
 WPAFB, OH 45433
 For Official Use Only

N

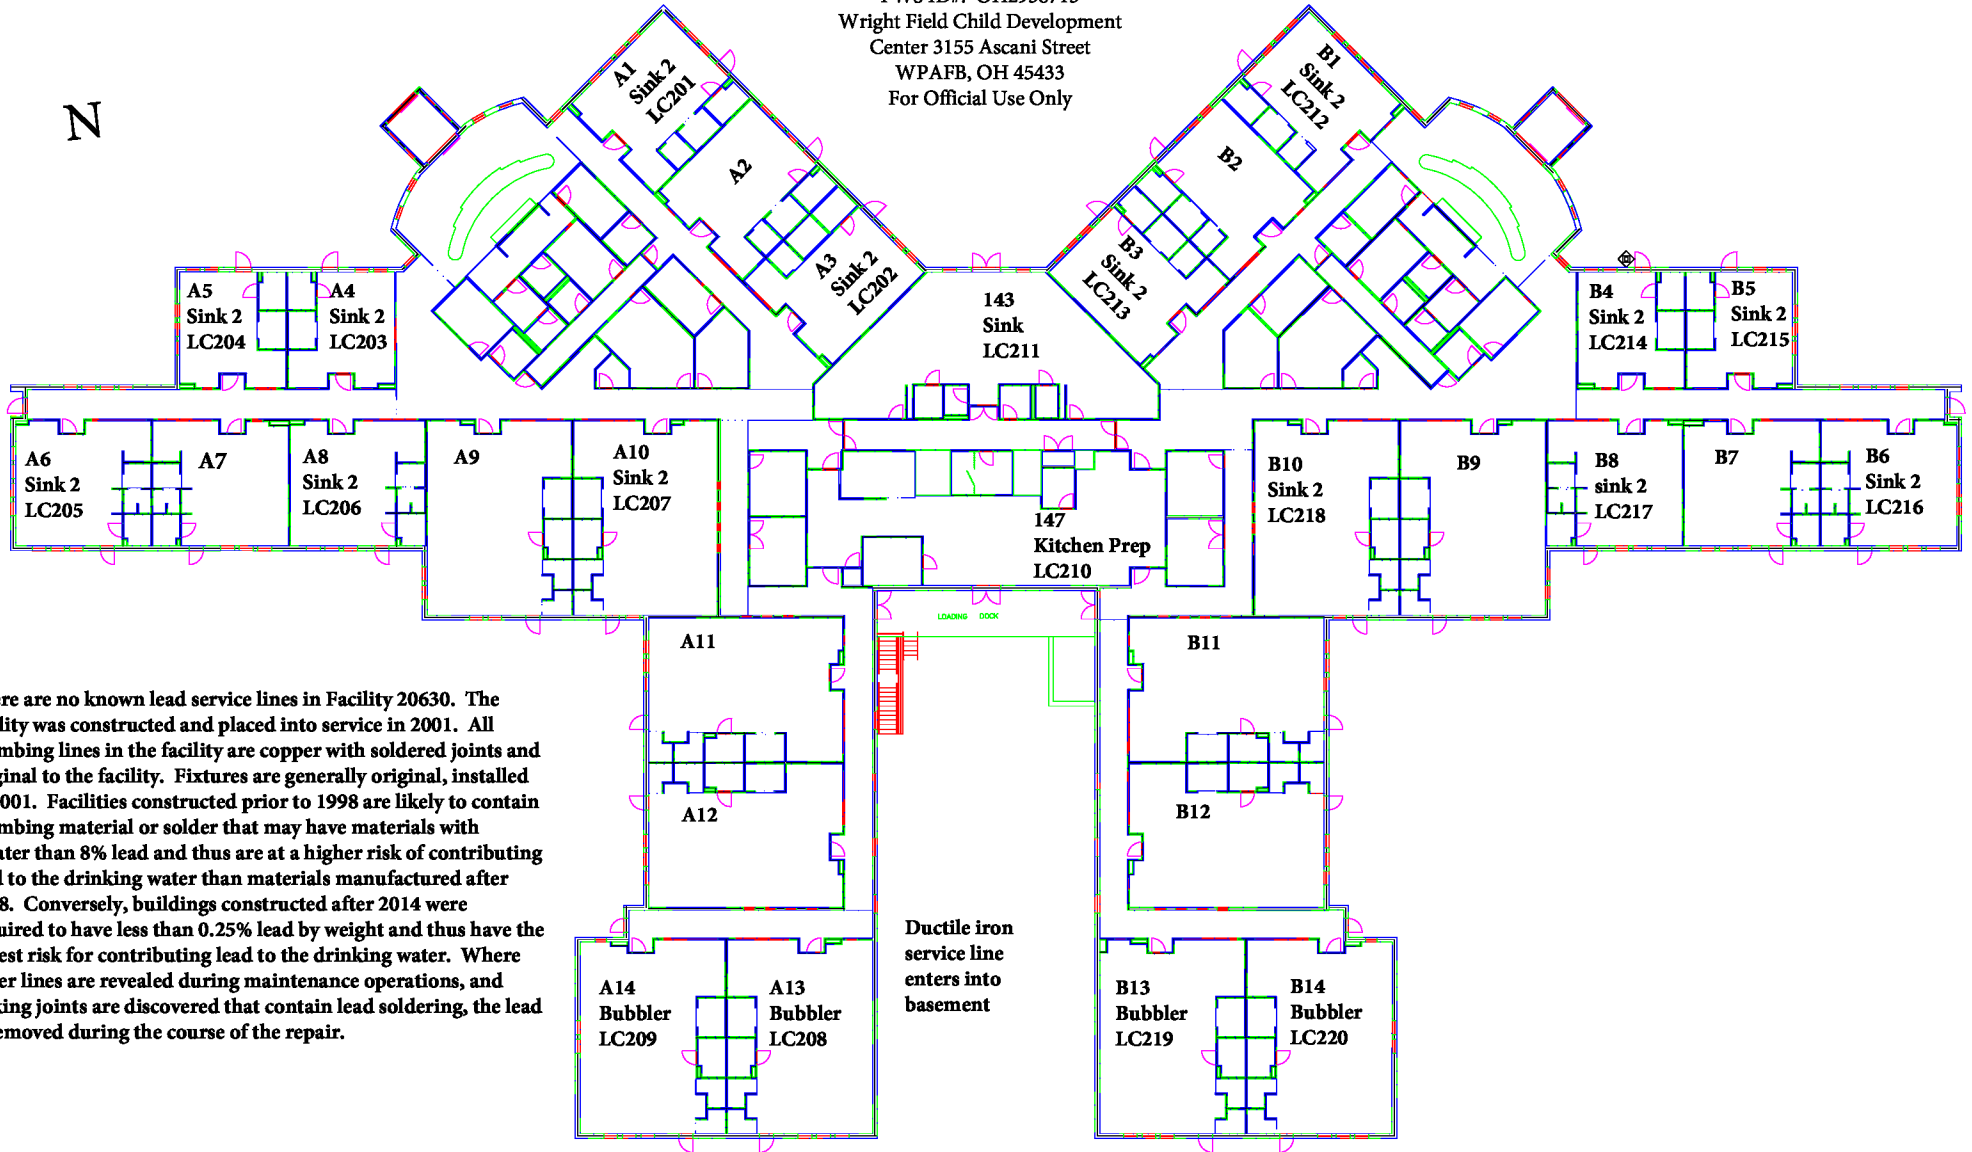

There are no known lead service lines in Facility 20630. The facility was constructed and placed into service in 2001. All plumbing lines in the facility are copper with soldered joints and original to the facility. Fixtures are generally original, installed in 2001. Facilities constructed prior to 1998 are likely to contain plumbing material or solder that may have materials with greater than 8% lead and thus are at a higher risk of contributing lead to the drinking water than materials manufactured after 1998. Conversely, buildings constructed after 2014 were required to have less than 0.25% lead by weight and thus have the lowest risk for contributing lead to the drinking water. Where water lines are revealed during maintenance operations, and leaking joints are discovered that contain lead soldering, the lead is removed during the course of the repair.